



TOGETHER
for a sustainable future

OCCASION

This publication has been made available to the public on the occasion of the 50th anniversary of the United Nations Industrial Development Organisation.



TOGETHER
for a sustainable future

DISCLAIMER

This document has been produced without formal United Nations editing. The designations employed and the presentation of the material in this document do not imply the expression of any opinion whatsoever on the part of the Secretariat of the United Nations Industrial Development Organization (UNIDO) concerning the legal status of any country, territory, city or area or of its authorities, or concerning the delimitation of its frontiers or boundaries, or its economic system or degree of development. Designations such as “developed”, “industrialized” and “developing” are intended for statistical convenience and do not necessarily express a judgment about the stage reached by a particular country or area in the development process. Mention of firm names or commercial products does not constitute an endorsement by UNIDO.

FAIR USE POLICY

Any part of this publication may be quoted and referenced for educational and research purposes without additional permission from UNIDO. However, those who make use of quoting and referencing this publication are requested to follow the Fair Use Policy of giving due credit to UNIDO.


CONTACT

Please contact publications@unido.org for further information concerning UNIDO publications.

For more information about UNIDO, please visit us at www.unido.org

23369

EDATHANALKUTHU
MINI HYDROELECTRIC PROJECT
2 x 250 kW

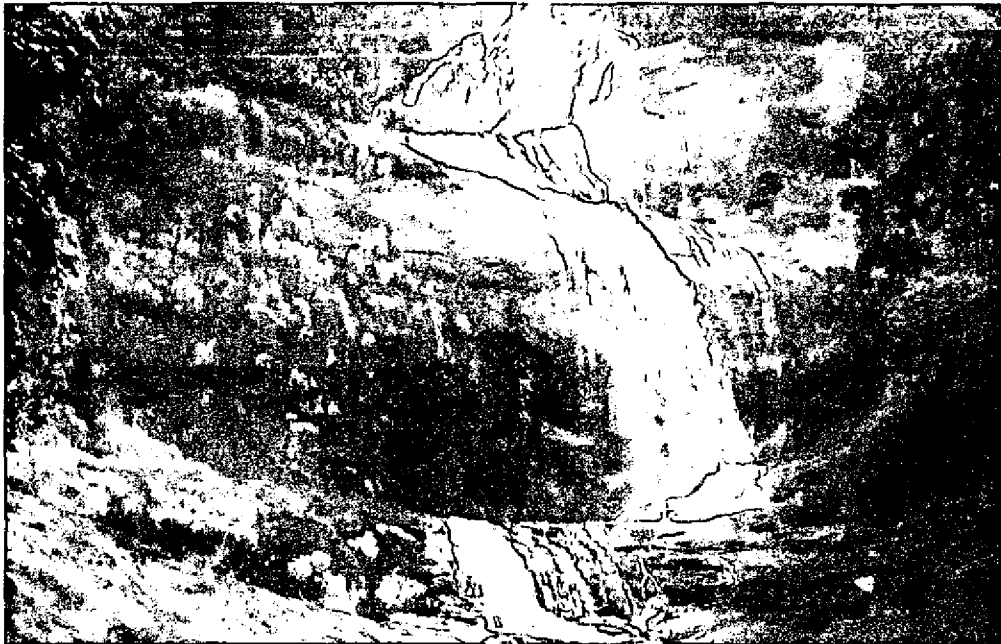

DETAILED PROJECT REPORT

for

UNIDO Regional Centre for Small Hydropower

MARCH 2007

CONTENTS

Preface

PART - I GENERAL REPORT

CHAPTER I.	SALIENT FEATURES OF PROJECT	1
CHAPTER II.	INTRODUCTION	4
CHAPTER III.	SURVEYS & INVESTIGATION	7
CHAPTER IV.	HYDROLOGY	9
CHAPTER V.	GEOLOGY	15
CHAPTER VI.	NEED & NECESSITY OF THE PROJECT	16
CHAPTER VII.	CONSTRUCTION MATERIALS & PROGRAMME	18
CHAPTER VIII.	ENVIRONMENT & ECOLOGY	20
CHAPTER IX.	COST OF THE PROJECT	21
CHAPTER X.	BENEFITS & FINANCIAL ASPECTS	22

PART - II DESIGN REPORT

CHAPTER XI.	WATER AVAILABILITY AND POWER-POTENTIAL STUDIES	25
CHAPTER XII.	DESIGN CRITERIA OF MAJOR COMPONENTS OF SCHEME	36

PART - III COST ESTIMATE

CHAPTER XIII.	COST ESTIMATE CRITERIA	46
CHAPTER XIV.	COST ESTIMATE OF CIVIL WORKS	48
CHAPTER XV.	COST ESTIMATE OF ELECTRICAL WORKS (INCLUDING TRANSMISSION LINES)	51
CHAPTER XVI.	COST ESTIMATE OF DEVELOPMENTAL WORKS	52
CHAPTER XVII.	ABSTRACT OF ESTIMATE	53

PART - IV DRAWINGS

1.	INDEX MAP	URC/SHP/ ETNL /DPR/01
2.	CONTOUR DETAILS & TOPOGRAPHICAL LAYOUT OF PROJECT	URC/SHP/ETNL/DPR/02
3.	PROJECT SCHEDULE	URC/SHP/ ETNL /DPR/03

EDATHANALKUTHU MHP

PART - I
GENERAL REPORT

CHAPTER - I

SALIENT FEATURES

1. Location		
1.1	State	Kerala
1.2	District	Idukki
1.3	Thaluk	Thodupuzha
1.4	Panchayath	Vannapuram
1.5	Access	
	a. Road	30 km to Mullaringkadu from Thodupuzha, then 3 km jeep road to PH site
	b. Rail	Kochi
	c. Airport	Kochi
	d. Harbour	Kochi
1.6	Geographical Co-ordinates	
	Latitude	9°59.5' N
	Longitude	76°49.5' E
2. River		
2.1	River	Kotamangalam thodu, a tributary of Kotamangalam Ar.
2.2	Basin	Muvattupuzha
3. Hydrology		
3.1	Catchment Area	3.5 sq. km.
3.2	Mean annual rainfall	4163 mm
3.3	Nearest rain gauge station	Thodupuzha (Malankara Plantations)
3.4	Nearest river gauging station	Karimanal
4. Component Structures		
4.1	Diversion Structure	
	i. Type	Gravity Weir with un-gated overflow portion
	ii. Length of weir	30m
	(a) Overflow portion	15m
	(b) Non Overflow portion	10m length on Left side and 5m on right side of overflow portion
	iii. Deepest Bed Level	379.50
	iv. Excavated level	379.00
	v. Top width of non -overflow portion	1.00 m

	vi. Shape of the overflow portion	Ogee (Parabolic with vertical u/s face)
	vii. FSL	+382.50
	viii. Energy Dissipaters	Type II Stilling basin (IS)
	ix. Height of Weir at deepest bed level at overflow portion	5.00 m
	x. Top level of Non-overflow portion	+196.30
	xi. Size of river sluices and gate	0.5m dia, on right bank, with 1.00 x 1.00 m gate
4.2	Intake	
	i. Location	On Left bank non overflow portion of weir
	ii. Sill level at intake	+480.25
	iii. Size of Intake gate	1 x 1 m
	iv. Control gate	Electrically operated vertical lift gate (1.5x1.5)
	v. F. S. L	+482.50
	vi. M. D. D. L.	+481.37
	vii. C/L of penstock intake	480.64
4.5	Penstock Pipe-(Steel Pipe)	
	i. Number	1 No.
	ii. Diameter & Length	0.40m dia & 850 m long
	iii. Thickness of pipe	8 mm uniform
	iv. Design discharge	0.178 m ³ /s
	v. No of feeder lines	Main penstock line bifurcating at PH end to feed 2 turbines (2 Nos. 30cm dia)
	vi. Max. velocity	1.42m/sec
4.6	Power House	
	i. Type	Over Ground
	ii. Head (Net Head)	3777.00 m
	iii. Elevation of C/L of turbine	+96.50
	iv. Floor level of M/C hall	+95.90
	v. Tail water level (normal)	+95.38
	vi. Size	
	i. Length	7.0 m
	ii. Width	6.0 m
	iii. Height	8.0 m
	iv. Installed Capacity	250 kW
	v. Turbine type	Horizontal Pelton turbine
	vi. No. of units & capacity	2 x 250kW

4.7	Tail Race Channel	
	i. Shape	Rectangular with rubble masonry sidewalls
	ii. Length	15 m
	iii. Size	1m x 1m
	iv. Sill level of channel at exit	+94.88
4.8	Power Evacuation	
	i. Transmission lines	Power Generated will be transmitted through 11kV line for 2 km length
	ii. Local distribution	Approximately 2km of L T line
5. Power Benefits		
5.1	Annual Energy generation	2.733 Mu
6. Financial		
6.1	Total Cost of project	Rs. 280 Lakhs (incl. of distribution lines)
6.2	Cost per kW installed	Rs. 58330 /-
6.3	Cost of generation/ unit	Rs. 1.42 (incl. of local distribution lines)

CHAPTER - II

INTRODUCTION

Edathanalkuthu waterfall is located in Kotamangalam thodu stream originating from Mannankavu Mala at an altitude of 842 m. The stream drains into one of the main tributary of Muvattupuzha River. The Project site is located in Vannapuram Panchayath near Thodupuzha town - about 33 kms. The site is characterised with its high head and reasonably good summer discharge of approximately $0.18 \text{ m}^3/\text{s}$. The gross head of this site is estimated to be about 386m. The design head after deducting the losses comes to 377m. Further an additional head of about 35m is also available down stream portion of the present powerhouse site. This area is in forestland. To protect the thick growth of forest-land and to get easier environmental clearance the present site is selected for this project.

The Panchayath is electrified leaving apart from a few locations similar to the one near Mullaringkadu where this project is located. In addition there are a few Pico hydro equipments by individuals run on motorbike dynamos with batteries. The total population of the Panchayath is around 15,000 out of which 20% of the population belongs to scheduled tribe category.

Exposed rock available is through out the stream. An overflow type weir is proposed to be located in the stream at about 2km away from the road from Mullaringkadu to Pattayakudi a tribal settlement from where there is a foot path up to the weir site. The spilled water will not make any problem because the water emerges after energy dissipation. The project will not cause any forest submergence with the proposed weir having a height of 4 m from the river bed level. The Intake position is fixed at left bank in the Non-overflow block. A Scour sluice is also provided to remove silt accumulated in the reservoir. Regarding the water conductor system, a Low pressure pipe is proposed to carry water in to the forebay. The alignment of this Low pressure pipe is located in the left bank of the stream over the rock out crop. The forebay of the project and part of the penstock are also aligned along the route mentioned above. The power house location is fully in private land. The tail water is let in to the existing valley stream, which is in forest land. This project envisages 11kV power evacuation line with around 2 km to distribution locations.

The capacity of the scheme is 2 x250 kW. The capacity is selected after detailed study of the availability of water in the stream by correlating the discharge readings obtained from the nearest catchment of the Lower Periyar Hydroelectric project.

Investigation of the site has been done and many alternatives have been studied for fixing the weir location. The weir is fixed at a suitable location 2km away from the present jeep track which is presently used for transport from Mullaringkadu to Pattayakkudi. The project area is selected in such a way to avoid forest completely. On detailed study it is seen that another fall is also available after the powerhouse location. But for this project this head cannot be utilized due to the special nature of the terrain. This fall can be considered as a second stage in a later stage if necessary.

This scheme proposes to utilize the waters from Kotamangalam stream alone by constructing a Gravity type weir, a Penstock and a Power House. There is no forebay tank proposed for this project. The weir itself has a live storage capacity of approximately 250m³. From the weir a penstock having a length of about 850m, 40cm dia have to be installed for the generation of power. The turbine selected is Hori: Pelton turbine to suit the available head and discharge. The machines selected are with denomination of 2 x 250kW, as this is the optimum size, which can cater to a lean flow in the dry seasons as well.

The total estimated cost of the project is 2.80 Crores and cost per kWh is Rs. 1.42 with a pay back period of 11 years. This is economically viable and better to implement at the earliest. There is no eviction and 0.60 Ha of private land is involved in the power house and water conductor system. A simple intake with vertical lift gate is proposed on the left bank of the river through the non-overflow portion of the weir. A scour sluice is also provided in the left bank of the river adjacent to the intake structure to remove the silt, which may be deposited near the intake. The hydrology of the scheme is worked out based on the rainfall records and also by comparing the inflow available from the nearest catchment of Lower Periyar HEP. The total catchment area of the stream is 3.5 km² and average annual rainfall is 4063 mm. The hydrological calculations are made based on the data availed Karimanai Gauging station owned by KSEB and that of the rainfall details availed from Malankara Plantations, Thodupuzha.

For computing the summer discharge attempt has been made to correlate the measured lean period discharge at Mullaringkadu.

An approach road up to the powerhouse site and about 50m away from the weir site are available.

The main components of the structures of the project are

1. Concrete weir of length 30m. The overflow portion is 15m and Non-overflow portion of 10m on left and 5m on right bank.
2. A gated intake having an opening of 1.00x1.00m is provided at the Left bank, through the non-overflow portion.
3. A gated out let arrangement having 50cm diameter is also provided to remove silt accumulated in the reservoir portion.
4. A penstock having a dia of 40cm and thickness 10mm having a length of 600 m is to be provided and bifurcated near to the powerhouse.
5. A powerhouse having a size of 9 x 7x 8 m is to be provided
6. A tailrace channel of length 15 m have to be cut and lined for the safe flow of water back to the river without being affected by the high flood conditions

CHAPTER - III

SURVEY AND INVESTIGATION

Reconnaissance survey was first conducted along the course of Edathanalkuthu stream. This survey revealed that the stream upstream of the weir site is passing through moderate slope to steep slope terrain. The contribution of the high head potential due to this waterfall in the stream is the unique advantage for selecting this portion of the stream for hydropower generation.

The idea behind the field investigation was to utilise the water availability and the head potential to the optimum extent possible, after taking into consideration of all factors affecting the project, such as engineering, environmental, social, economical and especially forest. The position of powerhouse selected in such a way to avoid forestland completely. The additional head available has been sacrificed in order to avoid thick forestland

A detailed investigation was carried out independently for this project after conducting preliminary field investigation and environmental studies. Taking into account of possible impact on the forest, it was decided to carry out construction activities in private land.

The land lying on the right bank of the stream is private land. A portion of the land has been kept unutilised, since the area is lying near the boundary of Thodupuzha Reserve forest. The private area is owned by the people in and around Mullaringkadu. This land is being used for cultivating pepper, rubber, areca nut and other cash crops and other agricultural produces by farmers. Data collected through reconnaissance study, reveals that the water conductor system, and powerhouse etc can be located on the Left bank of the stream, without having any impact on the forest, the tribal people and settlement system.

Since no level benchmark is established at this site, an arbitrary benchmark value assigned at the top of the waterfall by using digital altimeter. This value confers with the spot level value shown in the Survey of India topo sheets as well as the reading taken at the weir site. A preliminary topography survey is carried out covering the project area which is purely on the right bank of the stream. The level difference of the ground at the top of the waterfall and the powerhouse site comes to 386 meters, i.e., (483.00 – 97.00). Alternate proposals with weir site and P.H site at various levels were studied and it is concluded that the present proposal is the best without disturbance of forest.

Topography survey covering the whole project area was completed. A copy of the survey drawing is enclosed. Survey conducted along the alignment of water conductor system in the right bank. Alternate routes for the water conductor system were studied and a penstock is proposed to conduct water up to the powerhouse.

Cross section of the stream at weir site, and powerhouse sites are taken. A survey of the penstock route is also conducted. The powerhouse site is easily approachable with pedestrian track of 50m from tarred road.

Preliminary property survey conducted revealed that there is no necessity of eviction and also no resettlement requirement due to the project. The project area is partly in private land and vested riverine forests.

CHAPTER – IV

HYDROLOGY

Mullaringadu is located in Vannapuram Panchayat in Idukki District. This place is about 33 km distant from the Thodupuzha and approachable by good tarred road. Mullaringadu stream is a tributary of Muvattupuzha river. The stream is formed by two other streams called Edathanalthodu and Balanaduthodu.

Edathanalkuthu Mini Hydro electric Scheme envisages the utilisation of water from Kotamangalam thodu stream, the primary tributary of Muvattupuzha River originating from Mannankavu Mala at an altitude of 842 m. The Edathanalkuthu stream flows in the north-west direction before joining to Balanthodu and thereafter flow westwards. A temporary river gauging was established in the in the stream after its confluence with Balanthodu. The rain gauge readings available are, rain gauge station maintained by Malankara Plantation at Thodupuzha. The monthly rainfall readings of rain gauge station at Malankara Plantations, Thodupuzha from 1995 to 2003 were collected & attached in Table-1.

The Hydrology of the project has been arrived after considering the hydrology of Malankara Mini hydro project which is at Thodupuzha sanctioned by Kerala Government recently for implementation by private owner for captive use, for detailed study in correlation with data availed from Lower Periyar Hydel project of KSEB. A rainfall run-off correlation was arrived based on the rainfall data at Malankara and that at Lower Periyar and thereafter the regression equations were compared with the gauge data at Mullaringkadu downstream of Edathanalkuthu. Based on these comparisons the gauge data collected were roughly matching with that of the 50% dependable year. Hence the gauge data at site of year 2000 was used for the power potential studies.

Project site is located very near to Mullaringkau by about 4 km. The site is characterised with its high head and reasonably good summer discharge of approximately $0.18\text{m}^3/\text{s}$.

The discharge in the stream has been computed proportional to the catchment areas based on the inflow readings as explained above is tabulated in Table-II. On computation from the monthly discharge it can be seen that

The average discharge of six months (monsoon period) is

1. For 10 years (1997 to 2006) = 0.85 m³/s
2. 50% dependable year (2000) = 0.81 m³/s

Considering the lean period discharge and the a factor for evaporation losses and other utilisations, the power potential study has been conducted for 50% dependable year and the installed capacity is fixed as 500kW. Considering 10% overloading of turbine & generator the required discharge will be 0.178m³/s.

Maximum flood estimation

Flood estimation is done using Ryve's formula, $Q_{max} = C(A)^{2/3}$.

This project site is at about 80km from the seacoast. Hence the coefficient is taken as 8.45. Therefore $Q_{max} = 8.45 \times (7.25)^{2/3} = 31.65 \text{ m}^3/\text{s}$. This discharge is considered for the design of overflow portion of the weir.

Water utilisation

On observing the present condition of the river it is seen that water is available in good quantity during monsoon period and very small quantity during summer months. The average discharge during summer month is 0.18m³/s. The water after power generation is let into the same stream. No hindrance will be brought down on the inhabitants after commissioning of the scheme.

Water quality and sedimentation

Since the project is designed as a run of the river scheme no problem due to siltation will be expected. However silt exclusion arrangements have been made in the dam body near the intake portion. Water is of good quality and people are using this water for drinking purposes directly.

Climatological parameters

The climate is generally moderate, with normal temperature of 28°C. The average annual rainfall is 4163 mm. Good Rainfall is available from May to November. This scheme is a run of the river scheme and power generation is intended during monsoon season only.

Table - III. Computed Monthly Inflow of Edathanaikuthu Catchment (In Mm³) Catchment Area 7.25 km²

Year	January	February	March	April	May	June	July	August	September	October	November	December	yearly total
1997	0.16	0.11	0.30	1.24	1.71	7.27	8.26	3.36	1.81	1.06	0.62	0.35	26.24
1998	0.11	0.07	0.21	0.85	1.18	6.22	4.38	2.93	1.06	0.47	0.44	0.24	18.17
1999	0.11	0.07	0.20	0.80	1.11	4.49	6.07	1.82	0.92	0.71	0.53	0.23	17.05
2000	0.08	0.45	0.19	1.21	0.93	7.39	3.79	0.42	0.97	3.36	2.07	0.04	20.89
2001	0.16	0.11	0.31	1.23	1.69	5.47	6.54	6.26	1.76	1.63	0.58	0.34	26.07
2002	0.10	0.07	0.20	0.82	1.13	3.19	7.18	1.86	0.67	1.72	0.25	0.23	17.42
2003	0.13	0.09	0.26	1.06	1.45	4.09	3.55	4.89	3.14	2.19	1.34	0.30	22.49
2004	0.13	0.08	0.24	0.98	1.36	2.74	5.13	4.67	3.69	0.63	0.99	0.27	20.91
2005	0.17	0.11	0.33	1.33	1.84	6.07	7.08	2.76	3.63	4.20	0.43	0.36	28.32
2006	0.17	0.10	0.31	1.27	1.75	7.85	5.67	3.59	2.36	3.12	0.46	0.35	26.99

50% Dependable

Table - I → Monthly rain fall data from Malankara Plantations, Thodupuzha in mm

Year Month	1995	1996	1997	1998	1999	2000	2001	2002	2003
January	0	19.558	8.382	58.674	0	22.86	0	0	0
February	0	18.542	0	15.748	13.716	110.236	92.71	21.844	27.94
March	0	14.986	112.522	82.55	110.998	42.164	110.49	136.906	361.696
April	313.182	515.366	177.038	295.656	254	166.37	318.262	261.874	96.52
May	611.886	114.046	445.77	460.502	797.56	133.858	226.568	440.69	194.818
June	709.422	682.752	500.126	902.462	579.882	884.174	1081.278	586.232	557.022
July	757.936	962.66	1157.732	615.696	845.312	355.854	892.302	507.238	667.512
August	763.778	560.578	562.864	702.31	250.952	1046.988	300.482	649.478	609.346
September	336.804	566.42	275.082	801.624	247.65	351.282	280.416	110.998	128.524
October	284.988	618.49	549.91	716.534	989.33	213.106	434.848	593.344	812.8
November	237.236	248.666	477.774	0	71.374	56.134	261.112	173.99	69.596
December	0	72.898	57.912	227.584	221.742	44.45	34.036	32.004	69.596
TOTAL	4015.232	4394.962	4325.112	4879.34	4382.516	3427.476	4032.504	3514.598	3595.37


Mean annual rain fall = 4063 mm

Table - III. Computed Monthly Inflow of Balanthodu Catchment (In Mm³) Catchment Area 3.5 km²

Year	January	February	March	April	May	June	July	August	September	October	November	December	Yearly total
1997	0.16	0.11	0.30	1.24	1.71	7.27	8.26	3.36	1.81	1.06	0.62	0.35	26.24
1998	0.11	0.07	0.21	0.85	1.18	6.22	4.38	2.93	1.06	0.47	0.44	0.24	18.17
1999	0.11	0.07	0.20	0.80	1.11	4.49	6.07	1.82	0.92	0.71	0.53	0.23	17.05
2000	0.08	0.45	0.19	1.21	0.93	7.39	3.79	0.42	0.97	3.36	2.07	0.04	20.89
2001	0.16	0.11	0.31	1.23	1.69	5.47	6.54	6.26	1.76	1.63	0.58	0.34	26.07
2002	0.10	0.07	0.20	0.82	1.13	3.19	7.18	1.86	0.67	1.72	0.25	0.23	17.42
2003	0.13	0.09	0.26	1.06	1.45	4.09	3.55	4.89	3.14	2.19	1.34	0.30	22.49
2004	0.13	0.08	0.24	0.98	1.36	2.74	5.13	4.67	3.69	0.63	0.99	0.27	20.91
2005	0.17	0.11	0.33	1.33	1.84	6.07	7.08	2.76	3.63	4.20	0.43	0.36	28.32
2006	0.17	0.10	0.31	1.27	1.75	7.85	5.67	3.59	2.36	3.12	0.46	0.35	26.99

50% Dependable

Edathanalkuthu MHP - Flow Duration Curves

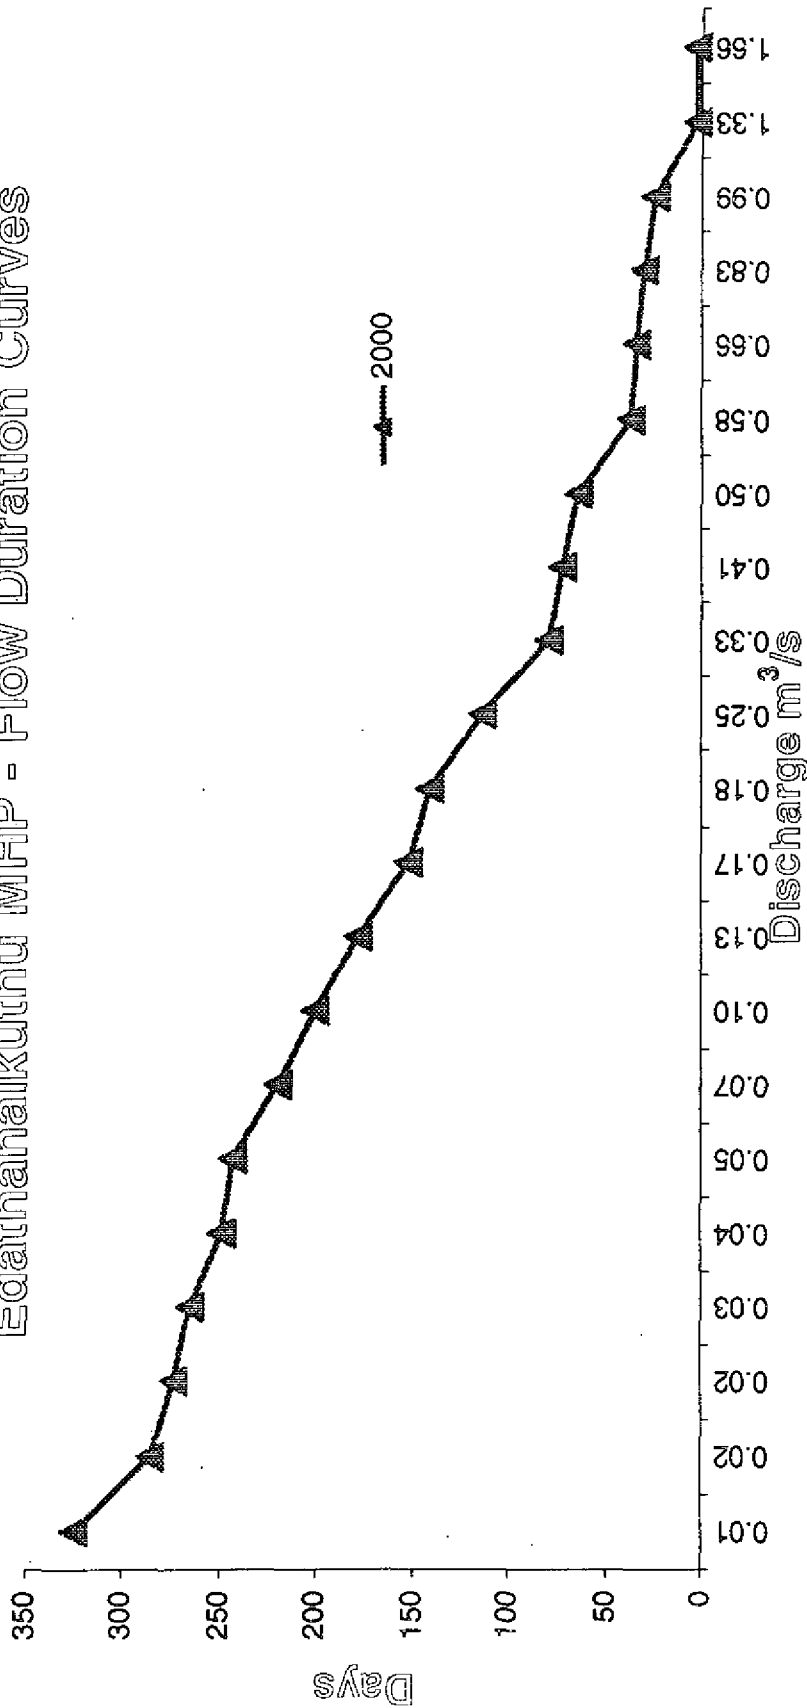

CHAPTER - V

GEOLOGY

The project area belongs to the typical formation of Western Ghats. The rock type in these ranges belongs to metamorphic nature, with more presence of Granitic Gneiss & Charnokite.

The dominant rock type at the weir site is gneiss. Exposed rock is seen at weir site and also along the portion of Penstock. The bed of the waterfall is solid rock with small potholes due to the effect of falling water. Hence no geological exploration by core boring is carried out at weir site. The powerhouse is proposed on the right bank of the stream. Here the stream flows through a moderately level bed. Hence the riverbank is formed by the accumulation of river cobbles and pebbles carried through the water in flood. In powerhouse area also rock is expected at a reasonable depth.

General geology is suitable for weir site, Fore-bay, powerhouse site and water conductor system. Borehole details have to be obtained before the construction of fore-bay, and Power house.

CHAPTER – VI

NEED & NECESSITY OF THE PROJECT

Idukki District in general and the project area in particular is one of the most exquisite ecological and natural resource regions in Kerala. It is one of the natural resource regions where hydrological, forest and agricultural resource systems symbiotically co-exist, providing an optimum and adequate opportunity for initiating comprehensive sustainable development initiatives. As far as the agricultural potential and bio-diversity is concerned, the project area presents a dynamic and encouraging scenario/picture. It is also encouraging to note that the agricultural and forest ecosystems of this area together provide an enduring support base for a variety of medicinal plant wealth. The agricultural cropping pattern is especially compatible with developing different value added micro/small industrial/ enterprise systems. However, the full developmental benefit/potential could not be realised due to the non-availability of electricity. The existing electricity distribution network which is six km away, in an extremely undulating topographical background, could not be extended to this project settlement region because of prohibitive infrastructural and investment cost.

Even though the project impact settlement system is a robust ecological region, in the summer months water scarcity is a serious problem. It is paradoxical that when water as a basic resource is physically available, it could not be made use of for agricultural operation because of the peculiar topographical formations. If electricity is made available, the locally available water resource could be systematically channelled towards agricultural and human welfare/development objectives.

It is most disturbing that a major part of agricultural produce (especially vegetables and fruits) and milk is destroyed due to the lack of opportunities for electricity-based preservation and value-addition.

In the context of health, education and cultural development, especially the project impact area suffers significantly as no electricity based support system could be developed. The main beneficiaries are tribal population (40%) who are below poverty line. Absence of electricity supported social, economic and infrastructure (like home and street lighting systems, milk, vegetable and fruit preservation systems, value added processing using locally available rubber, fruits and vegetables etc.) as such became a permanent bottleneck in the development of this region. The non-availability of electricity also became a barricade in people living in the settlement region getting the cultural, educational, health and psychological benefits of modern technology. If electricity is made available to this region it could lead to optimum sustainable utilisation of these resources through preservation and value added processing initiatives. Such value added programmes and production of new plant based medicines will also help to improve the nutritional and health status of the people.

The reconnaissance survey and personal discussion which the Engineers of EMC had with the local people also reveal that the availability of electricity will significantly help develop/initiate micro/small enterprises like rice mill, flour mill, oil mill etc. including facility for semen preservation and artificial insemination for veterinary development. Further, the availability of electricity could help/develop eco-tourism in this area, resulting in an overall and comprehensive socio-economic, cultural and educational development of population especially the poverty stricken tribal who are facing seasonal unemployment and perpetual under-employment.

EMC-UNIDO-RC team has also identified that the absence of electricity to a greater extent prevented the process of providing the people residing in this settlement with adequate health and educational facilities. The team further found that the non-availability of electricity became a limiting factor in deriving the full advantage of health and educational facilities to the people of the settlement region. Also the absence of electricity became a stumbling block in providing the benefits of information and entertainment to the people of the project impact-area, which ultimately turned out as a permanent bottleneck in the process of cultural and educational advancement of the people.

Therefore, the reconnaissance survey and social contact programme (socio-economic and ecological/environmental) organised by the EMC,UNIDO-RC categorically identify that the development of the two mini-hydel systems (Balanthodu and Edathanalkuthu) will result in comprehensive sustainable development of the project region.

This report is the result of a sparkling example of such an effort from UNIDO. The Edathanalkuthu Mini Hydro Scheme is located In Vannapuram Panchayath, Thodupuzha Block, in Idukki District. The two streams Balanthodu and Kotamangalam thodu join at Mullaringkau, and thereafter flows on to form the Kotamangalam Ar which merges with Muvattupuzha River as a tributary. The capacity of the scheme is 500KW with an energy generation of 2.733Mu. Considering the importance of energy especially in this region the project have to be implemented early.

CHAPTER - VII

CONSTRUCTION MATERIALS AND PROGRAMME

(a) Materials

For the construction of this project, the materials that are locally available as well as materials to be transported from elsewhere in the State can be utilised.

Source and availability

Rubble is available at the project site. An aggregate processing plant is proposed to be established near the Power House site. The coarse aggregates and fine aggregates can be produced at the plant using the rubble quarried here. Even though river sand is available in some part of the river, in the light of the environmental impact, as far as possible sand mining can be avoided. Hence crushed sand is proposed for construction purpose.

The project area is accessible through road and there will be no difficulty to convey Cement and Steel materials by Lorry. Tor-steel for reinforcement of concrete and steel plates for the fabrication of control gates, sluice gates, trash-racks and Penstock pipe and structural steel section for switchyard, etc can be brought from Kothamangalam or Kochi by lorry.

Turbines and generating equipments if to be imported, these can be shipped to Cochin Port. From there, these items can be brought to site by lorry.

(b) Programme of Construction

Edathanalkuthu Mini Scheme is proposed to be constructed under the guidance of UNIDO-RC and the work can be executed on contract basis. The proposed execution will be either a turnkey contract or separate contract for civil work, penstock fabrication & Erection work, Fabrication of Gates and its erection, Purchase and erection of Hydro mechanical Equipment etc. The quality control and the supervision for the entire work will be under the guidance of UNIDO-RC.

A Bar chart showing the starting and completion of various activities connected with the implementation of this project is attached with this project report.

The main activities involved are

1. Project Sanction including Finance
2. Marking Project Profile and fixing boundaries

3. Detailed design of the component Structures
4. Land acquisition
5. Preparation of tender documents
6. Tendering and award of Contract
7. Preliminary works, Access roads and infrastructure facilities.
8. Procurement of construction materials
9. Excavation of weir and intake.
10. Excavation of Penstock and anchor block.
11. Excavation of Power House, Tail Race and Switch Yard etc.
12. Concreting of weir
13. 1st Stage Concreting and roofing of Power House
14. Concreting of Anchor block and Erection of Penstock
15. Concreting of Tail Race & Switch yard
16. Supply and erection of T & G equipments, substation equipments etc
17. Erection of Machinery 1st stage
18. PH second stage concreting
19. Supply and erection of Gates and valves.
20. Fabrication and erection of Penstock
21. Final Erection of Machines
22. Construction of 11 KV transmission line.
23. Testing, Balancing & Commissioning

It is targeted to complete the construction activities, erection of T & G equipments and conduct trial running of the generators within 18 months from the date of awarding contract.

Multi-face activities are proposed. All the civil construction works will be carried out simultaneously to achieve the target. The entire activities of the project implementation will have to be monitored by an expert team of engineers.

CHAPTER - VIII

ENVIRONMENT AND ECOLOGICAL ASPECTS

Edathanalkuthu M H P is formulated as a run off the river scheme. As such no pondage (reservoir) is envisaged in this scheme. The minor storage proposed is to accommodate the power intake for taking water safely to the Channel.

The detailed engineering investigation of the project were carried out such that no submergence, no diversion, no disturbance for the public, will occur. Therefore no impact on environment and ecological aspects is expected due to this project. Also, no resettlement and rehabilitation is required for this project.

Total project area is in private land. The construction of the project will be in such a way, that the disturbance of forest due to this project is totally eliminated by selecting the position of the power station. This Project report is so formulated taking into account of all the aspects to avoid the impact on environment due to this project. The water after power generation is let into the same stream.

CHAPTER - IX
COST OF THE PROJECT

Abstract of Costs

	In Rs. Lakhs
I Civil Works	
A. Preliminary (Land, Building etc.)	9.60
B. Civil Works – Diversion structures, Water conductor System, Forebay, Powerhouse and Tail Race etc.	101.40
II Electrical Works	
i. Power plant equipments, accessories switchyard equipment	145.00
ii. Transmission lines	5.00
III Establishment charges including Project Management, Audit and Accounts, Running cost of vehicles, Welfare to workers, Inspection of UNIDO and other Experts and Officials, Maintenance of roads during the construction period, Camp equipments, forest and other clearances etc.	7.00
IV Contingencies, consultancy, quality control, etc.	12.00
Total	260.00

9.2 Year wise planning

The project is proposed to be implemented within a span of 2 years.

Expenditure for 1st year	Rs. 155.00 lakhs
Expenditure for 2 nd year	Rs. 125.00 lakhs
Total	Rs. 280.00 lakhs

CHAPTER - X

BENEFITS AND FINANCIAL ASPECTS

Edathanalkuthu Mini hydel Project proposed to be implemented under the guidance of UNIDO for the generation of energy to meet the power requirements of the local people in and around Mullaringkadu & Pattayakudi area.

Direct benefit of this project is the availability of 2.733 MU of hydropower after deducting auxiliary consumption.

For the analysis of the financial viability of this project the following calculations are made.

1. Deprecation of the component structures of project and average depreciation constant
2. Interest to be accrued on the capital during the period of construction. This amount is to be capitalised at the end of project construction.
3. Annual recurring expenses include (a) Interest 10% (b) Depreciation 2.3% (c) O&M charges 1.0% etc.
4. Dividend on Equity is 10%
5. Equity/ Loan ratio 25:75

The cost of generation of energy is found to be Rs 1.42/kWh. A financial analysis statement showing the capital expenditure, phasing of expenditure, recurring expenditure, cost of generation etc prepared and attached.

FINANCIAL ANALYSIS STATEMENT

Name of Project: - Edathanalkuthu MHP
 INSTALLED CAPACITY - 0.50 MW
 Total Cost of project = Rs. 280.00 Lakhs
 Period of implementation of project: 2 years
 Source of financing of project: 25% Equity, 75% loan
 Equity = 70 Lakhs Loan = 210 Lakhs

Phasing of expenditure	25% Equity	75% loan	Total
1 st Year	Rs. 70 Lakhs	Rs. 85 Lakhs	Rs. 94.4 Lakhs
2 nd Year	Rs. 0 Lakhs	Rs. 125 Lakhs	Rs. 100 Lakhs

Interest on loan = 10%

Interest During Construction

1st Year = $85 \times (10\%) / 2 = 4.25$ Lakhs

2nd Year = $125 \times (10\%) / 2 + 85 \times 10\% = 7.38$ Lakhs

Total = 11.63 say, Rs. 11.65 Lakhs

Interest during construction is capitalized. Hence total loan = Rs.221.65 Lakhs

Total cost of project on completion will be $70 + 221.65 =$ Rs. 291.65 Lakhs

i.e., Cost per M.W = Rs. 583.3 Lakhs

Annual recurring expenses

(a) Interest on loan @ 10% p.a = Rs. 22.17 Lakhs

(b) Operation and maintenance expenses @ 1% of Project cost = Rs. 2.8 Lakhs

(c) Depreciation @ 2.3% of project cost = Rs. 6.44 Lakhs

(d) Dividend on Equity at 10% = Rs. 7 Lakhs

(e) Total expenses = Rs. 38.41 Lakhs

Total power generated from the project = 2.733 Mu

Deducting

i. Power for auxiliary use @ 1% of generation = 0.02733 say, 0.03 Mu

ii. Transmission and wheeling

Net power available = 2.703 Mu

Cost of generation of power per unit = $38.41 / [2.703 \times 10] =$ Rs. 1.42

The repayment and interest are to be made at a flat rate of $[22.17 + 11.09] =$ Rs. 33.26 Lakhs (every year for complete repayment of loan + interest by 11 years)

Presently incentives & Subsidies are available from MNES. But this has not been considered in the financial analysis, owing to the reason that this amount is a variable subject to availability of fund.

Edathanalkuthu MHP (500kW)

Calculation of pay back period and cash flow statement.

Year from commencement of the project	Sum of expenditure (Loan) at the beginning of the year in Rs. Crores	Yearly capital expenditure through equity in Rs Crores.	Yearly capital expenditure through loan in Rs. Crores	Interest @10% of col(2) +interest @5% of col(4)	O/M cost +depreciated expenses in Rs. Crores	Net Power Available for the company in MU	Gross revenue in Rs Crores	Return on Equity	Net revenue col(8) - col(6) - col(9)	Annual surplus +ve or -ve (col.(10) - col.(5))	Sum of expenditure (Loan) at the end of year col.(2) + col.(6) - col.(11)
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)
II	0.00	0.70	0.85	0.04						0.04	0.89
1	0.89	0.00	1.25	0.15	0.09	2.70	0.50	0.07	0.33	-0.15	2.29
2	2.29	0.00	0.00	0.23	0.09	2.70	0.50	0.07	0.33	0.10	2.19
3	2.19	0.00	0.00	0.22	0.09	2.70	0.50	0.07	0.33	0.11	2.08
4	2.08	0.00	0.00	0.21	0.09	2.70	0.50	0.07	0.33	0.13	1.95
5	1.95	0.00	0.00	0.20	0.09	2.70	0.50	0.07	0.33	0.14	1.81
6	1.81	0.00	0.00	0.18	0.09	2.70	0.50	0.07	0.33	0.15	1.66
7	1.66	0.00	0.00	0.17	0.09	2.70	0.50	0.07	0.33	0.17	1.49
8	1.49	0.00	0.00	0.15	0.09	2.70	0.50	0.07	0.33	0.18	1.31
9	1.31	0.00	0.00	0.13	0.09	2.70	0.50	0.07	0.33	0.20	1.11
10	1.11	0.00	0.00	0.11	0.09	2.70	0.50	0.07	0.33	0.22	0.88
11	0.88	0.00	0.00	0.09	0.09	2.70	0.50	0.07	0.33	0.24	0.64
12	0.64	0.00	0.00	0.06	0.09	2.70	0.50	0.07	0.33	0.27	0.37
13	0.37	0.00	0.00	0.04	0.09	2.70	0.50	0.07	0.33	0.30	0.07
14	0.07	0.00	0.00	0.01	0.09	2.70	0.50	0.07	0.33	0.33	-0.25
15	-0.25	0.00	0.00	-0.03	0.13	2.70	0.20	0.07	0.00	0.03	-0.28
16	-0.28	0.00	0.00	-0.03	0.13	2.70	0.20	0.07	0.00	0.03	-0.31
17	-0.31	0.00	0.00	-0.03	0.13	2.70	0.20	0.07	0.00	0.03	-0.34
18	-0.34	0.00	0.00	-0.03	0.13	2.70	0.20	0.07	0.00	0.03	-0.37
19	-0.37	0.00	0.00	-0.04	0.13	2.70	0.20	0.07	0.00	0.04	-0.41
20	-0.41	0.00	0.00	-0.04	0.13	2.70	0.20	0.07	0.00	0.04	-0.45
21	-0.45	0.00	0.00	-0.04	0.13	2.70	0.20	0.07	0.00	0.04	-0.49
22	-0.49	0.00	0.00	-0.05	0.13	2.70	0.20	0.07	0.00	0.05	-0.54
23	-0.54	0.00	0.00	-0.05	0.13	2.70	0.20	0.07	0.00	0.05	-0.60
24	-0.60	0.00	0.00	-0.06	0.13	2.70	0.20	0.07	0.00	0.06	-0.66
25	-0.66	0.00	0.00	-0.07	0.13	2.70	0.20	0.07	0.00	0.07	-0.72
	-0.72	0.00	0.00	-0.07	0.13	2.70	0.20	0.07	0.00	0.07	-0.79

EDATHANALKUTHU MIHP

PART - II
DESIGN REPORT

CHAPTER - XI

WATER AVAILABILITY & POWER POTENTIAL STUDIES

Edathanalkuthu MHP scheme envisages utilisation of water in the stream a tributary of Kotamangalam river in Muvattupuzha basin for power generation of 500kW. The scheme is designed as a run of the river scheme with no storage provisions.

Average rainfall

The monthly rainfall readings of rain gauge station at Malankara Plantations, Thodupuzha from 1995 to 2003 were collected for the hydrological studies. The average annual rainfall in the rain gauge station is 4163 mm. A rainfall run-off correlation was arrived based on the rainfall data at Malankara and that at Lower Periyar and thereafter the regression equations were compared with the actual gauge data at Mullaringkadu downstream of Edathanalkuthu. Based on these comparisons the gauge data collected were roughly matching with that of the 50% dependable year. Hence the gauge data at site of year 2000 (50% dependable year) was used for the power potential studies.

The catchment area of the stream at the weir location is about 7.25 km².

Rainfall Details in mm at Malankara Plantations Rain Gauge station 1995-2003

Year	Annual Rainfall
1995	4015.2
1996	4395
1997	4325.1
1998	4679.3
1999	4362.5
2000	3427.5
2001	4032.5
2002	3514.6
2003	3595.4
Average	4163

The net head available for power generation is worked out as below.

1. Full reservoir level	-	+482.50
2. Bed level of stream at weir site	-	+479.50
3. M.D.D.L	-	+481.50
4. Level of c/l of runner	-	+96.50
5. Max Head available	-	386 m
6. Net design head allowing a head loss of 8 m	-	377 m

For a Power requirement of 1000 kW

$$\text{Power, } P = 8.Q.H$$

$$1000 = 8 \times Q \times H$$

$$H = 377 \text{ m}$$

Then power draft, $Q = 1000/8 \times 107 = 0.324 \text{ m}^3/\text{s}$

Power draft for various capacities of turbines from 100kW to 550 kW are as follows

100 kW	0.032 m ³ /s
200 kW	0.065 m ³ /s
300 kW	0.097 m ³ /s
400 kW	0.130 m ³ /s
500 kW	0.162 m ³ /s
550 kW	0.178 m ³ /s

The power generation possible with turbines of capacity from 100kW to 550 kW (10% overload of 500 kW) are worked out and attached. For optimum power utility, it is proposed to have two generators of 250 kW each. The power potential study has been conducted and attached. The Annual energy generation will be 2.733 Mu.

Power potential calculation for Edathanalkuthu MHP project
for 50% dependable year - 2000

Date	Computed Discharge at Edathanalkuthu (m ³ /s)	Maximum Generatable Power (kW)	Power (kW) with 2x125	Mu/day
1-Jan-00	0.02	27.22	0.00	0.000
2-Jan-00	0.02	27.22	0.00	0.000
3-Jan-00	0.02	27.22	0.00	0.000
4-Jan-00	0.02	27.93	0.00	0.000
5-Jan-00	0.03	31.16	0.00	0.000
6-Jan-00	0.02	27.93	0.00	0.000
7-Jan-00	0.02	27.93	0.00	0.000
8-Jan-00	0.03	29.19	0.00	0.000
9-Jan-00	0.03	29.46	0.00	0.000
10-Jan-00	0.03	29.46	0.00	0.000
11-Jan-00	0.03	29.46	0.00	0.000
12-Jan-00	0.03	29.46	0.00	0.000
13-Jan-00	0.03	29.46	0.00	0.000
14-Jan-00	0.03	30.29	0.00	0.000
15-Jan-00	0.03	30.29	0.00	0.000
16-Jan-00	0.03	30.29	0.00	0.000
17-Jan-00	0.03	32.03	0.00	0.000
18-Jan-00	0.03	32.03	0.00	0.000
19-Jan-00	0.03	32.03	0.00	0.000
20-Jan-00	0.03	33.01	0.00	0.000
21-Jan-00	0.03	33.01	0.00	0.000
22-Jan-00	0.03	33.01	0.00	0.000
23-Jan-00	0.03	34.06	0.00	0.000
24-Jan-00	0.03	35.17	0.00	0.000
25-Jan-00	0.03	35.17	0.00	0.000
26-Jan-00	0.03	35.17	0.00	0.000
27-Jan-00	0.03	36.36	0.00	0.000
28-Jan-00	0.03	37.54	0.00	0.000
29-Jan-00	0.04	41.93	0.00	0.000
30-Jan-00	0.04	41.93	0.00	0.000
31-Jan-00	0.04	41.93	0.00	0.000
1-Feb-00	0.29	332.89	332.89	0.008
2-Feb-00	0.29	332.89	332.89	0.008
3-Feb-00	0.29	332.89	332.89	0.008
4-Feb-00	0.29	332.89	332.89	0.008
5-Feb-00	0.29	332.89	332.89	0.008
6-Feb-00	0.29	332.89	332.89	0.008
7-Feb-00	0.29	332.89	332.89	0.008
8-Feb-00	0.18	205.41	205.41	0.005
9-Feb-00	0.18	205.41	205.41	0.005
10-Feb-00	0.18	205.41	205.41	0.005
11-Feb-00	0.18	205.41	205.41	0.005
12-Feb-00	0.18	205.41	205.41	0.005
13-Feb-00	0.19	211.78	211.78	0.005
14-Feb-00	0.18	205.41	205.41	0.005
15-Feb-00	0.16	175.66	175.66	0.004

Catchment Area = 7.25km²
 Head = 377 m

Date	Computed Discharge at Edathanalkuthu (m ³ /s)	Maximum Generatable Power (kW)	Power (kW) with 2x125	Mtu/day
16-Feb-00	0.16	175.66	175.66	0.004
17-Feb-00	0.16	175.66	175.66	0.004
18-Feb-00	0.16	175.66	175.66	0.004
19-Feb-00	0.16	175.66	175.66	0.004
20-Feb-00	0.16	175.66	175.66	0.004
21-Feb-00	0.16	175.66	175.66	0.004
22-Feb-00	0.16	175.66	175.66	0.004
23-Feb-00	0.16	175.66	175.66	0.004
24-Feb-00	0.16	175.66	175.66	0.004
25-Feb-00	0.16	175.66	175.66	0.004
26-Feb-00	0.06	65.93	0.00	0.000
27-Feb-00	0.06	65.93	0.00	0.000
28-Feb-00	0.06	65.93	0.00	0.000
29-Feb-00	0.00	1.01	0.00	0.000
1-Mar-00	0.09	103.37	103.37	0.002
2-Mar-00	0.09	103.37	103.37	0.002
3-Mar-00	0.09	103.37	103.37	0.002
4-Mar-00	0.09	103.37	103.37	0.002
5-Mar-00	0.02	17.07	0.00	0.000
6-Mar-00	0.00	1.06	0.00	0.000
7-Mar-00	0.05	55.58	0.00	0.000
8-Mar-00	0.00	1.12	0.00	0.000
9-Mar-00	0.26	292.48	292.48	0.007
10-Mar-00	0.09	103.37	103.37	0.002
11-Mar-00	0.06	62.38	0.00	0.000
12-Mar-00	0.00	1.19	0.00	0.000
13-Mar-00	0.00	1.19	0.00	0.000
14-Mar-00	0.00	1.19	0.00	0.000
15-Mar-00	0.00	1.12	0.00	0.000
16-Mar-00	0.01	7.09	0.00	0.000
17-Mar-00	0.01	7.09	0.00	0.000
18-Mar-00	0.03	35.39	0.00	0.000
19-Mar-00	0.03	35.39	0.00	0.000
20-Mar-00	0.03	35.39	0.00	0.000
21-Mar-00	0.03	28.34	0.00	0.000
22-Mar-00	0.03	29.85	0.00	0.000
23-Mar-00	0.03	31.53	0.00	0.000
24-Mar-00	0.03	35.39	0.00	0.000
25-Mar-00	0.08	85.73	0.00	0.000
26-Mar-00	0.08	85.73	0.00	0.000
27-Mar-00	0.10	117.60	117.60	0.003
28-Mar-00	0.10	117.60	117.60	0.003
29-Mar-00	0.10	117.60	117.60	0.003
30-Mar-00	0.01	14.85	0.00	0.000
31-Mar-00	0.62	705.48	550.00	0.013
1-Apr-00	0.60	675.73	550.00	0.013
2-Apr-00	0.60	675.73	550.00	0.013
3-Apr-00	0.43	486.63	486.63	0.012
4-Apr-00	0.49	550.37	550.00	0.013

Catchment Area = 7.25km²
Head = 377 m

Date	Computed Discharge at Edathanalkuthu (m ³ /s)	Maximum Generatable Power (kW)	Power (kW) with 2x125	Mu/day
5-Apr-00	0.57	643.86	550.00	0.013
6-Apr-00	0.57	643.86	550.00	0.013
7-Apr-00	0.43	486.63	486.63	0.012
8-Apr-00	0.46	518.50	518.50	0.012
9-Apr-00	0.51	580.12	550.00	0.013
10-Apr-00	0.46	518.50	518.50	0.012
11-Apr-00	0.51	580.12	550.00	0.013
12-Apr-00	0.54	611.99	550.00	0.013
13-Apr-00	0.57	643.86	550.00	0.013
14-Apr-00	0.57	643.86	550.00	0.013
15-Apr-00	0.51	580.12	550.00	0.013
16-Apr-00	0.49	550.37	550.00	0.013
17-Apr-00	0.51	580.12	550.00	0.013
18-Apr-00	0.54	611.99	550.00	0.013
19-Apr-00	0.54	611.99	550.00	0.013
20-Apr-00	0.54	611.99	550.00	0.013
21-Apr-00	0.35	391.01	391.01	0.009
22-Apr-00	0.46	518.50	518.50	0.012
23-Apr-00	0.51	580.12	550.00	0.013
24-Apr-00	0.57	643.86	550.00	0.013
25-Apr-00	0.57	643.86	550.00	0.013
26-Apr-00	0.37	422.89	422.89	0.010
27-Apr-00	0.16	176.97	176.97	0.004
28-Apr-00	0.07	76.55	0.00	0.000
29-Apr-00	0.33	371.89	371.89	0.009
30-Apr-00	0.15	172.86	172.86	0.004
1-May-00	0.32	357.95	357.95	0.009
2-May-00	0.05	53.69	0.00	0.000
3-May-00	0.05	53.69	0.00	0.000
4-May-00	0.08	88.82	0.00	0.000
5-May-00	0.17	191.70	191.70	0.005
6-May-00	0.07	76.75	0.00	0.000
7-May-00	0.11	127.96	127.96	0.003
8-May-00	0.18	207.65	207.65	0.005
9-May-00	0.20	223.57	223.57	0.005
10-May-00	0.25	285.19	285.19	0.007
11-May-00	0.28	317.06	317.06	0.008
12-May-00	0.28	317.06	317.06	0.008
13-May-00	0.28	317.06	317.06	0.008
14-May-00	0.28	317.06	317.06	0.008
15-May-00	0.31	348.93	348.93	0.008
16-May-00	0.34	380.80	380.80	0.009
17-May-00	0.36	410.55	410.55	0.010
18-May-00	0.36	410.55	410.55	0.010
19-May-00	0.39	444.55	444.55	0.011
20-May-00	0.25	285.19	285.19	0.007
21-May-00	0.31	348.93	348.93	0.008
22-May-00	0.36	410.55	410.55	0.010
23-May-00	0.34	380.80	380.80	0.009

Catchment Area = 7.25km²
Head = 377 m

Date	Computed Discharge at Edathanalkuthu (m ³ /s)	Maximum Generatable Power (kW)	Power (kW) with 2x125	Mu/day
24-May-00	0.36	410.55	410.55	0.010
25-May-00	0.39	444.55	444.55	0.011
26-May-00	0.42	474.29	474.29	0.011
27-May-00	0.42	474.29	474.29	0.011
28-May-00	0.42	474.29	474.29	0.011
29-May-00	0.45	506.16	506.16	0.012
30-May-00	0.45	506.16	506.16	0.012
31-May-00	2.24	2531.04	550.00	0.013
1-Jun-00	2.52	2845.51	550.00	0.013
2-Jun-00	2.71	3066.48	550.00	0.013
3-Jun-00	2.77	3130.22	550.00	0.013
4-Jun-00	1.77	2005.79	550.00	0.013
5-Jun-00	0.40	452.46	452.46	0.011
6-Jun-00	5.29	5983.94	550.00	0.013
7-Jun-00	3.20	3614.92	550.00	0.013
8-Jun-00	5.62	6357.62	550.00	0.013
9-Jun-00	6.05	6845.62	550.00	0.013
10-Jun-00	1.43	1618.31	550.00	0.013
11-Jun-00	3.29	3715.62	550.00	0.013
12-Jun-00	3.46	3916.39	550.00	0.013
13-Jun-00	3.46	3916.39	550.00	0.013
14-Jun-00	3.46	3916.39	550.00	0.013
15-Jun-00	3.46	3916.39	550.00	0.013
16-Jun-00	3.46	3916.39	550.00	0.013
17-Jun-00	2.21	2502.98	550.00	0.013
18-Jun-00	1.22	1375.76	550.00	0.013
19-Jun-00	1.17	1319.36	550.00	0.013
20-Jun-00	2.00	2259.31	550.00	0.013
21-Jun-00	1.67	1886.36	550.00	0.013
22-Jun-00	1.56	1767.23	550.00	0.013
23-Jun-00	0.92	1040.55	550.00	0.013
24-Jun-00	3.46	3916.39	550.00	0.013
25-Jun-00	2.32	2619.16	550.00	0.013
26-Jun-00	3.46	3916.39	550.00	0.013
27-Jun-00	3.46	3916.39	550.00	0.013
28-Jun-00	3.46	3916.39	550.00	0.013
29-Jun-00	3.46	3916.39	550.00	0.013
30-Jun-00	2.77	3127.66	550.00	0.013
1-Jul-00	2.77	3127.66	550.00	0.013
2-Jul-00	2.77	3127.66	550.00	0.013
3-Jul-00	2.77	3127.66	550.00	0.013
4-Jul-00	2.77	3127.66	550.00	0.013
5-Jul-00	0.46	515.18	515.18	0.012
6-Jul-00	0.78	877.02	550.00	0.013
7-Jul-00	0.72	813.83	550.00	0.013
8-Jul-00	0.76	859.64	550.00	0.013
9-Jul-00	0.92	1036.52	550.00	0.013
10-Jul-00	0.55	621.92	550.00	0.013
11-Jul-00	0.45	506.04	506.04	0.012

Catchment Area = 7.25km²
Head = 377 m

Date	Computed Discharge at Edathanalkuthu (m ³ /s)	Maximum Generatable Power (kW)	Power (kW) with 2x125	Mu/day
12-Jul-00	1.19	1341.76	550.00	0.013
13-Jul-00	0.97	1094.77	550.00	0.013
14-Jul-00	1.44	1634.15	550.00	0.013
15-Jul-00	1.82	2057.43	550.00	0.013
16-Jul-00	2.48	2807.78	550.00	0.013
17-Jul-00	2.77	3127.66	550.00	0.013
18-Jul-00	2.77	3127.66	550.00	0.013
19-Jul-00	2.77	3127.66	550.00	0.013
20-Jul-00	2.01	2275.59	550.00	0.013
21-Jul-00	1.67	1884.82	550.00	0.013
22-Jul-00	1.26	1424.82	550.00	0.013
23-Jul-00	1.14	1284.83	550.00	0.013
24-Jul-00	0.50	565.37	550.00	0.013
25-Jul-00	0.55	617.68	550.00	0.013
26-Jul-00	0.36	409.28	409.28	0.010
27-Jul-00	0.75	843.31	550.00	0.013
28-Jul-00	1.09	1230.98	550.00	0.013
29-Jul-00	1.44	1624.95	550.00	0.013
30-Jul-00	1.20	1360.86	550.00	0.013
31-Jul-00	0.04	48.36	0.00	0.000
1-Aug-00	0.07	78.87	0.00	0.000
2-Aug-00	0.11	124.79	124.79	0.003
3-Aug-00	0.12	131.62	131.62	0.003
4-Aug-00	0.09	102.18	102.18	0.002
5-Aug-00	0.11	122.32	122.32	0.003
6-Aug-00	0.08	95.76	0.00	0.000
7-Aug-00	0.11	119.49	119.49	0.003
8-Aug-00	0.12	138.98	138.98	0.003
9-Aug-00	0.13	152.28	152.28	0.004
10-Aug-00	0.14	159.31	159.31	0.004
11-Aug-00	0.14	159.31	159.31	0.004
12-Aug-00	0.14	159.31	159.31	0.004
13-Aug-00	0.14	153.42	153.42	0.004
14-Aug-00	0.09	99.91	0.00	0.000
15-Aug-00	0.06	70.41	0.00	0.000
16-Aug-00	0.05	54.41	0.00	0.000
17-Aug-00	0.06	64.94	0.00	0.000
18-Aug-00	0.05	60.36	0.00	0.000
19-Aug-00	0.09	103.79	103.79	0.002
20-Aug-00	0.10	111.43	111.43	0.003
21-Aug-00	0.11	122.95	122.95	0.003
22-Aug-00	0.11	121.30	121.30	0.003
23-Aug-00	0.15	172.93	172.93	0.004
24-Aug-00	0.19	218.47	218.47	0.005
25-Aug-00	0.26	295.38	295.38	0.007
26-Aug-00	0.19	216.29	216.29	0.005
27-Aug-00	0.20	224.13	224.13	0.005
28-Aug-00	0.34	380.50	380.50	0.009
29-Aug-00	0.63	707.61	550.00	0.013

Catchment Area = 7.25km²
Head = 377 m

Date	Computed Discharge at Edathanalkuthu (m ³ /s)	Maximum Generatable Power (kW)	Power (kW) with 2x125	Mu/day
30-Aug-00	0.30	335.35	335.35	0.008
31-Aug-00	0.40	453.45	453.45	0.011
1-Sep-00	0.37	419.47	419.47	0.010
2-Sep-00	0.44	497.14	497.14	0.012
3-Sep-00	0.47	531.22	531.22	0.013
4-Sep-00	0.46	518.93	518.93	0.012
5-Sep-00	0.45	508.41	508.41	0.012
6-Sep-00	0.46	514.90	514.90	0.012
7-Sep-00	0.54	615.27	550.00	0.013
8-Sep-00	0.50	570.33	550.00	0.013
9-Sep-00	0.50	567.18	550.00	0.013
10-Sep-00	0.43	488.75	488.75	0.012
11-Sep-00	0.36	411.76	411.76	0.010
12-Sep-00	0.22	253.90	253.90	0.006
13-Sep-00	0.31	355.10	355.10	0.009
14-Sep-00	0.41	467.16	467.16	0.011
15-Sep-00	0.39	439.62	439.62	0.011
16-Sep-00	0.36	411.76	411.76	0.010
17-Sep-00	0.32	361.47	361.47	0.009
18-Sep-00	0.90	1015.67	550.00	0.013
19-Sep-00	0.13	148.81	148.81	0.004
20-Sep-00	0.14	158.84	158.84	0.004
21-Sep-00	0.05	60.26	0.00	0.000
22-Sep-00	0.09	106.75	106.75	0.003
23-Sep-00	0.15	167.98	167.98	0.004
24-Sep-00	0.16	185.22	185.22	0.004
25-Sep-00	0.18	208.43	208.43	0.005
26-Sep-00	0.24	273.93	273.93	0.007
27-Sep-00	0.35	395.55	395.55	0.009
28-Sep-00	0.36	402.70	402.70	0.010
29-Sep-00	0.42	475.96	475.96	0.011
30-Sep-00	1.10	1238.96	550.00	0.013
1-Oct-00	1.22	1378.26	550.00	0.013
2-Oct-00	1.35	1521.55	550.00	0.013
3-Oct-00	1.35	1524.21	550.00	0.013
4-Oct-00	1.35	1524.21	550.00	0.013
5-Oct-00	1.35	1524.21	550.00	0.013
6-Oct-00	1.35	1524.21	550.00	0.013
7-Oct-00	1.35	1524.21	550.00	0.013
8-Oct-00	1.35	1524.21	550.00	0.013
9-Oct-00	1.35	1524.21	550.00	0.013
10-Oct-00	0.42	474.81	474.81	0.011
11-Oct-00	1.35	1524.21	550.00	0.013
12-Oct-00	1.31	1481.94	550.00	0.013
13-Oct-00	1.35	1524.21	550.00	0.013
14-Oct-00	1.35	1524.21	550.00	0.013
15-Oct-00	1.35	1524.21	550.00	0.013
16-Oct-00	1.35	1524.21	550.00	0.013
17-Oct-00	0.58	655.25	550.00	0.013

Catchment Area = 7.25km²
Head = 377 m


Date	Computed Discharge at Edathanaikuthu (m ³ /s)	Maximum Generatable Power (kW)	Power (kW) with 2x125	Mu/day
18-Oct-00	1.28	1444.03	550.00	0.013
19-Oct-00	1.35	1524.21	550.00	0.013
20-Oct-00	1.35	1524.21	550.00	0.013
21-Oct-00	1.35	1524.21	550.00	0.013
22-Oct-00	1.35	1524.21	550.00	0.013
23-Oct-00	0.94	1066.97	550.00	0.013
24-Oct-00	1.35	1524.21	550.00	0.013
25-Oct-00	1.35	1524.21	550.00	0.013
26-Oct-00	1.35	1524.21	550.00	0.013
27-Oct-00	1.35	1524.21	550.00	0.013
28-Oct-00	1.35	1524.21	550.00	0.013
29-Oct-00	1.35	1524.21	550.00	0.013
30-Oct-00	1.35	1524.21	550.00	0.013
31-Oct-00	0.78	886.02	550.00	0.013
1-Nov-00	0.84	945.75	550.00	0.013
2-Nov-00	0.84	945.75	550.00	0.013
3-Nov-00	0.83	943.55	550.00	0.013
4-Nov-00	0.84	945.75	550.00	0.013
5-Nov-00	0.68	772.48	550.00	0.013
6-Nov-00	0.76	855.82	550.00	0.013
7-Nov-00	0.82	923.67	550.00	0.013
8-Nov-00	0.82	923.67	550.00	0.013
9-Nov-00	0.84	945.75	550.00	0.013
10-Nov-00	0.84	945.75	550.00	0.013
11-Nov-00	0.84	945.75	550.00	0.013
12-Nov-00	0.84	945.75	550.00	0.013
13-Nov-00	0.84	945.75	550.00	0.013
14-Nov-00	0.84	945.75	550.00	0.013
15-Nov-00	0.84	945.75	550.00	0.013
16-Nov-00	0.84	945.75	550.00	0.013
17-Nov-00	0.84	945.75	550.00	0.013
18-Nov-00	0.84	945.75	550.00	0.013
19-Nov-00	0.84	945.75	550.00	0.013
20-Nov-00	0.84	945.75	550.00	0.013
21-Nov-00	0.84	945.75	550.00	0.013
22-Nov-00	0.84	945.75	550.00	0.013
23-Nov-00	0.84	945.75	550.00	0.013
24-Nov-00	0.84	945.75	550.00	0.013
25-Nov-00	0.84	945.75	550.00	0.013
26-Nov-00	0.84	945.75	550.00	0.013
27-Nov-00	0.84	945.75	550.00	0.013
28-Nov-00	0.84	945.75	550.00	0.013
29-Nov-00	0.84	945.75	550.00	0.013
30-Nov-00	0.01	8.72	0.00	0.000
1-Dec-00	0.01	8.84	0.00	0.000
2-Dec-00	0.01	8.95	0.00	0.000
3-Dec-00	0.01	9.20	0.00	0.000
4-Dec-00	0.01	9.45	0.00	0.000
5-Dec-00	0.01	10.01	0.00	0.000

Catchment Area = 7.25km²
Head = 377 m

Date	Computed Discharge at Edathanalkuthu (m ³ /s)	Maximum Generatable Power (kW)	Power (kW) with 2x125	Mu/day
6-Dec-00	0.01	10.81	0.00	0.000
7-Dec-00	0.01	10.81	0.00	0.000
8-Dec-00	0.01	11.15	0.00	0.000
9-Dec-00	0.01	11.99	0.00	0.000
10-Dec-00	0.03	32.53	0.00	0.000
11-Dec-00	0.01	12.60	0.00	0.000
12-Dec-00	0.01	12.84	0.00	0.000
13-Dec-00	0.01	13.44	0.00	0.000
14-Dec-00	0.01	13.89	0.00	0.000
15-Dec-00	0.01	13.89	0.00	0.000
16-Dec-00	0.01	15.12	0.00	0.000
17-Dec-00	0.01	13.89	0.00	0.000
18-Dec-00	0.01	13.98	0.00	0.000
19-Dec-00	0.01	13.89	0.00	0.000
20-Dec-00	0.01	14.18	0.00	0.000
21-Dec-00	0.01	14.18	0.00	0.000
22-Dec-00	0.01	14.49	0.00	0.000
23-Dec-00	0.01	14.81	0.00	0.000
24-Dec-00	0.01	14.81	0.00	0.000
25-Dec-00	0.01	15.46	0.00	0.000
26-Dec-00	0.01	15.83	0.00	0.000
27-Dec-00	0.01	15.83	0.00	0.000
28-Dec-00	0.01	16.21	0.00	0.000
29-Dec-00	0.01	16.61	0.00	0.000
30-Dec-00	0.01	16.61	0.00	0.000
31-Dec-00	0.11	128.01	128.01	0.003
Yearly power generation Mu				2.733

Catchment Area = 7.25km²
Head = 377 m

Edathanaikuthu MHP - Power Duration Curve

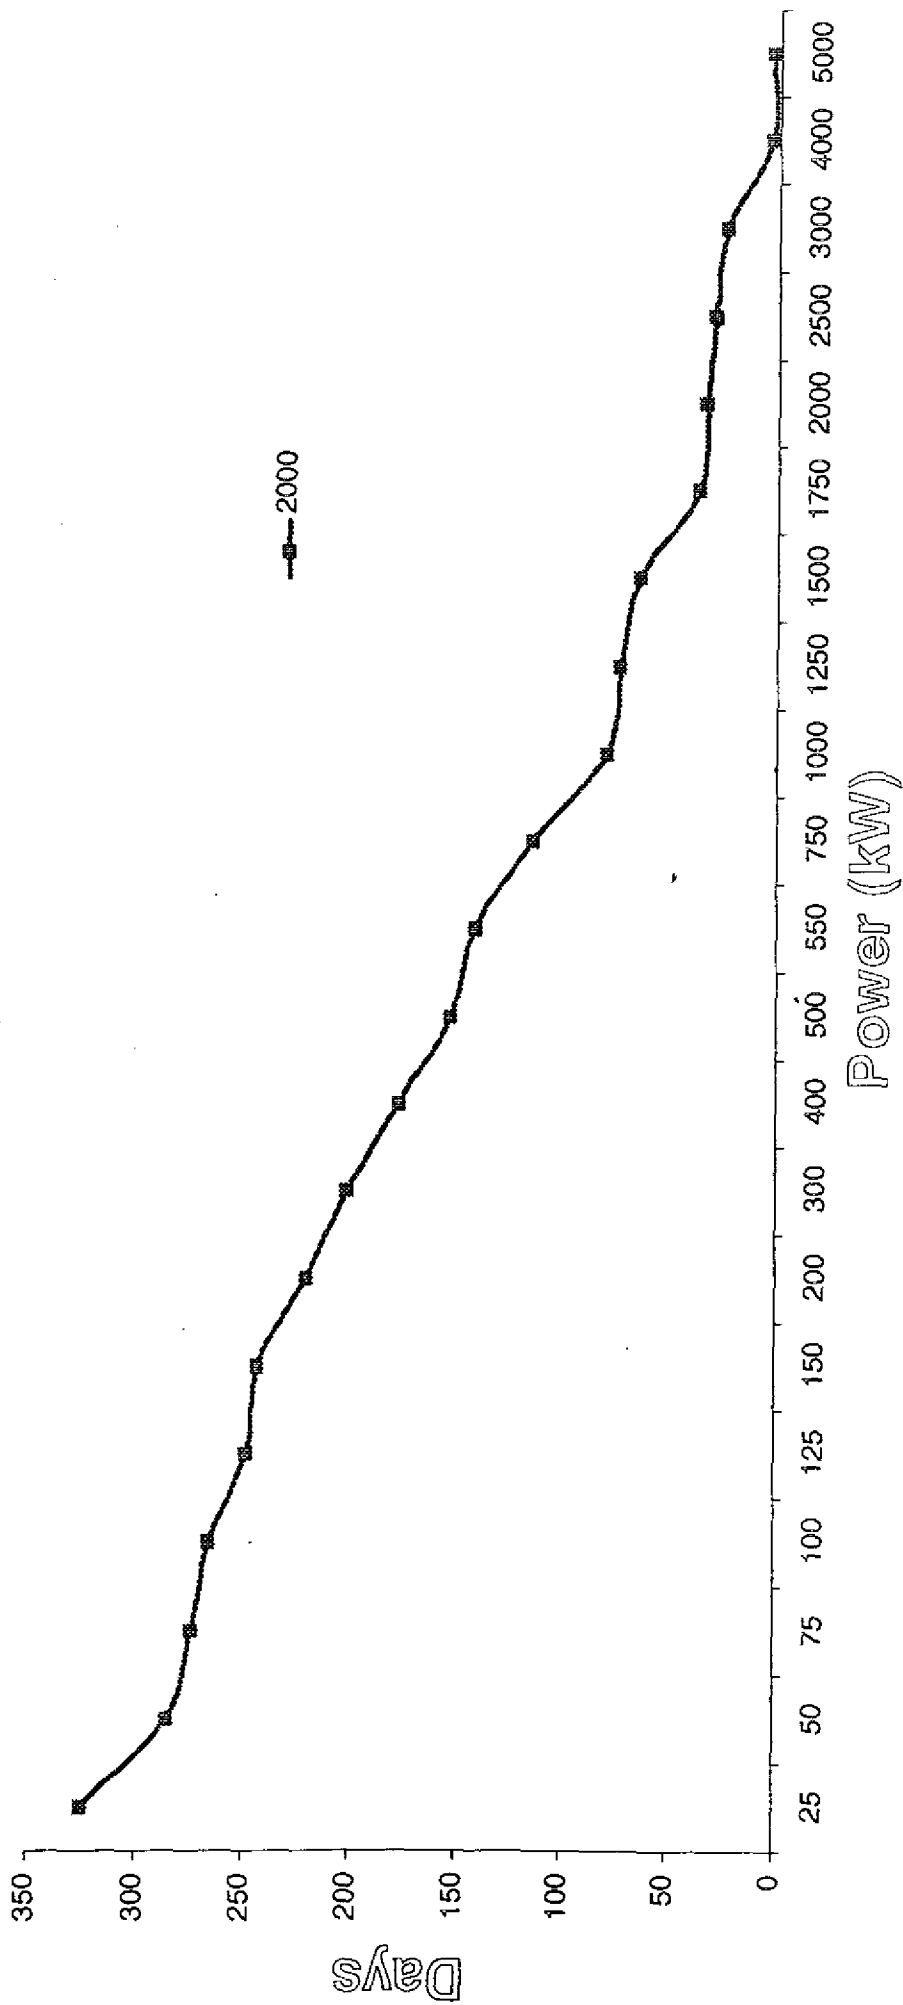

CHAPTER - XII

DESIGN CRITERIA OF MAJOR COMPONENTS OF SCHEME

General

The river-bed is at primary stage. The flow in the river is very heavy during rainy seasons and as per hydrologic details available, there have been flash floods. During the monsoon seasons, heavy flow is available for about 5 months. In monsoon seasons in order to cater the flood with high velocities an overflow type diversion weir is adopted. The height of the weir is minimised in order to cater the intake provision to avoid cavitations, and to keep the maximum water level below the maximum flood level of the stream. The height of the weir at the overflow portion is thus kept as 3.0 m

The diversion weir of Ogee type is proposed with overflow portion having a length of 15m. The maximum flood discharge is 31.65 m³/s. The lowest bed level of the stream at weir site is 193.

The Edathanalkuthu mini hydel scheme is designed as a run of the river scheme with the following main project components.

1. Gravity weir

The weir is constructed across the stream Kotamangalam thodu, at about 4km from Mullaringkadu. Total length of the concrete weir is 30m and u/s side protected on either banks with DR masonry. This concrete weir will be having an ungated overflow section for a length of 15m and non-overflow sections of length 10m on left bank and 5m on right bank.

2. Water conductor system

- a) A Trash rack structure will be constructed on the left bank of weir at the intake
- b) A gated river sluice of dia 0.50 m to flush out the silt, settling down near the intake end.
- c) An intake bell mouth located with center line elevation +480.76 m in the right bank non-overflow portion of the weir.
- d) 1 No. Penstock pipes of diameter 0.40 m and length 850m.

3. Power House

A surface powerhouse of size 7 m x 6 m to house two units of generating equipment of 250 kW capacity

4. Tailrace

A tailrace channel of length 15 m to discharge water back into stream (size 1 m x 1 m).

GRAVITY WEIR

The maximum height of weir at the overflow portion is 3.0 m.

According to Ryve's formula, Maximum flood discharge, $Q_{\max} = C.A^{(2/3)}$

Catchment Area, $A = 7.25$ sq.km.

In Ghat region for area between 24 km to 161km from coast, $C = 8.45$

$Q_{\max} = 8.45 \times (7.25)^{2/3} = 31.65$ m³/s, is adopted as the design flood discharge, Q .

Provide a of overflow section 15m length.

Taking C_d as 2.2, $k_a = 0.1$, $L = 15$ m and

$$Q = C_d \times L \times (H_d)^{3/2}$$

$$H_d = 0.973 \text{ m.}$$

A design head of 0.9 m is adopted with level of non-overflow portion 1.5m above the overflow portion with free board of 0.6m. Top of Non over flow level 484.00

Effective length of spill way, $L_c = L - 2(k_a \times H_d)$

$$L_c = 14.82\text{m, with } H_d = 0.9\text{m}$$

$$Q = C_d \times L_c \times (H_d)^{3/2}$$

$$Q = 59.90 \text{ m}^3/\text{sec} > 31.65 \text{ m}^3/\text{sec, Hence okay.}$$

Therefore $H_d = 0.90$ m,


Hence a spillway length of 15 m and height of non-overflow portion above spillway crest of 1.5 m is adopted. The excavated bed level is taken as +479.00

Weir Profile

The upstream face of the weir is kept vertical.

Downstream Profile

$$X_n = K H_d^{n-1} Y$$

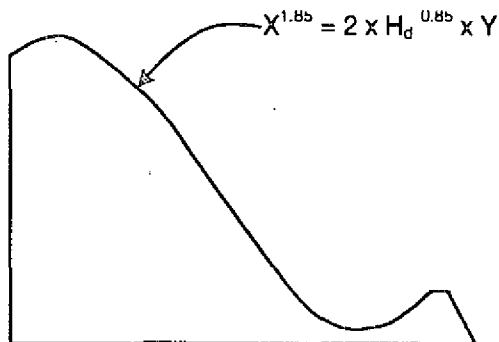

Equation for the Ogee profile for upstream face vertical $\rightarrow X^{1.85} = 2 \times H_d^{0.85} \times Y$

$\frac{H_o}{H_d}$ is taken as 1

D/s slope of the weir below the point of tangency is given a slope of 0.75 H to 1 V.

Equating $\frac{dy}{dx} = \frac{1}{0.75}$ we get Co-ordinates of point of tangency $\rightarrow \underline{X = 1.362}$ and $\underline{Y = 0.969}$

Co-ordinates of Ogee Profile:

X	0.136	0.545	0.817	1.090	1.226	1.362
Y	0.014	0.178	0.377	0.641	0.797	0.969

Upstream Profile

Equation for upstream profile

$$Y = \frac{0.724 (X + 0.27H_d)^{1.85}}{H_d^{0.85}} + 0.126 H_d - 0.4315 H_d^{0.375} (X + 0.27H_d)^{0.625}$$

$X_{\max} = -0.27 H_d = -0.243$ and corresponding $Y_{\max} = 0.113$

$q = \text{discharge/unit width} = C_d \times 1 \times H_d^{1.5}$ taking C_d as 2.2,

Discharge intensity, $q = 2.11 \text{ m}^3/\text{s/m}$

$$q = v \times d_1$$

Velocity over weir, $v = \sqrt{2 \times 9.81 (H - 0.5 \times H_d)} = 8.23 \text{ m/s}$

$y_1 = 0.256 \text{ m}$, $y_2 = 1.75 \text{ m}$

Froude No = 5.19 > 4.5 Hence the flow is super critical Type -II stilling basin as per Indian Standards is selected as the energy dissipater.

Length of stilling basin = 5.18 m

Maximum downstream water level = 479.50 + 1.75m = + 481.25

River Sluice

A 0.50 m dia river sluice is provided at the right non-overflow portion of the diversion weir to pass through the silt, settling down near the intake end. The sluice is controlled by a manually operated gate arrangement of size 1m x 1m.

Stability Analysis for Overflow Section

Height of dam, $H = 3.00 \text{ m}$

Uplift pressure factor, $c = 0.30$

Average shear strength of concrete, $q = 70.00 \text{ t/m}^2$

Specific weight of water, $w = 1.0 \text{ t/m}^3$

Specific weight of weir material, $s = 2.400 \text{ t/m}^3$

Specific weight of silt submerged, $\gamma_{\text{sub}} = 0.480 \text{ t/m}^3$

Specific weight of silt saturated, $\gamma_{\text{sat}} = 1.480 \text{ t/m}^3$

Coefficient of friction between base and soil/rock,

Trashrack coefficient = 0.25, (Coeff related to the partial clogging of the trashrack screen: no automatic raker i.e. 75% clogged)

Assumed velocity of flow through the trash rack, $v_0 = 0.75$ m/s

$$\text{Required area of trash rack} = \frac{1}{K_1} \left(\frac{t+b}{b} \right) \frac{Q}{v_0} \cdot \frac{1}{\sin \alpha} = 1.14 \text{ m}^2$$

Assumed width of trash rack = 1.8 m

Required height of trash rack = 0.63m, provide a height of 1.80 m.

Therefore provided area of trash rack = $1.80 \text{ m}^2 > 1.14$, hence safe.

Actual velocity with provided area = $0.475 \text{ m/s} < 1.5 \text{ m/s}$, hence safe against vorticity.

Box type trash rack arrangement with three panels of 0.6m length and 1 m depth are provided with a frame made up of 50 mm angle iron, having vertical flat plate bars of 10 mm thickness. The bars are welded to the outer frame made up of angle irons. The trash rack chamber is open at the top except for the R.C.C slab connecting the supporting columns of the panels. The supporting columns will have a cross section of 0.5m x 0.5m. The panels will be inserted into the slot provided in the concrete columns. The semicircular arrangement will have a radius of 1m. The flow through velocity in the trash rack will be 0.475m/s. The floor level of the trash rack cabin is at +480.00

The intake sill level of the penstock bell mouth is fixed at +480.25

Reservoir capacity and Penstock Bell mouth.

To provide sufficient water cover above the penstock bell mouth and to provide sufficient capacity of water to sustain in situations of sudden closures/ stoppages of the turbines a suitable reservoir should be maintained.

Discharge required for an installed capacity of 500 kW with 10 % overload = $0.178 \text{ m}^3/\text{s}$

A minimum of for statutory 3 minutes storage, i.e., $3 \times 60 \times 0.178 = 32.06 \text{ m}^3$ is to be above the MDDL. The reservoir formed due to construction of weir provides storage of approximately 125 m^3 , which is more than sufficient for the minimum storage requirements.

The top of the bell mouth transition is to be at least $0.6H_0$ below MDDL.

Bell mouth design details

The penstock intake will have a transition from rectangular to circular using a bell mouth transition. The bell mouth is designed in such a way that the penstock takes off from the forebay horizontally. A penstock of 0.5m dia is adopted.

$\theta = 0$ - axis horizontal

As the axis is horizontal, height of opening, $H_0 = h_1 + h_2 = a + 2b$, and $D = 0.40 \text{ m}$

Profile of ellipse (top & bottom), in case of transition from rectangular to circular section

$$\text{is } \frac{X^2}{a^2} + \frac{Y^2}{b^2} = 1 \text{ where } a = 1.1 D \text{ \& } b = 0.29 D$$

$$\text{Length of transition } a = 1.1 \times 0.4 = 0.44 \text{ m}$$

$$'b' = 0.29 \times 0.4 = 0.12 \text{ m.}$$

$$H_o = 0.67 + 2 \times 0.12 = 0.67 \text{ m}$$

Provide height of bell mouth opening as = 0.70m

$$\text{Minimum water cover above bell mouth} = 0.60H_o = 0.60 \times 0.70 = 0.42\text{m}$$

$$\text{Width of transition} = 1.43D = 0.57 \text{ m say } 0.60\text{m}$$

$$\text{Size of intake opening – bell mouth} = 0.70 \text{ m} \times 0.60 \text{ m}$$

The crest of bell mouth opening will be kept at 0.75m above the lowest bed level.

Therefore depth of water below the MDDL up to bed level of the stream at the weir site is $0.42+0.70+0.75 = 1.87\text{m}$. The centreline of bell mouth is at level +480.64 and MDDL is fixed as +481.37. Full supply level is fixed as +482.50. The depth of water above the MDDL at full reservoir condition will therefore be 1.13m.

The provided weir height effectively creates a reservoir capacity of 125 m^3 above the minimum draw down level, which is more than the required minimum storage capacity.

PENSTOCK PIPES

From the forebay the water is conveyed through penstock to the turbines. The length of penstock is 850m. It will be bifurcated near the Powerhouse to supply for two turbines of 250 kW capacity each.

The penstock diameter from the forebay to the bifurcation points for feeder pipes is 0.40 m with a velocity of 1.42m/s for the 110% load at the rated design head of 377m for a maximum output of 550 kW.

The maximum drop from the centre line of the intake bell mouth at the forebay to the machine centreline is 386 m. The penstock wall thickness arrived is 8mm after allowing for corrosion and handling allowances. There will be ten bends in total for the penstock line inclusive of compound bends. A Stop log with electrically operated hoist is provided at the entry of the penstock for the maintenance of the penstock and valves.

Standard expansion joints will be provided for the penstock line at suitable intervals. Necessary anchor blocks are provided where there is a change in the direction of the pipelines along its alignment with suitable saddle supports in between.

Design of penstock pipe.

The rating of each of the two turbine generator set selected is 250 kW at the generator terminals with a provision for 10% continuous overload.

Maximum design discharge per turbine for 100% load at a rated design head of 107 m, for obtaining a generator terminal output of 125kW, that is for a turbine output of 131.25 kW = $0.136 \text{ m}^3/\text{s}$. The maximum discharge for each turbine for obtaining 10% over load is $0.15 \text{ m}^3/\text{s}$.

Diameter of penstock:

A penstock dia of 0.40m is taken as design diameter.

Length of the penstock = 850 m

Velocity of flow through the penstock, $v = Q/A$

Where, Q = design draft of the penstock = $0.178 \text{ m}^3/\text{s}$.

A = area of the penstock = $(\pi/4)d^2 = 0.126\text{m}^2$

The corresponding flow velocity is 1.42 m/s at maximum power draft, which is within acceptable limits as far as the losses are concerned.

The wall thickness is selected as 8mm.

Feeder Pipes

The main penstock will be bifurcated longitudinally to feed the two turbines. The diameter of the two feeder pipes supplying to the 125kW machines is fixed as 0.30m to with velocity of flow as 1.26 m/s.

Head loss in penstock

Dia of the penstock = 0.4 m, Length of the penstock = 850 m

Velocity of flow through the penstock, $v = 1.42 \text{ m/s}$

$$\text{Velocity head} = \frac{v^2}{2g} = 0.102$$

$$(a) \text{ Loss of head at bell mouth entry in forebay } h_e = k_e \frac{v^2}{2g}$$

$$k_e = 0.16$$

$$\therefore h_e = 0.16 \times 0.102 = 0.02 \text{ m}$$

$$(b) \text{ Loss of head due to friction, } h_f = \frac{f \cdot l \cdot v^2}{2gd}$$

$f = 0.0125$ (for steel pipe with smooth surface)

$$h_f = \frac{0.0125 \times 386 \times 1.42^2}{2 \times 9.81 \times 0.4} = 2.72 \text{ m}$$

(c) Loss of head due to bends (10nos in total)

$$\text{Head loss due to, bends } h_b = \frac{v^2}{2g} \sum k_b = 0.102 \times 0.958 = 0.10 \text{ m}$$

(d) Loss of head due to gradual contraction at PH end.

$$h_{gc} = 0.18 \frac{v^2}{2g} = 0.18 \times 0.102 = 0.02 \text{ m}$$

(e) Loss of head due to butterfly valve.

$$h_{gc} = 0.2 \frac{v^2}{2g} = 0.2 \times 0.102 = 0.02 \text{ m}$$

$$\text{Total head loss in penstock} = 0.02 + 2.72 + 0.10 + 0.02 + 0.02 = 2.88 \text{ m}$$

Adding bifurcation losses and other losses in bifurcated pipe and valves, the total head loss is taken as 9 m for design purpose.

Full supply level of forebay tank = +482.50

Centre line level of turbine = +480.64

Normal tail water level = +96.50

Gross Head = 482.50 - 96.50 = 386.00

Net Head = 386 - 9 = 377.00 A design head of 377 m is adopted.

POWERHOUSE

For making the final design of Powerhouse, details from the manufacturer / supplier is necessary. In the absence of foundation details etc., a tentative design is made which will be modified on getting details from the supplier. Powerhouse will be located on the Left bank of the river.

Gross head in meters = 386.00

Conduit head loss at rated flow meters = 9.00

Rated net head in meters = 377.00

Rated discharge = 0.178 m³/s

Total power plant capacity (Including 10% overload) = 550 kW

Plant capacity factor = 0.624

Total Generator unit output = 500 kW

Required turbine out put = 525 kW

Number of turbines = 2

Design Discharge, Q per turbine, with 10% overload capacity = 0.09 m³/s

Sizing of Generator

No of poles provided = 4 poles or, 2 pairs of poles

Frequency = 50 Hz

Generator speed = 1500 rpm

Sizing & Design of Turbine

A Pelton turbine arrangement is selected for the project. At 1500 rpm the rotational speed of generator the specific speed of turbine will be close to 15 rpm, for single jet Pelton, which is in allowable range.

Hence, No of jet proposed = 1

Assumed Sp. Speed = 15.00, so as to get a rotational speed of approximately 1500 rpm with one jet. Adopt rotational speed of turbine as 1500 rpm for synchronized operation with generator. Then Gear ratio of speed increaser = 1.00, i.e the turbine will be directly coupled to the generator.

Actual specific speed/ jet = 14.97, > 12 & < 26 hence okay

As per IS for selection of turbine and dimensioning of Power house

Dia of circumference tangent ,PCD

Assume, d/D ratio = 0.0555

$q_3 = 0.342$

As per IS, Pitch Circle Dia, PCD = 0.56m

Distance between C/L of Penstock and C/L of Turbine = $2D = 1.12$ m

Distance between. C/L of Turbine & top of servomotor = $3.7D = 2.08$ m

Width of Turbine Chamber = $2.5D = 1.40$ m

Distance between C/L of M/c to TWL = $2D = 1.12$ m

Tail water pool Depth = $2D = 1.12$ m

Jet Dimensions

Velocity of Jet at nozzle, $v_{ch} = 83.42$ m/s

Diameter of each jet = 0.037 m

Nozzle Diameter = 0.041 m

Bucket size in radial direction = 0.131 m

Therefore, runner inner circle Dia, $D = 0.43$

No of buckets = 20

Relevant elevations

C/L of Runner = +96.50

Tail water Level = +95.38

Tail water pool floor level = +94.25

Powerhouse dimensions.

Total length of powerhouse, excluding offices = 7.00 m.

Powerhouse width=6.00 m

The powerhouse building proper will be having a size of 7m x 6m x 8 m. The roof proposed is with aluminium or G.I. sheets supported on steel trusses. The size and spacing of the R C columns and machine foundation blocks of the powerhouse will be finalized based on turbine manufacturer's drawings.

The 440 kV generation is stepped up at the switchyard to 11kV and will be taken to the distribution centres at a distance of about 2 km from the powerhouse.

Drains will be provided inside the powerhouse and connected to tailrace channel. Dewatering pumps are provided for draining water from the tailrace channel for repairs after closing draft tube gates.

TAILRACE CHANNEL

The water coming out from the turbine after power generation will be let back in to the river through the tailrace. The channel will be with length of about 15 m with a size of 1m x 1m. Protection with rock riprap is provided between the powerhouse and the stream. The design takes care of the high flows during flood season so that it does not cause erosion downstream of the tail race portion.

EDATHANALKUTHU MIHP

PART - III
COST ESTIMATE

CHAPTER - XIII

COST ESTIMATE CRITERIA

The estimate cost of this project is prepared following the guide lines for the preparations of project estimates for hydro electric project" issued by the Central Electricity Authority. All the estimates under the detailed head "Civil works" are based on quantities worked out from detailed survey and preliminary design of component structure of the project. The project is to be executed either on "turnkey execution basis" or separate contract arrangements. As such the rates are worked out as detailed below

1. **Labour rates:** The current labour rates followed in the department is "Schedule of rates 2004.
2. **Rates for materials:** As stated in Chapter VI construction materials, such as rubble, coarse and fine aggregates are produced locally. Since sand mining in rivers is prohibited, crushed sand is proposed for the work and is being produced in the crushing plant. Non-levy cement only will be available for this work. Cost of cement at railhead at Kochi is taken and the cost at site is arrived by road transportation. Similarly, the tor steel structural steel, steel for Penstock pipes are to be procured from steel yard at Kochi and transported to site by rail and road.
3. **Rate for conveyance:** For manual head load conveyance the rates are taken from the present Schedule of rates. For lorry transport, the usual rate prevailing in this area is considered Special transportation charges are worked out and provided in the estimate for conveyance of Penstock pipes, trash-rack structures, vertical lift gates, hoists etc, as these items are very heavy and require extra care for transportation.
4. **Use rate for construction equipments:** Mechanised work is proposed for earthwork excavation, rock blasting, concreting etc. The use rate for various construction equipments are worked based on the present day value of machines and the output (capacity) of equipments as given by the manufactures of equipments.
5. **Electro-Mechanical part:** The estimate for electro-mechanical item, is worked out based on the budgetary offer received from reputed firms, manufacturing these item. For the transportation the rates are worked out separately taking into account the difficulty of the job.

6. **Estimate for transmission lines:** The estimate for the transmission lines is worked out based on the standard rate collected from the Chief Engineer, Transmission. K S E Board.

For all civil works the contractor's profit @ 10% and overhead charges @ 10 % are provided. Amenities to labour @ 30% is provided for labour part of the item, as stipulated in the guidelines.

CHAPTER - XIV
COST ESTIMATE – CIVIL WORKS

1	Weir & Intake			
1.1	Clearing the site	4000 m ²	170/100m ²	0.068
1.2	Temporary diversion arrangements	LS		0.122
1.3	Common excavation for foundation of weir, Energy dissipating arrangements etc.	54 m ³	150/m ³	0.081
1.4	Rock excavation for foundation of weir, Energy dissipating arrangements etc.	62 m ³	300/m ³	0.180
1.5	Foundation preparation	105 m ²	520/10m ²	0.055
1.6	Cement concrete C ₄₀ -M ₁₅₀ for the foundation of overflow, non overflow, intake, body of overflow portion etc.	70 m ³	3500/m ³	2.450
1.7	Cement concrete C ₂₀ -M ₂₀₀ for overflow, intake energy dissipating arrangements and training walls including piers & beams of intake	39 m ³	3600/m ³	1.404
1.8	Providing contraction joints with copper sealing strips	18 m	2650/m	0.477
1.9	Providing reinforcement rods for the foundation of weir, spill way training walls, ogee portion, etc.	2 Tons	46000/T	0.920
1.10	Fabricating and installing intake gates, and river sluices etc including erection.	2 Nos	LS	3.50
1.11	Contingencies			0.043
	Sub Total			9.300
2	Penstock			
2.1	Common excavation for track cutting, saddle supports, anchor blocks etc	2000	150/m ³	3.00
2.2	Rock excavation	250	300/m ³	0.75
2.3	Cement concrete C ₂₀ -M ₂₀₀ for saddle supports and anchor blocks	240 m ³	3600 / m ³	8.64

2.4	Providing reinforcements for the concrete works	8T	45000/T	3.60
2.5	Fabrication and transportation of Penstock pipes :			
	Straight pipes	73T	70000/T	51.10
	Expansion joint pipes	3.5 T	80000/T	2.80
	Bend pipe	4.5 T	80000/T	3.60
2.6	Erection of Penstock pipes including x-ray testing etc	78 Ton	6000 /T	4.68
2.7	Painting the pipes	750 m ²	600/10m ²	0.70
2.8	Contingencies			0.13
	Sub Total			79.00
3.	Power House			
3.1	Clearing of site & Site levelling	200 m ²	170/100m ²	0.003
3.2	Common excavation for P.H Building and machine foundation	95 m ³	210/m ³	0.200
3.3	Rock excavation for P.H. Building and machine foundation	30m ³	380/m ³	0.114
3.4	Cement concrete M ₂₀₀ C ₄₀ for the foundation of column	8.5 m ³	3300/m ³	0.281
3.5	Cement concrete M ₂₀₀ C ₂₀ for columns gantry beam, slabs etc in Power House building	22m ³	3300/m ³	0.726
3.5	Cement concrete M ₂₀₀ C ₄₀ for machine foundation	12 m ³	3300/m ³	0.396
3.6	R. R masonry in CM 1:5 for the foundation and basement of Power House building	38 m ³	1750/m ³ .	0.665
3.7	Brick masonry walls in CM 1:5 for the Power House building walls	26 m ³	2730/ m ³	0.709
3.8	Supplying and fixing steel doors, windows and ventilation with glazed shutters and other fittings		Ls	0.600
3.9	Flooring with cement concrete M ₁₅ C ₄₀ for	45 m ²	3900/10m ²	0.175

	15 cm thick including plastering with cement mortar two coats			
3.10	Steel structural for gantry girder, roof beam, etc. with fabrication, conveyance & erection	4.5 T	65000/T	2.925
3.11	Providing reinforcements to concrete bend tied and placed in position.	3.7	40000/T	1.480
3.12	Roofing the power house building with GI sheets over steel trusses	108 m ²	433/m ²	0.468
3.13	Finishing works like Plastering, Painting, etc including rolling shutters and doors		Ls	2.60
6.14	Providing water supply and sanitary facility in PH building		Ls	0.35
3.15	Providing Electrification inside, the power house and switch yard		Ls	0.35
3.16	Contingencies		Ls	0.148
	Sub Total			12.190
4.	Tailrace Channel			
4.1	Clearing site		Ls	0.01
4.2	Earthwork excavation in ordinary soil, mixed with boulders	45 m ³	210/m ³	0.095
4.3	Rock excavation	5 m ³	380/m ³	0.019
4.4	R.R Masonry in cement mortar	15m3	1750	0.263
4.5	Concreting the bottom and sides of tail race channel	15 m ³	3300/m ³	0.495
4.6	Contingencies			0.028
	Sub Total			0.910
Grand Total (Civil Works)				101.00

CHAPTER - XV
COST ESTIMATE - ELECTRICAL WORKS

Specifications

Turbine	Horizontal Pelton
Number of units and rating	2 Nos. 250kW
Rated turbine out put	526 kW
Continuous overload capacity	10 %
Rated speed	1500 rpm
Generator	Horizontal Synchronous
Rated output	250 kW x 2
Rated voltage	415 V
Governor	Electronic
Valve	Butterfly valve (400 mm)

	item	Amount (Rs Lakhs)
1.	E & M Equipments and auxiliaries	
1.	Cost of Design, manufacture, tests at manufacturers works, supply, delivery at site, erection and commissioning of hydro turbine generating sets and auxiliaries as per the above requirements and as per standard specification, including Civil and structural works of switchyard including Earthment, lighting arrester. Switchyard accessories, connection hardware, communication and fire fighting equipments. Emergency lighting, ventilation and air-conditioning of control room, cable ducts, power cable Termination kits and all other accessories as per specification etc. complete including taxes, duties, insurance and provision of escalation etc.	135.00
	Sub Total	145.00

2	Transmission works	
2.1	Constructing 11 kV line from the switchyard of power house to distribution locations = 2 km @ Rs. 2.5 lakhs/km	5.00
	Sub Total	5.00

CHAPTER - XVI
COST ESTIMATE -DEVELOPMENTAL WORKS

a . Preliminary

	Item	Amount (Rs Lakhs)
i	Construction of approach roads 2.5 km @ Rs 2.5 Lakhs/km	6.25
iii.	Establishment charges including Project Management, Audit and Accounts, Running cost of vehicles, Welfare to workers, Inspection of UNIDO and other Experts and Officials, Maintenance of roads during the construction period, Camp equipments, forest and other clearances etc.	7.00
iv.	Contingencies, consultancy, quality control, etc.	12.00
	Total	20.25

b. Cost of land

The forest land required for the project may be taken on long-term lease from Forest.

	Item	Amount (Rs Lakhs)
i	Private land required – 0.60 Ha	3.350
	Total	3.350

CHAPTER - XVII
ABSTRACT OF ESTIMATE

I. Civil Works – water diversion works, water conductor system, Power House and tailrace channel

i. Weir	⇒	Rs. 9,30000
ii. Penstock pipe	⇒	Rs. 79,00000
iii. Powerhouse civil works	⇒	Rs. 12,19000
iv. Tailrace channel	⇒	Rs. 91000
Total		Rs. 101,40,000

Total **Rs.101.40 Lakhs**

II Powerhouse T&G Equipments, Switchyard

i. Electromechanical Equipments = Rs. 75,00,000

Rs. 145.00 Lakhs

III Transmission of power

i. Transmission line works and LT distribution =

Rs. 5.00 Lakhs

IV Developmental Works

i. Prelim: expenses, cost of land, approach roads & buildings


= Rs. 28.60 Lakhs

GRAND TOTAL


Rs. 280.00 Lakhs

EDATHIANALKUTHU MIHIP


PART - IV
DRAWINGS

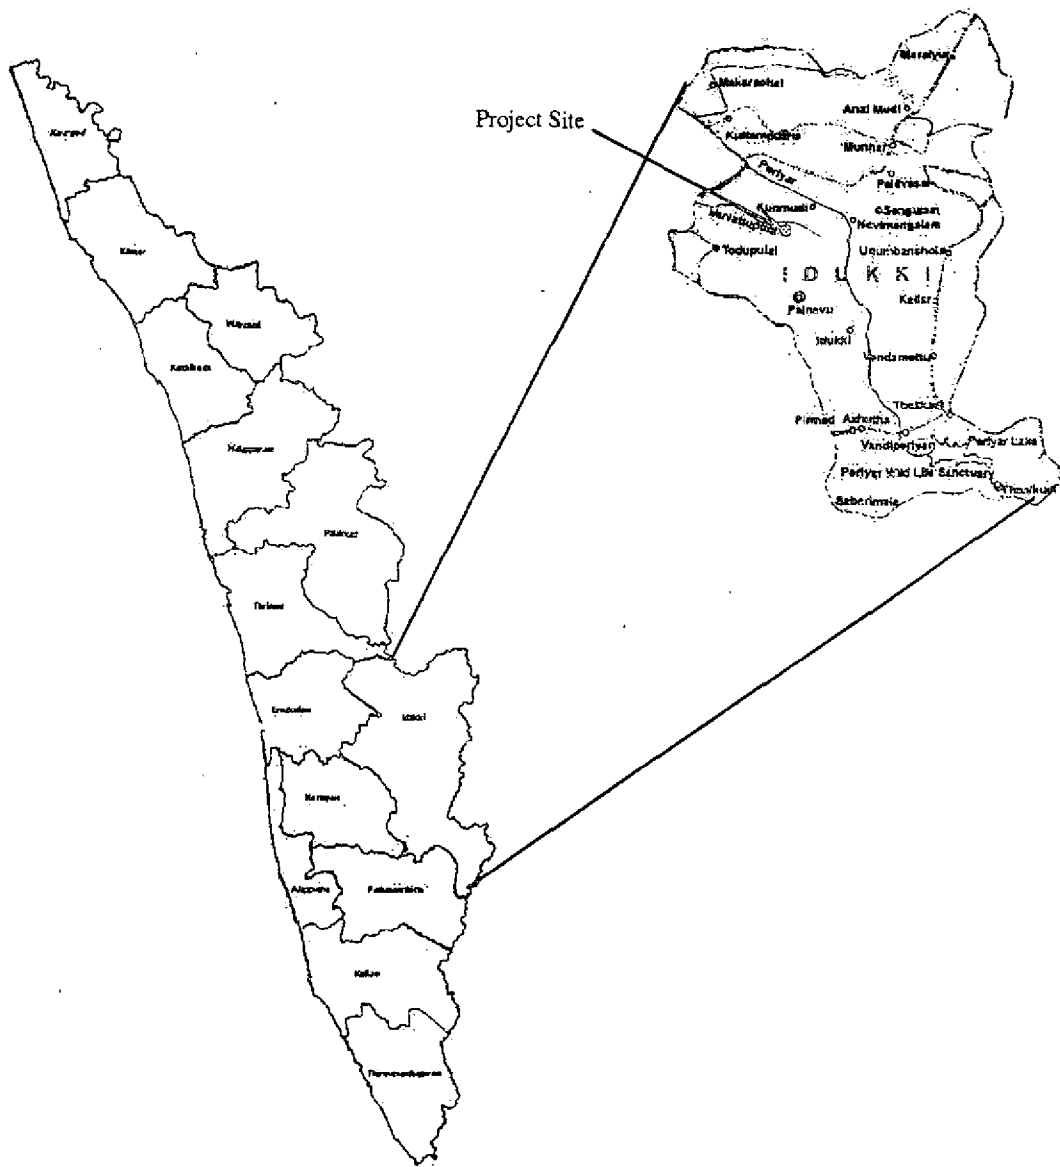


Project Report Drawing

UNIDO-RC FOR SHIP DEVELOPMENT			
EDATHANALKUTHU SMALL HYDEL PROJECT			
Title : INDEX MAP			
Consultants: ENERGY MANAGEMENT CENTRE - KERALA THYCAUD, THIRUVANANTHAPURAM - 695 014			
Reference: URC/SHIP/ETNL/DPR/01	Sheet No.	Revision:	Scale: NS
Prepared:		Approved	

BAR CHART
Construction of Edathanalkuthu MHP (2x250 kW)

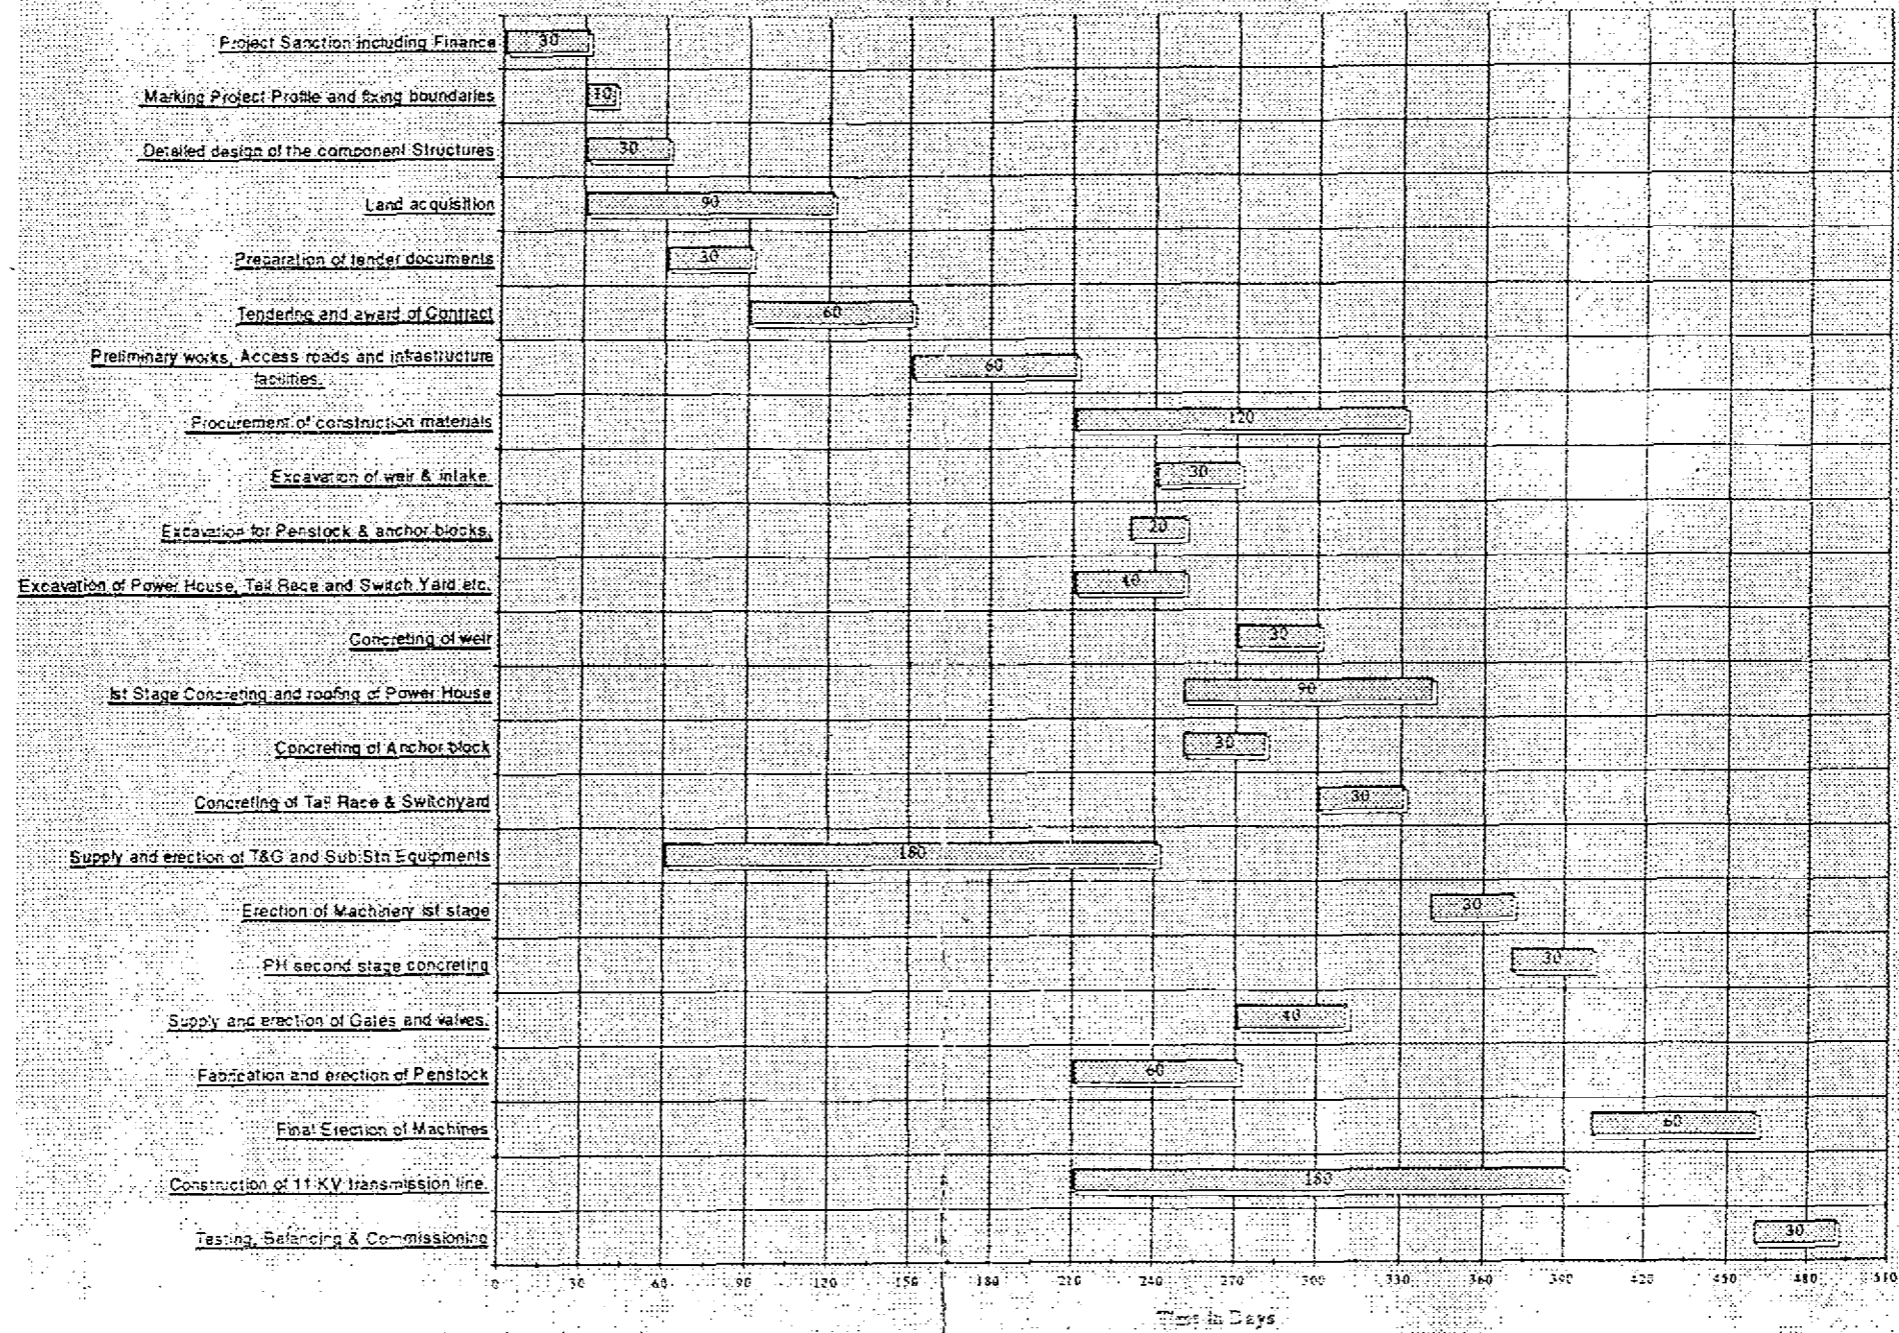

UNIDO-EC FOR SHP DEVELOPMENT			
EDATHANALKUTHU SMALL HYDEL PROJECT			
Title: PROJECT SCHEDULE			
Consultants:	ENERGY MANAGEMENT CENTRE - KERALA THYCAUD, THIRUVANANTHAPURAM - 695 014		
Reference:	URC/SHP/ETNL/DPR/03	Sheet No.	Revision: Scale: NS
Prepared:		Approved:	

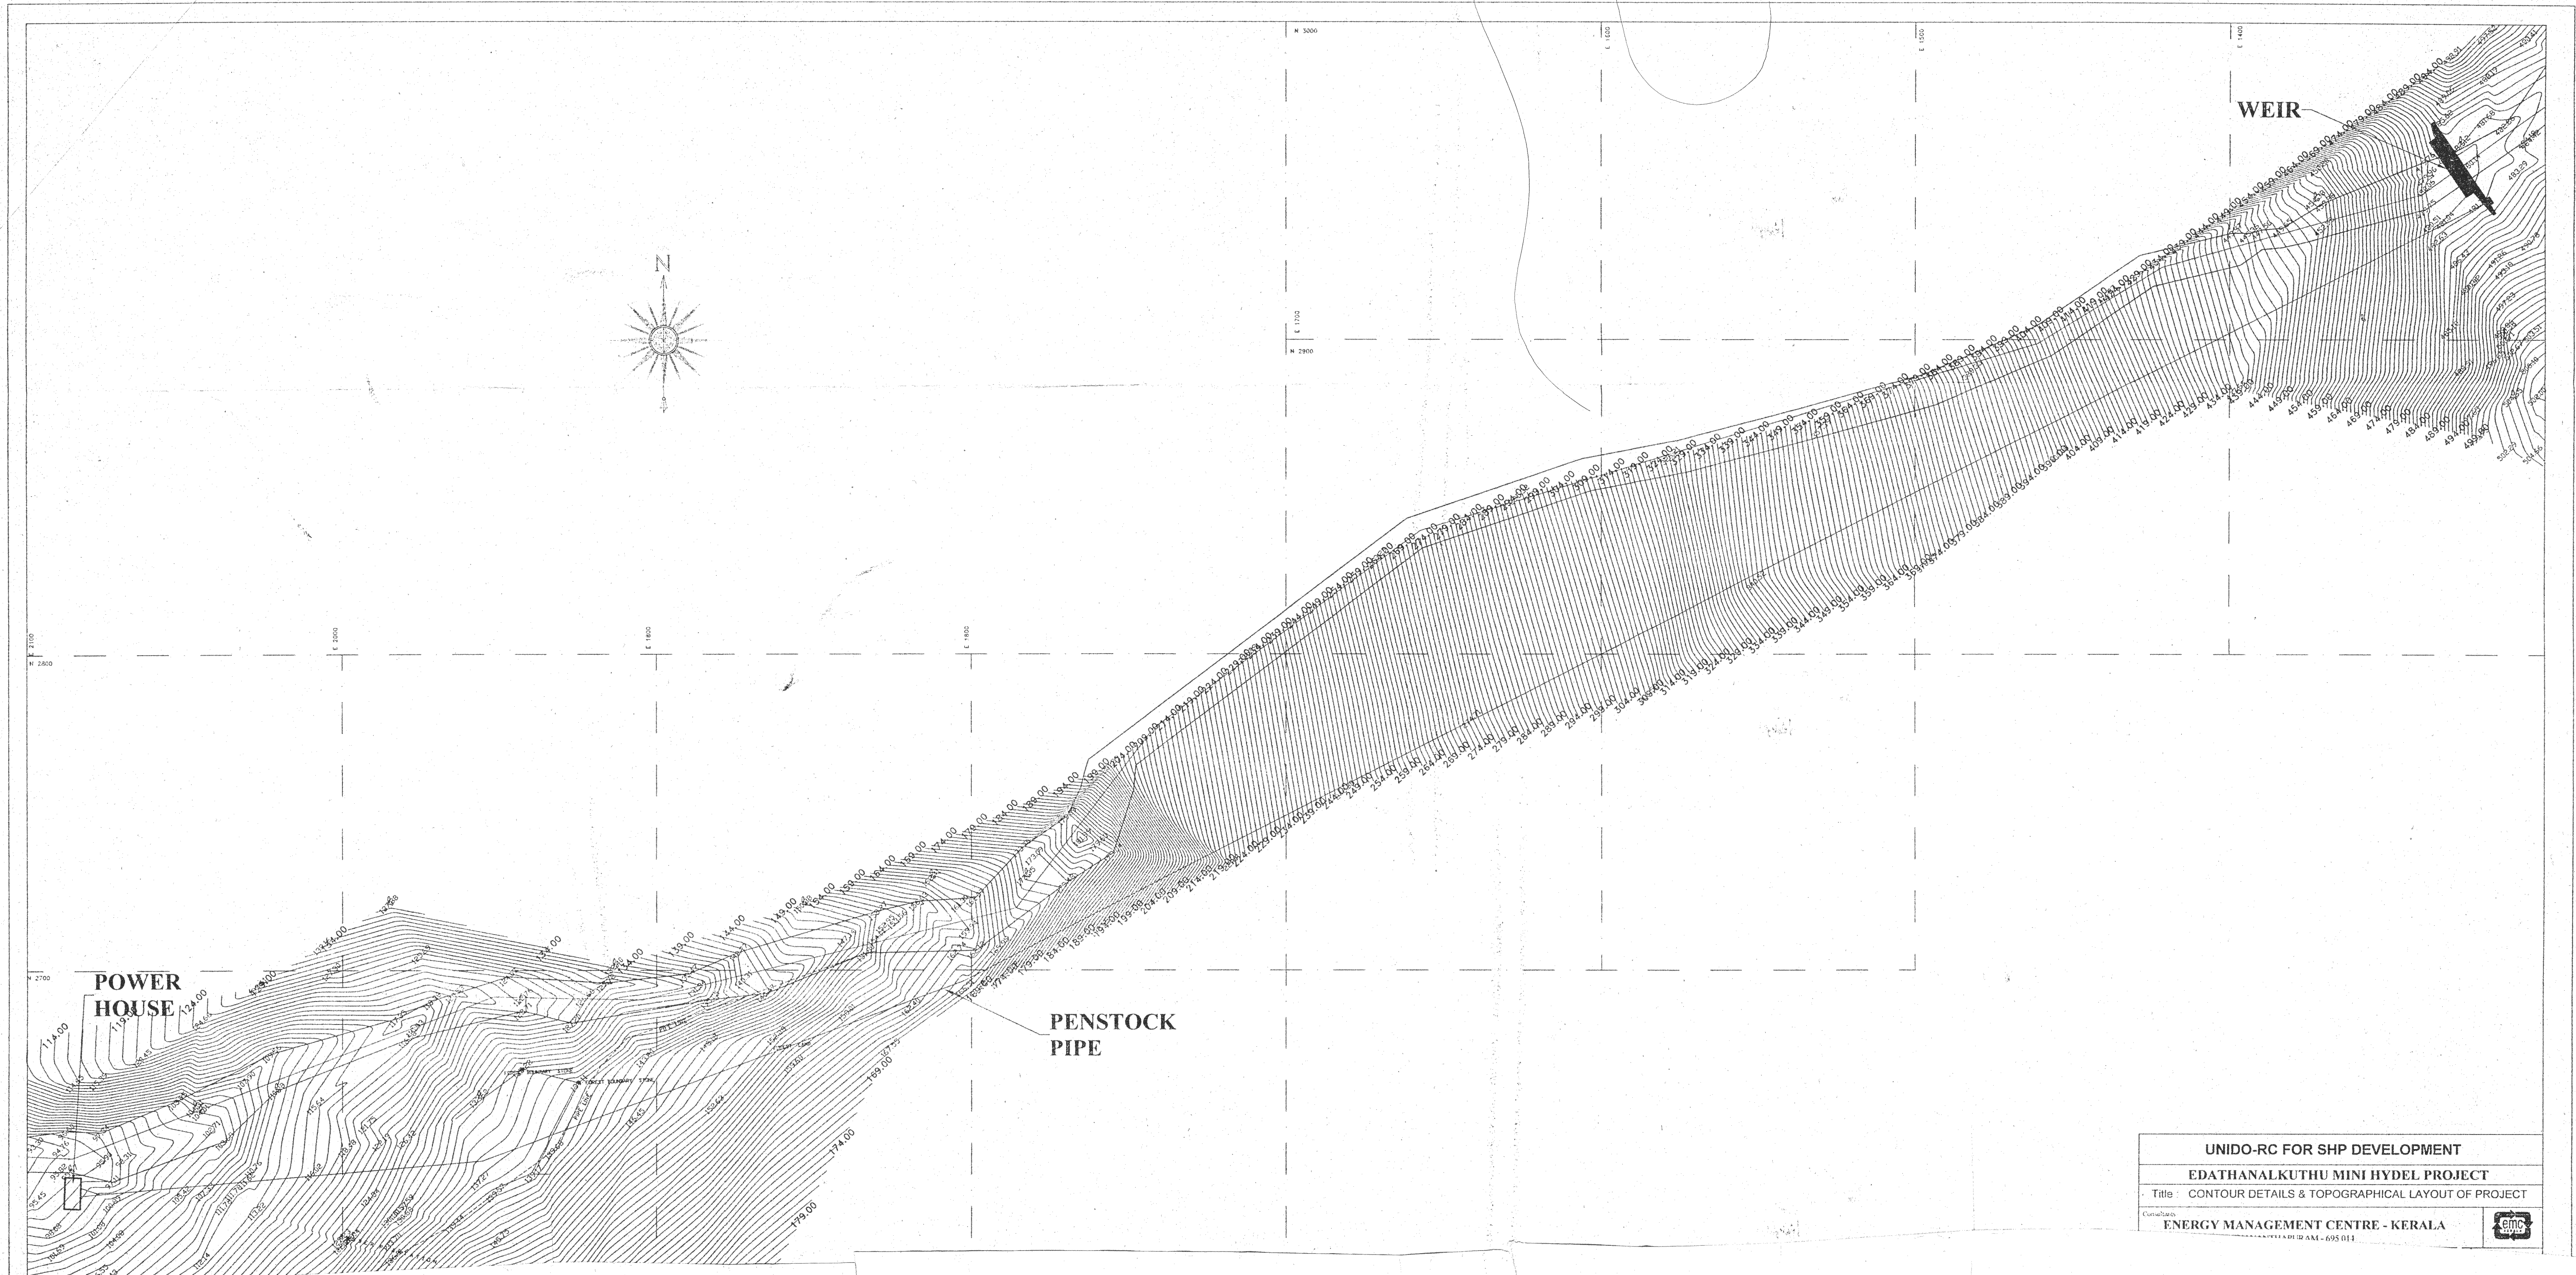

POWER HOUSE

PENSTOCK PIPE

WEIR

UNIDO-RC FOR SHP DEVELOPMENT	
EDATHANKUTHU MINI HYDEL PROJECT	
Title: CONTOUR DETAILS & TOPOGRAPHICAL LAYOUT OF PROJECT	
Consultants:	
ENERGY MANAGEMENT CENTRE - KERALA	
KARUNAKRISHNAN P O AM - 695 013	
