



**TOGETHER**  
*for a sustainable future*

## OCCASION

This publication has been made available to the public on the occasion of the 50<sup>th</sup> anniversary of the United Nations Industrial Development Organisation.



**TOGETHER**  
*for a sustainable future*

## DISCLAIMER

This document has been produced without formal United Nations editing. The designations employed and the presentation of the material in this document do not imply the expression of any opinion whatsoever on the part of the Secretariat of the United Nations Industrial Development Organization (UNIDO) concerning the legal status of any country, territory, city or area or of its authorities, or concerning the delimitation of its frontiers or boundaries, or its economic system or degree of development. Designations such as “developed”, “industrialized” and “developing” are intended for statistical convenience and do not necessarily express a judgment about the stage reached by a particular country or area in the development process. Mention of firm names or commercial products does not constitute an endorsement by UNIDO.

## FAIR USE POLICY

Any part of this publication may be quoted and referenced for educational and research purposes without additional permission from UNIDO. However, those who make use of quoting and referencing this publication are requested to follow the Fair Use Policy of giving due credit to UNIDO.

## CONTACT

Please contact [publications@unido.org](mailto:publications@unido.org) for further information concerning UNIDO publications.

For more information about UNIDO, please visit us at [www.unido.org](http://www.unido.org)



شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

22385

Our Ref.: شماره:

Date: تاریخ:

*Conversion of Prototypes into  
R134a Ozone Friendly  
Refrigerant At  
Ghandil Company*

Project Number  
MP/IRA/99/110

Contract Number, 99/255P

*Final Report*

May 2000





شرکت مهندسی سهند مینا (با مسئولیت محدود)

**SAHAND MINA ENGINEERING CO.LTD.**

شماره: Our Ref.:

Date: تاریخ:

**PROJECT NO. MP/IRA/99/110**

***Contract Number 99/255P***

## Final Report

### Introduction

Please find below our Final Report, concerning calculation and redesign of the prototypes that have been made by the counterparts and they will be tested at counterpart hot chamber. These prototypes have been manufactured under our engineering supervision and have been tested in accordance with appropriate ISO standard test procedure and relevant performance test characteristics for functionality and performance of the new Ozone friendly R134a refrigerant. We hope that this report could have satisfied the UNIDO in order to comply with our contract.


### Synopsis

This report has been prepared based on the Contract between UNIDO and Sahandmina Engineering company.

This project will phase out the use of CFC-11 and CFC-12 in the production of commercial refrigeration equipment at Ghandil Company CFC-11, which is used as a foam blowing agent in the production of polyurethane foam will be replaced by HCFC-141b and CFC-12 which is used as the refrigerant in the cooling circuit of appliances will be replaced by HFC-134a. The project includes the modification of all cooling equipment produced and the conversion of the production facilities. The model redesign element of the project includes testing, trial manufacture and reliability tests. The cost of converting foaming machines to use HCFC-141b will be covered by the counterpart organizations.

SMEC Final Report, Ghandil May 2000





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

## General Background


This report has been prepared and based on the UNIDO's contract and relevant terms of reference prepared by UNIDO and Sahandmina Co. Proposal to UNIDO.

The project will phase out, use of CFC-11 and CFC-12 for the production of Commercial Refrigerators at Ghandil Company. The redefinition of the existing refrigerator models in this company covers activities such as calculation and refrigeration system components selection.

SMBC Final Report, Ghandil May 2000

تهران، خیابان شریعی، بالاتر از میرداماد ساختمان ۱۲۸۰ آپارتمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۲۲۵۰۳۳۰، ۲۲۷۴۹۳۶، ۲۲۷۴۹۳۶ نمابر: ۲۲۷۴۹۳۶  
No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel.Fax: +98 21 227 49 36  
e.mail, sahandmina@hotmail.com





Our Ref.: شماره:

Date: تاریخ:

## Project Summary

The project relates to the Ghandil company accounting for phasing out CFC-11 and CFC-12, in small and medium-size companies in the commercial and industrial refrigeration sector in Iran.

This project covers the conversion of different models and will phase out the use of 21.95 tones of CFC-11 and 6.80 tones of CFC-12 in the production of a range of commercial refrigeration equipment. CFC-11, which is used as a foam-blowing agent in the production of polyurethane foam will be replaced by R141b and CFC-12, which is used as the refrigerant in the cooling circuit of equipment, will be replaced by HFC 134a. The project includes technical assistance in design and implementation of the conversion.


The conversion of the production facilities includes all equipment necessary for charging and testing of refrigerating equipment and the equipment necessary for the production of polyurethane insulating foam.

The overall unconstrained CFC consumption in the Islamic Republic of Iran was projected to raise from 2,445 ODP tones in 1991 to 7,778 ODP tones in 2010. This corresponds to an overall annual growth rate of 6.5%. The annual growth rate for the domestic refrigeration sector, however, was estimated to be 12% in the period 1991 to 1995 and 4% between 1996 and 2010.

Most Commercial Refrigerators Companies manufacture several types of equipment from wide ranges of applications, including the following:

- Display and sales cabinets for supermarkets and individual suppliers of food,
- Upright and chest freezers for commercial application,
- Different sizes of drinking water coolers,
- Soft ice freezer





Our Ref.: شماره:

Date: تاریخ:

## Company Backgrounds

Ghandil Company is one of the manufacturers of commercial and domestic refrigerators and freezers located in Mahdasht, near Tehran. The enterprise is 100% indigenously owned and was established and commenced production in 1989. the enterprise employs about 135 person. The enterprise reports no exports and being financially sound.

The Ghandil Co. has two main production line. Production of 7 and 11 cu. Ft. refrigerators, 11, 15, 18 cu. Ft. refrigerators/freezers and chest freezers for commercial application. The products are depending on markets. The company produced in 1997 a total of 32450 refrigerator and freezers and 2230 chest freezers in 3 models. In the preceding 12 month (20/03/1998 to 20/03/99), the Ghandil Co. produced a total of 36450 refrigerators & freezers and 84 Chest Freezers and consumed 21.95 Mt. Of CFC-11 and 6.80 Mt. Of CFC-12

The Model-wise breakdown of commercial and domestic refrigeration products with their individual CFC data produced by the enterprise during the preceding twelve months period (20/03/1998 to 20/03/99) is reported by them as below

Model/Description	Units Produced	Foam Operation		Refrigeration Operation	
		Foam/Unit (gms)	CFC11/ Unit (gms)	Compressor	CFC-12/unit (gms)
Refrigerators	19,250	3710	520	1/5 HP	175
Refrigerator/freezers	19,800	4500	630	¼ HP	200
Total/Weighted Average	36,050	4340	608	—	188

## Aim of the Project

The aim of the immediate project is to;

- Design, calculation and ing for model redefinition.
- Testing prototypes for functionality and performance criteria.

5





Our Ref.: شماره:

Date: تاریخ:

- Redesign the cooling units of the all models so that they could run on the new Ozone friendly R134a instead of the ODP active CFC12.

### **Scope of the Contract**

A study will be made for 5 models of commercial refrigerators made by Ghandil Co. to specify;

- Dimensional specification;
- Type and thickness of insulation
- Refrigeration unit component details
- Working performance
- Energy consumption

Selection of HFC 134a compatible components  
Redesign of the refrigeration circuit as necessary  
Specifying necessary changes in the cooling system if required  
Preparation of the trial equipment one prototype per model  
Testing of prototypes for functionality and performance  
Evaluation of the test results

### **Supply of the Material**

Following components and material have been used to make prototypes .

- R134a Compressors
- R134a Refrigerant
- Refrigerant Accumulators
- Specially designed filter drier
- Specially designed evaporator and condenser

### **Activities**

In this report we will describe the activities achieved during execution of the contract for implementation of the project.

- Site survey of the counterpart premises in order to be familiar with the counterpart facility and production line and also define the prototypes for conversion.

6





Our Ref.: شماره:

Date: تاریخ:

- Site survey of the counterpart premises in order to collect necessary data for calculation of prototype.
- Preparation of Technical data sheet in order to define detail technical specification
- Review the existing technical drawing for the purpose of assessment of possible changes in the design criteria.
- Review each prototype refrigeration circuit for determination of cooling circuit components
- Review and assessment of design criteria following cooling circuit component in order to minimize possible changes and design improvement.
  - Compressor technical specification
  - Condenser type, material and design criteria
  - Evaporator type, material and design criteria
  - Capillary tube design, dimensions and material
  - Filter drier, size and material
  - Determination of R12 refrigerant charge for each prototype in order to adjust R134a charge weight
- Coordination with the counterparts for performing, performance test after completion of making prototypes
- Calculation of prototypes in order to determine the size of R134a compressor and implement necessary changes to the cooling circuits
- Preparation of Performance Test Results Sheet, in order to record all data obtained during functional test.
- Achievement of Performance Test for each prototype
- Evaluation of test results sheet.
- Recommending appropriate changes to the refrigeration system component for necessary prototype improvement.
- Modifying necessary components.
- Supervision of Trial Production.

### ***Preparation of prototypes for performance test as***

The prototypes shall be tested under designated ambient temperature mostly at + 32 C, the test performance revealed that no significant changes is necessary for refrigeration system circuit, because the original size of evaporator and condensers are much bigger than cooling requirements.

The adjustment will be applied to the mainly to the amount of refrigerant

7







Our Ref.: شماره:

Date: تاریخ:

charge and length of capillary tube.

Each prototypes should under go for performance test at the following test criteria.

Pull down test at + 32 C

Continues run Test at = 32 C ambient temperature

Cyclic run test at + 32 C ambient temperature.

The test condition was selected in accordance with appropriate ISO test standards.

The material as sample for making prototypes are supplied mainly from local market, due to the limitation for purchasing R134a compressor from local market we had to contact several manufacturers to find out the technical specification for appropriate compressor.

The prices for material specially R134a and R141b blended polyol are much higher than R12 and R11,

## Training

Before making prototypes we conducted a training course to train the technical staffs to make their own prototypes and also make them familiar with the new technology.


The following topics were thought during the theatrical training course.

- An orientation to UNIDO CFC phases out project.
- Montreal Protocol
- Ozone Layer and CFC side effect to Ozone layer
- Familiarization with new R134a Refrigerant, application, safety precaution, use and maintenance.

- Familiarization with the new vacuum and charging equipment, vacuum

8





Our Ref.: شماره:

Date: تاریخ:

pump and charging board.

- Recovery and recycling of R12 refrigerant, and also R134a.
- Alternative for R11 and R12.
- Some explanation about R141b blowing agent,
- Selection of refrigeration components to be replaced with R12 refrigeration system.
- Calculation and redesign of prototypes
- Performance test
- Test results Evaluation.
- Refrigeration system adjustment.
- Selecting Prototype Model
- Refrigeration System components Familiarization
- Heat Load Calculation
- Thermostat Selection and Adjustment
- Refrigerant Charging Methods
- Testing Prototypes
- Analyzing Prototype Test Results





Our Ref.: شماره :

Date: تاریخ :

Following subjects were taught during conduction of the course

Refrigeration Load Calculation for different type of  
Water Coolers

Water cooler cabinet usually consist of a sheet metal housing built around a steel framework, inside this sheet housing there is usually a condensing unit, located near the floor, and above this is the water-cooling mechanism. The latter is the only part insulated (foamed plastic) from the room. The insulation is usually specially formed and between one and one half inches and two inches thick. These cabinets are made in such a way that one or more sides may be easily removed to gain access to the interior. The basin of the water cooler is generally made of porcelain-coated cast iron, porcelain coated - steel, or stainless steel. Heat exchangers are frequently used on water coolers. These make use of the low temperature of waste water and the suction line to pre-cool the fresh water line to the evaporator coil.

Self-cooler are of two types,

- 1- Bottle Type.
- 2- Tap water type

The bottle cooler usually uses a 20 to 25 liter bottle of water inverted on the top of the cabinet. Overflow and drain water are stored in a container built the cabinet. These coolers use air-cooled condensing units exclusively. They are used where water and drains are not available or where available the plumbing insulation may be expensive.

Water cooler using a plumbing supply and drain connection, must be installed according the relevant approved standards. The plumbing should be concealed, a hand shutoff valve should be installed in the fresh water line. Drain pipe at least 1 inches in diameter provided, and rubber opening must be above the drain in such a way as to eliminate the chance for accidental siphoning of the drain water back into the fresh water system. The tap water models use variety of evaporator coil wrapped around the water-cooling tank.

Temperatures of the cooling water are variable depending on the persons who are drinking the water. We consider 10 C for the temperature of drinking water, while our inlet temperature is considered 24 C.

In large business establishment, in office buildings, or in factories, multiple water





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO. LTD.

Our Ref.: شماره:

Date: تاریخ:

cooler, instead of individual ones, are popular. These

coolers have one large condensing unit supplying many bubbles and these may be of many different types.

Water cooler is a device that usually is used in the public area to supply cold drinking water to the customers and different people. The appliance is mainly used in the Airports, Railways Station, Coach Terminals, Banks, Offices, Parks, and etc. therefore, it is hard to specify an standard for cold water consumption during the day from the water cooler.

We consider three refrigeration load components that should be taken into our consideration.

Heat gain by heat transmission from, main water storage tank wall insulation.

Heat removed from water entering to the water tank at the initial refrigeration system operating condition, (water stored in storage tank during the night, with normal ambient temperature) which is divided by 24 hrs.

Heat removed from Drinking Water flow that are consumed during designated operating hours " $\dot{M}$ "

The problem of determining the refrigeration load of a water-cooled installation is basically a specific heat and heat leakage problem combination. The water is cooled to temperature which vary upward from about 4 degree centigrade , and the amount heat removed from the water to cool it to a predetermined temperature is simple specific heat problem. The water, being maintained at these low temperature,

results in a heat leakage from room into the water, and this part involves the heat leakage portion of installation.

$Q1 = m C \Delta T$ , Where:

$Q1$  Total heat removed from total drinking water tank volume capacity (lit.) during specific period, related to compressor cooling capacity power in Watts, at initial compressor start up, and early in the morning. When the water temperature is 30 C.

$m$  total weight of water in the water cooler storage tank in Kg. Considering that one litter of water at 24 C is equal to approximately one Kg.

$C$  Specific heat factor of water in Kcal/Kg °C


$\Delta T$  Temperature difference ( $T_i - T_c$ ), where,  $T_i$  is inlet water temperature, and  $T_c$  is

تهران، خیابان شریعتی، بالاتر از میرداماد ساختمان ۱۲۸۰ آپارتمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۲۲۵۰۳۳۰ - ۲۲۷۴۹۳۶ شماره: ۲۲۷۴۹۳۶

No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel. Fax : +98 21 227 49 36

Second progress report, Ghandil Company, March 2000, email, sahandmina@hotmail.com





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

final cooled water.

$$Q2 = \dot{M} C \Delta T$$

Q2 Total heat removed from total drinking water flow (lit.) during specific period, 16 hours. In Kcal.

$\dot{M}$  total weight of water flow during 16 hours. in Kg.

C Specific heat factor of water in Kcal/Kg °C

T Temperature difference (Ti-Tc), where, Ti is inlet water temperature, and Tc is final cooled water temperature.

$$Q3 = UA \Delta T$$

Where:

Q3 Total Leak, gained through side wall of drinking water storage tank by conduction in Kcal..

U Heat Resistance Coefficient Factor in Kcal/Sq. mt. C

A Total Area which heat is transmitted by. In Sq. Mt.

$\Delta T$  Temperature difference (Ta - Tc), where, T is ambient temperature, and Tc is final cooled water temperature.





Our Ref: شماره:

Date: تاریخ:

### Refrigeration Load Calculation for different type of Domestic and Commercial Appliances

Refrigeration load consist of four individual components:

- 1- Transmission load;  
Heat transfer through walls ( sides, back panels, top and bottom ) and door panel.
- 2 - Product load;  
Heat Removed from and produced by the products which are brought and stored in the refrigerator;
- 3 - Internal load;  
Heat produced by internal sources such as lights, fan or heaters;
- 4 - Infiltration load  
Heat gains associated with air entering the refrigerated space;

The above mentioned components will be discussed separately to analyze and extract the most useful and practical equipment.

#### Transmission Load

Heat gain through walls of a refrigerated space depend on cabin Temperature, liner, insulation and cabin conductivity and also the surrounded ambient air. In other word, there are four different resistance opposing heat flow between cabin space and ambient air as given in resistance circuit.

Considering the above mentioned resistance,  $R_i$ ,  $R_c$  and  $R_a$  are not comparable in magnitude with  $R_i$  ( Insulation resistance ) and so can be neglected in our calculations. Therefore, the resultant circuit and relevant equations are.

$$R = \frac{x}{KA} \text{ Heat Resistance}$$

$$Q_{TL} = \frac{\Delta T}{R} \text{ Heat Transfer}$$

Where:

تهران ۱۳، خیابان شریعی، بالاتر از میرداماد ساختمان ۱۲۸۰ آبارتمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۲۲۵۰۳۳۰، ۲۲۷۴۹۳۶، ۲۲۷۴۹۳۶  
No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel.Fax: +98 21 227 49 36

Second progress report, Ghadil Company, March 2007  
e-mail, sahandmina@hotmail.com





Our Ref.: شماره:

Date: تاریخ:

x = Insulation Thickness, mm

K = Insulation Conductivity,  $\frac{Wmm}{m^2 \cdot C}$

A = Outside Area,  $m^2$

$\Delta T$  = Temperature difference (Ta - Tc), C

If the insulation thickness of side walls, back panels, top, bottom and door are different, heat transfer for each part can be calculated separately and then summed for two door refrigerators, due to different cabin temperature of freezer and refrigerator compartments, heat transfer for each compartment should be calculated separately and then added together.

#### Product Load

Heat removed from products (meat, fruits, vegetables, water and etc.) to reduce temperature from receiving to storage temperature is known as product load. Following steps can be taken to calculated of product loads.

1 - Heat removed from initial temperature (Ti) to storing temperature (Trs) in refrigerator compartment is;

$$Q_{rs} = \dot{M} C (T_i - T_{rs})$$

Where:

$\dot{M}$  = Mass of product, Kg / h

C = Specific heat of product, Kcal / Kg


2 - Heat removed from initial temperature (Ti) to freezing temperature (Tf) is ;

$$Q_{af} = \dot{M} C (T_i - T_f)$$

Where :

$\dot{M}$  = Mass of product, Kg / h





Our Ref.: شماره:

Date: تاریخ:

C = Specific heat of product above freezing point, Kcal / Kg

3- Latent heat of fusion for products is equal to;

$$Q_L = \dot{M} h$$

Where h = Latent heat of product, Kcal / Kg

4 - Heat removed from freezing temperature ( Tf ) to final storage temperature ( Tfs ) is;

$$Q_{bf} = \dot{M} C_{bf} ( T_f - T_{fs} )$$

Where: Cbf = Specific heat of products below freezing temperature.

For upright freezers or freezer compartment of refrigerators, total product load is

$$Q_{pl} = Q_{af} + Q_L + Q_{bf}$$

For storage products to some lower temperatures above freezing temperature in refrigerator compartment is;

$$Q_{pl} = Q_{rs}$$

#### Internal Load

Electrical energy dissipated in the refrigerated space such as lights, fan motors, heaters, .... are included in the internal heat load. Due to the little amount of consumption of lighting, the effect of lighting can be negligible and only electrical

heaters of two door refrigerators or fan motors ( if exist ) are considered in our load calculation.

#### Infiltration Load

Infiltration air load is the heat transfer due to exchanging of refrigerated air with ambient caused by opening of the door or leakage through the gasket area. Infiltration load is one of the most important load components and roughly it is about 20 % of total refrigeration load.







Our Ref.: شماره :

Date: تاریخ :

### Total Refrigeration load

As it was mentioned before, transmission load ( Qtl ), product load ( Qpl ) and internal load ( Q il ) can be calculated separately. For infiltration load (air exchange through doorways or gasket leakage ), we can take into account from 10 to 25% of sum of the above mentioned components, (transmission load, product load and internal load). Therefore total refrigeration load can be expressed as:

$$QTL = 1.25 ( QTL + QPL + QIL )$$

As per ASHREA standard we can use following formula which is depended directly to the number of air change per day and internal volume of the appliance.

$$Q = (V \times N \times H) \div 86400$$

### Where:

Q = Heat Load due to the Air Change

V = Appliance Internal Volume

H = Heat removed from cubic meter of air = 75000 jul/sec

### Equipment Selection

Calculation of refrigeration load is the basis for selecting system equipment. First step is selection of a suitable compressor with cooling capacity comparable to calculated load, then a capillary tube should be selected so that the compressor and tube fix a balance point at the desired evaporating temperature, also two evaporator

and condenser should be selected to balance compressor capacity.

### Compressor selection

Assuming 16 hours daily operating time for the compressor, the calculated refrigeration load will be modified to:

$$Qc = \frac{Q_{TL} \times 24}{16} = 1.5 Q_{TL}$$

Where :

Qc = required cooling capacity





Our Ref: شماره:

Date: تاریخ:

For selection of compressor from manufacturer's catalogue, we have to mention appropriate evaporating temperature;

- In refrigerators with ice compartment mounted inside, maximum evaporating temperature can be selected in order to have - 12 C ( Two Stars ) inside ice compartment.

- For upright freezers or freezer compartment of two door refrigerators, evaporating temperature should be in order to obtain -18 C ( Three Stars ) cabin temperature.

#### Capillary tube

Capillary tube is one of the most important components in refrigerator circuits . capillary acts as a pressure reducing device to meter the flow of refrigerant to the low pressure side ( evaporator ) of the system. In other word, capillary tube should be capable to pass refrigerant pumped by the compressor and feed it to evaporator at available load and demand conditions.

On the contrary of the R12 or R22 refrigerants, practical equations, charts or graphs are not available for calculation of capillary size in R134a refrigeration circuits. Comparing saturation properties of R134a with R12 at a certain temperature, R134a pressure is less than R12, therefore, capillary tube for R134a shall be adjusted at low evaporating temperatures in comparison with R12 system. The capillary for R134a refrigeration system must have an increase resistance which can be estimated about 10 - 15% increase in length for a definite bore. However the exact size (bore and length )

can be attainable after laboratory performance tests.

#### Condenser & Evaporator

The statically cooled condenser is designed for use in small refrigeration appliance with sufficient space for the necessary condenser area. These condensers are manufactured either in tube-on-finned plate type or wire-on-tube design. Assuming that compressor casing and tubing will dissipate 80% of the heat equivalent of electrical in put, the condenser should be capable to reject heat absorbed by the refrigerant in the evaporator plus 20% of compressor power input heat equivalent.

The evaporator should balance the selected compressor capacity, not the original calculated load. Most of the refrigerators mainly employ aluminum evaporators





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO. LTD.

Our Ref.: شماره:

Date: تاریخ:

produced on the roll-bond principal, where wire-on tube evaporators are usually installed in upright freezers.

Due to the higher latent heat ( hfg ) of R134a in comparison with R12 and therefore less refrigerant charge in the system, it seems that evaporators and condensers used for R12 are also suitable for R134a refrigeration system. However more detailed information about role of these two components in the system would be cleared after laboratory performance tests. Therefore partial modifications should be done if needed.

#### Refrigerant charge

As mentioned in previous sections, R134a latent heat of vaporization is about 28-30% higher than R12 in temperature range -30 C up to + 10 C. Table 2-2 shows thermodynamics saturation properties (with respect to a certain temperature ) for these two refrigerants. In practice, charging amount of R134a can be 10-15% less than R12 with the same refrigeration load.

R134a is capable to absorb more humidity of the oil in comparison with R12. Therefore, the filter drier selected for R134a should be a drier with 3A desiccant with 20% more molecular sieve ( by weight ) in comparison with conventional types.





Our Ref.: شماره:

Date: تاریخ:

## Making Prototypes

- Prototype Model Selection
- Refrigeration System Components Selection
  - 1- Defrost Type
  - 2- No-Frost Type
- Familiarization with Refrigeration System Components
  - 1- Condenser
    - a. Wire on Tube
    - b. Tube welded on Plate
    - c. Tube on Plate
    - d. Tube in the Body
    - e. Tube on the fins
  - 2- Capillary Tube
    - a. Tube Length
    - b. Tube Diameter
    - c. Tube Material
  - 3- Expansion Valve
    - a. Size
    - b. Capacity
    - c. Material
  - 4- Filter Direr
    - a. Weight
    - b. Material
    - c. Model
  - 5- Evaporator
    - a. Roll Bond





Our Ref.: شماره:

Date: تاریخ:

- b. Wire on Tube
- c. Tube welded on Plate
- d. Tube on Plate
- e. Tube in the Body
- f. Tube on the fins

- Refrigeration Load Calculation

1- Aim of Calculation

- a. Model Re-Definition
- b. Model Improvement
- c. Model Modification
- d. Conversion of Prototype
- e. Model New Design

2- Methods of Refrigeration Load Calculation

- a. ASHREA
- b. Manufacturer
- c. Institutes and Universities

3- Different Elements Required for Calculation

a. Heat Transfer

Dimension, Insulation, Ambient, Working Condition  
Gasket, etc.

b. Product Load

Food, Material, Ice, Etc.

c. Infiltration

Door Opening, Air Replacement

d. Miscellaneous devices and apparatus

Light, Fan, Etc.





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO. LTD.

Our Ref.: شماره:

Date: تاریخ:

- Compressor

1- Cooling System

- a. Static
- b. Oil
- c. Air

2- Pressure

- a. LBP (Low Back Pressure)
- b. HBP (High Back Pressure)
- c. MBP (Medium Back Pressure)

3- Model

- a. Hermetic
- b. Semi-Hermetic
- c. Open

4- Type of Refrigerant

- a. R12
- b. R134a
- c. Isobutene
- d. Blend

5- Accessories

- a. Capacitor Type
- b. Starting Relay
- c. Voltage, Frequency and Current
- d. Electrical Circuit

6- Mounting Compressor

- a. Refrigerant Fellow Direction
- b. Top on the Roof
- c. Bottom on Base
- d. Double Compressor Mounted





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

### 7- Compressor Capacity

- a. Watt
- b. Horse Power
- c. B.T.U/Hr
- d. Kcal/Hr

### 8- Compressor Test Condition

CECOMAF

Evaporating Temp.	-25° C
Condensing Temp.	55° C
Ambiant Temp.	32° C
Suction Gas Temp.	32° C
Liquid Temp.	55° C
Volatage/Hertz	220V/50 Hz
Heat out Put= Capacity+Watt Consumption	

ASHRAE

Evaporating Temp.	-23.3° C
Condensing Temp.	55° C
Ambiant Temp.	32° C
Suction Gas Temp.	32° C
Liquid Temp.	32° C
Volatage/Hertz	220V/50 Hz
Heat out Put= Capacity+Watt Consumption	

ASHRAE to CECOMAF

### Conversion of Capacity From CECOMAF into ASHRAE

- R134a Multiply by 1.231
- R22 Multiply by 1.097
- R404 Multiply by 1.183
- 1 Watt = 0.86 Kcal/h
- 1 Watt = 3.41 BTU/h

تهران ۲۲ خیابان شریعی، بالاتر از میرداماد ساختمان ۱۲۸۰ آپارتمان شماره ۱۱۰ کد پستی ۱۹۵۵۸ تلفن ۲۲۵۰۱۲۴، ۲۲۵۰۱۲۴، ۲۲۵۰۱۲۴ نمابر: ۲۲۵۰۱۲۴  
No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel. Fax: +98 21 227 49 36

Second progress report, Ghandil Company, March 2006, e-mail, sahandmina@hotmail.com





Our Ref.: شماره:

Date: تاریخ:

1 Kcal/h = 1.0162 Watt  
1 BTU/h = 0.293 Watt

9- Evaporating Temp. and Selection of Compressor

10- Thermostat

Thermostat Adjustment

- a. Cut-in Time – 5 to –15 Compressor Connected
- b. Cut-out time –15 to –25 Compressor Dis-Connected
- c. Thermostat Setting, Max. Med, Min
- d. Thermostat Temperature Difference

- Refrigerant Type

- 1- CFC- 12
- 2- HFC-134a
- 3- Isobutene, R-600
- 4- Blend, (Isobutene+ Propane)

- Methods of Refrigerant Charging

- 1- Bottle, 13.5 Kg. Cylinder
- 2- Portable Charger
- 3- Production, Evacuation and Charging Equipment

- Refrigerant Charge Weight

- 1- Experimental, trial and error
- 2- Calculation
- 3- Comparison with other Refrigerants

- Refrigeration Leak Detection Procedure

- 1- Conventional Method, (water and Soap)
- 2- Portable Electronic Leak Detector
- 3- Production Electronic Leak Detector
- 4- Nitrogen, and Helium Leak Detection Procedure

Accuracy and Precision of Leak Detection Procedure







شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

- 5- Conventional Method, (water and Soap)
- 6- Portable Electronic Leak Detector
- 7- Production Electronic Leak Detector
- 8- Nitrogen, and Helium Leak Detection Procedure

- Recovery
- Recycling
- Reclaiming

### Testing Prototypes

- Test Prototypes with R12 Refrigerant to get desired test results.
- Hot Chamber Specification
- Placing Prototypes at Hot Chamber
- Mounting Sensors and their Place and Location
- Testing Condition
  - 1- Tropical "T" 43 °C
  - 2- Sub-Tropical 38 °C
  - 3- Normal 32 °C
  - 4- Sub-Normal 28 °C
  - 5- Cold 18 °C
  - 6- Relative Humidity





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO. LTD.

Our Ref.: شماره:

Date: تاریخ:

- Test Package
- « M » Package
- Meat
- Ice
- Different Tests
  - 1- Operational
  - 2- Performance
  - 3- Energy Consumption
  - 4- Ice Making
  - 5- Humidity
- Testing Procedure
  - 1- Pull Down
  - 2- Continuous Run
  - 3- Cyclic Run
- Duration of Test
- Reading Test Results
- Test Results Analysis





Our Ref.: شماره:

Date: تاریخ:

## Refrigeration Load Calculation

### Water Cooler and Chest Freezer, Double Door Ref.Freezer and Display cases

Refrigeration load consist of three individual components:

- 1- Transmission load;  
Heat transfer through side walls by conduction
- 2 - Product load;  
Heat Removed from and produced by the products which are stored.
- 3 - Internal load;  
Heat produced by internal sources such as lights, fan or heaters;
- 4 - Infiltration load  
Heat gains associated with air entering the refrigerated space and door opening and etc.;

In this section , the above mentioned components will be discussed separately to analyze and extract the most useful and practical equipment's.

### Transmission Load

Heat gain through walls of a refrigerated space depends on cabin Temperature, liner, insulation and cabin conductivity and also the surrounded ambient air. In other word, there are four different resistance opposing heat flows between cabin space and ambient air as given in resistance circuit.

$$T_{\text{refrigerator}} \leftarrow R_{\text{liner}} + R_{\text{insulation}} + R_{\text{cabin}} + R_{\text{ambient}} \leftarrow T_{\text{ambient}}$$

Considering the above mentioned resistance,  $R_l$ ,  $R_c$  and  $R_a$  are not comparable in magnitude with  $R_i$  ( Insulation resistance ) and so can be neglected in our calculations. Therefore, the resultant circuit and related equations is.

$$R = \frac{x}{KA} \quad \text{Heat Resistance}$$

$$Q_{\pi} = \frac{\Delta T}{R} \quad \text{Heat Transfer}$$

Where:





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

$x$  = Insulation Thickness, mm

$K$  = Insulation Conductivity,  $Wmm/m^2 \cdot C$

$A$  = Outside Area,  $m^2$

$\Delta T$  = Temperature difference ( $T_a - T_c$ ), C

If the insulation thickness of side walls, back panels, top, bottom and door are different. Heat transfer for each part can be calculated separately and then summed for freezer and refrigerator compartments as necessary, heat transfer for each compartment should be calculated separately and then added together.

### Product Load

Heat removed from products (meat, fruits, vegetables, water and etc. ) to reduce temperature from receiving to storage temperature is known as product load. Following steps can be taken to calculated of product loads.

1 - Heat removed from initial temperature ( $T_i$ ) to storing temperature ( $T_{rs}$ ) in refrigerator compartment is;

$$Q_{rs} = \dot{M} C (T_i - T_{rs})$$

Where:

$\dot{M}$  = Mass of product, Kg / h

$C$  = Specific heat of product, Kcal / Kg

2 - Heat removed from initial temperature ( $T_i$ ) to freezing temperature ( $T_f$ ) is ;

$$Q_{af} = \dot{M} C (T_i - T_f)$$

Where:

$\dot{M}$  = Mass of product, Kg / h

$C$  = Specific heat of product above freezing point, Kcal / Kg

3 - Latent heat of fusion for products is equal to;

$$Q_L = \dot{M} h$$

Where  $h$  = Latent heat of product, Kcal / Kg

4 - Heat removed from freezing temperature ( $T_f$ ) to final storage temperature ( $T_{fs}$ ) is;

$$Q_{bf} = \dot{M} C_{bf} (T_f - T_{fs})$$

SMEC for Ghandil Company,  
C:\My documents\GHA\NDIL\First Report





Our Ref.: شماره:

Date: تاریخ:

Where:

$C_{bf}$  = Specific heat of products below freezing temperature.

For upright freezers or chest freezer, total product load is

$$Q_{pl} = Q_{af} + Q_i + Q_{bf}$$

For storage products to some lower temperatures above freezing temperature in refrigerator display cases compartment is;

$$Q_{pl} = Q_{rs}$$

### Internal Load

Electrical energy dissipated in the refrigerated space such as lights, fan motors, heaters, should be calculated as appropriate depending on type of display cases and other products.

### Infiltration Load

Infiltration air load is the heat transfer due to exchanging of refrigerated air with ambient caused by opening of the door or leakage through the gasket area and /or open top freezer of show cases. Infiltration load is one of the most important load components.

### Total Refrigeration load

As it was mentioned before, transmission load ( $Q_{tl}$ ), product load ( $Q_{pl}$ ) and internal load ( $Q_{il}$ ) can be calculated separately. For infiltration load (air exchange through doorways or gasket leakage), we have to take into account that depending on the type of models we have to consider different amount of heat gain, or a percentage of amount of the above mentioned components. (Transmission load, product load and internal load). For example;

$$Q_{TL} = 1.20 ( Q_{TL} + Q_{PL} + Q_{IL} )$$





Our Ref.: شماره:

Date: تاریخ:

**Refrigeration Load Calculation for different type of  
Water Coolers**

Water cooler cabinet usually consist of a sheet metal housing built around a steel framework, inside this sheet housing there is usually a condensing unit, located near the floor, and above this is the water-cooling mechanism. The latter is the only part insulated (foamed plastic) from the room. The insulation is usually specially formed and between one and one half inches and two inches thick. These cabinets are made in such a way that one or more sides may be easily removed to gain access to the interior. The basin of the water cooler is generally made of porcelain-coated cast iron, porcelai coated - steel, or stainless steel. Heat exchangers are frequently used on water coolers. These make use of the low temperature of waste water and the suction line to pre-cool the fresh water line to the evaporator coil.

Self-cooler are of two types,

- 1- Bottle Type.
- 2- Tap water type

The bottle cooler usually uses a 20 to 25 liter bottle of water inverted on the top of the cabinet. Overflow and drain water are stored in a container built the cabinet. These coolers use air-cooled condensing units exclusively. They are used where water and drains are not available or where available the plumbing insulation may be expensive.

Water cooler using a plumbing supply and drain connection, must be installed according the relevant approved standards. The plumbing should be concealed, a hand shutoff valve should be installed in the fresh water line. Drain pipe at least 1 inches in diameter provided, and rubber opening must be above the drain in such a way as to eliminate the chance for accidental siphoning of the drain water back into the fresh water system. The tap water models use variety of evaporator coil wrapped around the water-cooling tank.

Temperatures of the cooling water are variable depending on the persons who are drinking the water. We consider 10 C for the temperature of drinking water, while our inlet temperature is considered 24 C.





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

In large business establishment, in office buildings, or in factories, multiple water cooler, instead of individual ones, are popular. These

coolers have one large condensing unit supplying many bubbles and these may be of many different types.

Water cooler is a device that usually is used in the public area to supply cold drinking water to the customers and different people. The appliance is mainly used in the Airports, Railways Station, Coach Terminals, Banks, Offices, Parks, and etc. therefore, it is hard to specify an standard for cold water consumption during the day from the water cooler.

We consider three refrigeration load components that should be taken into our consideration.

- 1- Heat gain by heat transmission from, main water storage tank wall insulation.
- 2- Heat removed from water entering to the water tank at the initial refrigeration system operating condition, (water stored in storage tank during the night, with normal ambient temperature) which is divided by 24 hrs.
- 3- Heat removed from Drinking Water flow that are consumed during designated operating hours " $\dot{M}$ "

The problem of determining the refrigeration load of a water-cooled installation is basically a specific heat and heat leakage problem combination. The water is cooled to temperature which vary upward from about 4 degree centigrade , and the amount heat removed from the water to cool it to a predetermined temperature is simple specific heat problem. The water, being maintained at these low temperature, results in a heat leakage from room into the water, and this part involves the heat leakage portion of installation.

$$Q_1 = m C \Delta T, \text{ Where:}$$

SMEC for Ghandil Company,  
C:\My documents\GHANDIL First Report\





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO. LTD.

Our Ref.: شماره:

Date: تاریخ:

$Q_1$  Total heat removed from total drinking water tank volume capacity (lit.) during specific period, related to compressor cooling capacity power in Watts, at initial compressor start up, and early in the morning. When the water temperature is 30 C.

$m$  total weight of water in the water cooler storage tank in Kg.  
Considering that one liter of water at 24 C is equal to approximately one Kg.

$C$  Specific heat factor of water in Kcal/Kg °C

$\Delta T$  Temperature difference ( $T_i - T_c$ ), where,  $T_i$  is inlet water temperature, and  $T_c$  is final cooled water.

$$Q_2 = \dot{M} C \Delta T$$

$Q_2$  Total heat removed from total drinking water flow (lit.) during specific period, 16 hours. In Kcal.

$\dot{M}$  total weight of water flow during 16 hours. in Kg.

$C$  Specific heat factor of water in Kcal/Kg °C

$T$  Temperature difference ( $T_i - T_c$ ), where,  $T_i$  is inlet water temperature, and  $T_c$  is final cooled water temperature.

$$Q_3 = UA \Delta T$$

Where:

$Q_3$  Total Leak, gained through side wall of drinking water storage tank by conduction in Kcal..

$U$  Heat Resistance Coefficient Factor in Kcal/Sq. mt. C

$A$  Total Area which heat is transmitted by. In Sq. Mt.

$\Delta T$  Temperature difference ( $T_a - T_c$ ), where,  $T_a$  is ambient temperature, and  $T_c$  is final cooled water temperature.







شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

**Refrigeration Load Calculation**  
**Double Door Up-Right Refrigerator and Freezer**

**Model Ghandil RF16**

a) Transmission load calculation

Insulation Type: Pu Foam with R141b blowing agent.

Thermal Conductivity for Foam = 0.0175 W/ mt. °C

Ambient Temperature = 32 °C

Refrigerator Air Temperature = +4 °C

Temperature Difference Refrigerator Compartment:

$$\Delta T = 32 - (+4) = 28 \text{ °C}$$

Freezer Air Temperature = -18 °C

Temperature Difference Freezer Compartment:

$$\Delta T = 32 - (-18) = 50 \text{ °C}$$

Thicknesses of ABS type inner liner and still panel sheet have been neglected.

**Freezer Compartment**

Freezer Compartment	Dimension Cm.	Area (sq.mt.)	Insulation Thickness	Temp. Difference
Side Walls	2 x (55x65)	0.72	60 mm	50 c
Back Panel	65x55	0.36	60 mm	60 c
Top Panel	58x66	0.39	60 mm	50 c
Door	66x56	0.36	60 mm	50 c
Bottom Panel	58x66	0.39	60 mm	14 c

SMEC for Ghandil Company.  
C:\My documents\GHANDIL\First Report

تهران، خیابان شریعی، بالاتر از میرداماد ساختمان ۱۲۸۰ آپارتمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۲۲۵۰۳۳۰، ۲۲۷۴۹۳۶، ۲۲۷۴۹۳۶  
No 12, Building 1280, Shariati Ave., Tehtan 19558 Iran. Tel.: +98 21 225 03 30 Tel.Fax: +98 21 227 49 36  
e.mail, sahandmina@hotmail.com





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

### Calculation :

#### Heat Leak For Freezer Compartment.

$$Q_{TL} = Q_{SW} + Q_{Back\ Panel} + Q_{door} + Q_{Bottom} + Q_{top}$$

$$Q = U A (T_a - T_r) \text{ Watt}$$

$$U = \frac{1}{X_1 / K_1} = 1 / (0.060 / 0.175) = 0.29 \text{ W/ sq.m } ^\circ\text{C}$$

Where :

U = Heat Resistance Coefficient Factor

K<sub>1</sub> = Foam Thermal Conductivity = 0.0175 for R141b blowing agent

foam

$$1- Q_{SideWalls} = [U A (T_a - T_r)]$$

T<sub>a</sub> = Ambient Temperature 32

T<sub>r</sub> = refrigerator air Temperature -18

$$U = 1 / (0.060 / 0.0175) = 0.29 \text{ W/ sq.m } ^\circ\text{C}$$

A = 0.72 Sq. Mt., T<sub>a</sub> = 32 °C, T<sub>r</sub> = -18 °C

$$Q_{SideWalls} = 0.29 \times 0.72 \times 50 = 10.4 \text{ Watts}$$

$$2- Q_{doors} = [U A (T_a - T_r)]$$

$$U = 1 / [(0.060 / 0.0175)] = 0.29 \text{ W/ sq.m } ^\circ\text{C},$$

T<sub>a</sub> - T<sub>r</sub> = 50, A = 0.36,

$$Q_{doors} = 0.29 \times 0.36 \times 50 = 5.2 \text{ Watts}$$

$$3- Q_{top} = [U A (T_a - T_r)]$$

U = 0.29 w/sq. Mt. °C,

T<sub>a</sub> - T<sub>r</sub> = 50, A = 0.39

$$Q_{top} = 0.29 \times 0.39 \times 50 = 5.6 \text{ Watts}$$

SMEC for Ghandil Company.  
C:\My documents\GHANDIL\First Report\





Our Ref.: شماره:

Date: تاریخ:

$$4 - Q_{\text{back panel}} = [U A (T_a - T_r)]$$

$$U = 0.29 \text{ w/sq. Mt. } ^\circ\text{C,}$$

$$T_a - T_r = 60, A = 0.0.36$$

$$Q_{\text{back panel}} = 0.29 \times 0.36 \times 60 = 6.3 \text{ Watts}$$

$$5 - Q_{\text{Bottom}} = [U A (T_a - T_r)]$$

$$U = 0.22 \text{ w/sq. Mt. } ^\circ\text{C,}$$

$$T_a - T_r = 14, A = 0.39$$

$$Q_{\text{Bottom Surface}} = 0.29 \times 0.39 \times 14 = 1.6 \text{ Watt}$$

Heat Leak For Freezer Compartment.

$$Q_{TL} = Q_{SW} + Q_{\text{Back Panel}} + Q_{\text{door}} + Q_{\text{Bottom}} + Q_{\text{top}} = 29.1$$

### Heat Leak For Refrigerator Compartment.

Refrigerator Compartment	Dimension Cm.	Area (sq.mt.)	Insulation Thickness	Temp. Difference
Side Walls	2 x (125x60)	1.5	40 mm	28 c
Back Panel	65x125	0.81	40 mm	38 c
Door	65x125	0.81	40 mm	28 c
Bottom Panel	60x65	0.39	40 mm	28 c

$$Q = U A (T_a - T_r) \text{ Watt}$$

$$U = \frac{1}{X_1 / K_1} = 1 / (0.040 / 0.175) = 0.43 \text{ W/sq.m } ^\circ\text{C}$$

Where :

U = Heat Resistance Coefficient Factor

K<sub>1</sub> = Foam Thermal Conductivity = 0.0175 for R141b blowing agent foam

$$1 - Q_{\text{SideWalls}} = [U A (T_a - T_r)]$$

T<sub>a</sub> = Ambient Temperature 32

T<sub>r</sub> = refrigerator air Temperature 4





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref: شماره:

Date: تاریخ:

$$U = 1 / (0.040 / 0.0175) = 0.43 \text{ W/ sq.m } ^\circ\text{C}$$

$$A = 1.5 \text{ Sq. Mt.}, T_a = 32 \text{ } ^\circ\text{C}, T_r = +4 \text{ } ^\circ\text{C}$$

$$Q_{\text{SideWalls}} = 0.43 \times 1.5 \times 28 = 18.1 \text{ Watts}$$

$$2- Q_{\text{doors}} = [U A (T_a - T_r)]$$

$$U = 1 / [(0.040 / 0.0175)] = 0.43 \text{ W/ sq.m } ^\circ\text{C},$$

$$T_a - T_r = 28, A = 0.81,$$

$$Q_{\text{doors}} = 0.43 \times 0.81 \times 28 = 9.7 \text{ Watts}$$

$$4 - Q_{\text{back panel}} = [U A (T_a - T_r)]$$

$$U = 0.43 \text{ w/sq. Mt. } ^\circ\text{C},$$

$$T_a - T_r = 38, A = 0.81$$

$$Q_{\text{back panel}} = 0.43 \times 0.81 \times 38 = 13.2 \text{ Watts}$$

$$5 - Q_{\text{Bottom}} = [U A (T_a - T_r)]$$

$$U = 0.43 \text{ w/sq. Mt. } ^\circ\text{C},$$

$$T_a - T_r = 28, A = 0.39$$

$$Q_{\text{Bottom Surface}} = 0.43 \times 0.39 \times 28 = 4.7 \text{ Watt}$$

Total Refrigerator Heat Leak = 45.7 W

**Total Transmission Heat Load Through Refrigerator and Freezer Compartment  
by Conduction through side walls = 29.1 + 45.7 = 74.8**

### **Product Load**

A product placed in a refrigerator at a temperature higher than the storage temperature will lose heat until it reaches the storage temperature. The quantity of heat to be removed may be calculated from knowledge of the product, including its state upon entering the refrigerator, its final state, its weight, specific heat above and below freezing point, its freezing temperature and latent heat.

SMEC for Ghandil Company,  
C:\My documents\GHANDIL\First Report

تهران، خیابان شریعی، بالاتر از میرداماد ساختمان ۱۲۸۰ آپارتمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۲۲۵۰۳۳۰۰ ۲۲۷۴۹۳۶ نمابر: ۲۲۷۴۹۳۶  
No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel.Fax: +98 21 227 49 36  
e.mail, sahandmina@hotmail.com





شرکت مهندسی سهند مینا (با مسئولیت محدود)  
SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

When a definite weight of product is cooled from one state and temperature to another state and temperature, some or all of the following calculations must be made:

Heat removal from initial temperature to some lower temperature above freezing.

$$Q = mc(T_1 - T_2)$$

Heat removal from initial temperature to freezing point of product.

$$Q = mc(T_1 - T_f)$$

Heat removal to freeze product.

$$Q = mh_f$$

Heat removal from freezing point to final temperature below freezing.

$$Q = mc(T_f - T_3)$$

Where

Q = heat removed, Kj

M = weight of product, kg

C = specific heat of product above freezing point, Kj/Kg. K

T<sub>1</sub> = initial temp. C

T<sub>2</sub> = lower temperature above freezing, C

T<sub>f</sub> = freezing temperature of product, C

H<sub>f</sub> = latent heat of fusion, kj per kg

We suppose that 20 Kgs of normal water (25 C) must be kept frozen for 24 hours at Freezing point -18 C, therefore, we calculate as follow,

$$Q_1 = mc(T_1 - T_2)$$

Q<sub>1</sub> = heat removal of water above freezing point

M = 20 kg

C = 4.23 j/g K

T<sub>1</sub> = 25 C

T<sub>2</sub> = 0 C

$$Q_1 = 20000 \times 4.23 \times (25 - 0) = 2115000 \text{ jul} / 86400 = 24.4 \text{ Watt}$$

$$Q_2 = mc(T_1 - T_2)$$

Q<sub>2</sub> = heat removal of ice below freezing point

SMEC for Ghandil Company.  
C:\My documents\GHANDIL First Report\





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

$$M = 20 \text{ kg}$$

$$C = 2.10 \text{ j/g K}$$

$$T_1 = 0 \text{ C}$$

$$T_2 = -18 \text{ C}$$

$$Q_1 = 20000 \times 2.10 \times [(0 - (-18))] = 756000 \text{ jul} / 86400 = 8.8 \text{ Watt}$$

Assuming only 90% of water present freezes, a good assumption for many foods is:

1- Latent heat of Freezing:

$$334 \times 0.9 = 300.6 \text{ kJ/kg}$$

2- Sensible heat to cool the ice:

$$2.10 \times 18 = 37.8 \text{ kJ/kg}$$

3- Sensible heat to cool unfrozen water:

$$4.23 \times 0.1 \times 18 = 7.6 \text{ kJ/kg}$$

4- Sensible heat to cool non-aqueous material, 25% of material is non-aqueous

$$(0.25 \times 0.84) 18 = 3.9 \text{ kJ/kg}$$

$$\text{Total} = 349900 \text{ J/kg}$$

$$Q_{\text{total}} = 349900 \times 20 = 3499000 \text{ J} = 6998000 / 86400 = 81$$

### Internal Load

Door Opening

Refrigerator Internal Volume 360 lit.

Number of air change as per ASHREA standard = 20 per day

Heat removed per cubic meter of air 75000 j

$$\text{Air Change load} = 0.36 \times 20 \times 75000 / 86400 = 6.3 \text{ Watt}$$

$$Q_{\text{Total}} = Q_{\text{heat leak}} + Q_{\text{product load}} + Q_{\text{internal load}} + Q_{\text{air change}}$$

$$Q_{\text{Total}} = 74.8 + 114.2 + 6.3 = 195.3 \text{ Watts}$$

Considering 20 % of Q total for safety factor

$$Q_{\text{Grand Total}} = 195.3 + 20\%(39) = \underline{234} \text{ watts}$$

SMEC for Ghandil Company,  
C:\My documents\GHANDIL\First Report\

تهران، خیابان شریعتی، بالاتر از میرداماد ساختمان ۱۲۸۰ پارتیمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۲۲۵۰۳۳۰، ۲۲۷۴۹۳۶، ۲۲۷۴۹۳۶

No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel.Fax : +98 21 227 49 36

e.mail, sahandmina@hotmail.com





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

With respect to the above calculation we have to select a compressor of R134a with cooling capacity of approximately 197watt at  $-23.3$  degree centigrade evaporating temperature. We recommend Danfoss model SC12G oil cooled compressor with 259 watts cooling capacity at  $-23.3$  evaporating temp. ASHREA Standards, or Compressor Matsushita Model D91C21RAX5 With 227 watts cooling capacity at  $-23.3$  evaporating temp. ASHREA Standards, or Aspera Model B3119Z with 234 watts cooling capacity at  $-23.3$  evaporating temp. ASHREA Standards, or Electrolux (Zanussi) Model GL90AA with 224 watts cooling capacity at  $-23.3$  evaporating temp. ASHREA Standards. Or Necchi Model ESC 11/11K with 246 watts cooling capacity at  $-23.3$  evaporating temp. ASHREA Standards.

SMEC for Ghandil Company.  
C:\My documents\GHANDIL\First Report

تهران، خیابان شریعتی، بالاتر از میرداماد ساختمان ۱۲۸۰ آپارتمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۲۲۵۰۳۳۰، ۲۲۷۴۹۳۶، ۲۲۷۴۹۳۶ نمایر: ۲۲۷۴۹۳۶  
No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel.Fax: +98 21 227 49 36  
e.mail, sahandmina@hotmail. com





Our Ref.: شماره:

Date: تاریخ:

**Refrigeration Load Calculation**  
**Up-Right Freezer**

**Model Ghandil F11**

b) Transmission load calculation

Insulation Type: Pu Foam with R141b blowing agent.  
Thermal Conductivity for Foam = 0.0175 W/ mt. °C  
Ambient Temperature = 32 °C  
Refrigerator Air Temperature = +4 °C  
Temperature Difference Refrigerator Compartment:  
 $\Delta T = 32 - (+4) = 28 \text{ °C}$   
Freezer Air Temperature = -18 °C  
Temperature Difference Freezer Compartment:  
 $\Delta T = 32 - (-18) = 50 \text{ °C}$

**Freezer Compartment**

Freezer Compartment	Dimension Cm.	Area (sq.mt.)	Insulation Thickness	Temp. Difference
Side Walls	2 x (148x53)	1.56	60 mm	50 c
Back Panel	63x148	0.93	60 mm	60 c
Top Panel	53x63	0.33	60 mm	50 c
Door	63x148	0.93	60 mm	50 c
Bottom Panel	53x63	0.33	60 mm	60 c







Our Ref.: شماره:

Date: تاریخ:

**Calculation :**

**Heat Leak For Freezer Compartment.**

$$Q_{TL} = Q_{SW} + Q_{Back\ Panel} + Q_{door} + Q_{Bottom} + Q_{top}$$

$$Q = U A (T_a - T_r) \text{ Watt}$$

$$U = \frac{1}{\sum X_i / K_i} \text{ W/ sq.m } ^\circ\text{C}$$

Where :

U = Heat Resistance Coefficient Factor

K<sub>1</sub> = Foam Thermal Conductivity = 0.0175 for R141b blowing agent

foam

$$1- Q_{SideWalls} = [U A (T_a - T_r)]$$

T<sub>a</sub> = Ambient Temperature 32

T<sub>r</sub> = refrigerator air Temperature -18

$$U = 1 / (0.060 / 0.0175) = 0.29 \text{ W/ sq.m } ^\circ\text{C}$$

$$A = 1.56 \text{ Sq. Mt.}, T_a = 32 ^\circ\text{C}, T_r = -18 ^\circ\text{C}$$

$$Q_{SideWalls} = 0.29 \times 1.56 \times 50 = \text{Watts}$$

$$2- Q_{doors} = [U A (T_a - T_r)]$$

$$U = 1 / [(0.060 / 0.0175)] = 0.29 \text{ W/ sq.m } ^\circ\text{C},$$

$$T_a - T_r = 50, A = 0.93,$$

$$Q_{doors} = 0.29 \times 0.93 \times 50 = 13.5 \text{ Watts}$$

$$3- Q_{top} = [U A (T_a - T_r)]$$

$$U = 1 / (0.60 / 0.0175) = 0.29 \text{ w/sq. Mt. } ^\circ\text{C},$$

$$T_a - T_r = 50, A = 0.33$$

$$Q_{top} = 0.29 \times 0.33 \times 50 = 4.8 \text{ Watts}$$

$$4- Q_{back\ panel} = [U A (T_a - T_r)]$$

$$U = 0.29 \text{ w/sq. Mt. } ^\circ\text{C},$$

SMEC : for Ghandil Company,  
C:\My documents\GHANDIL First Report.





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

$$T_a - T_r = 60, A = 0.93$$

$$Q_{\text{back panel}} = 0.29 \times 0.93 \times 60 = 16.2 \text{ Watts}$$

$$5 - Q_{\text{Bottom}} = [U A (T_a - T_r)]$$

$$U = 1 / (0.60 / 0.0175) = 0.29 \text{ w/sq. Mt. } ^\circ\text{C,}$$

$$T_a - T_r = 14, A = 0.33$$

$$Q_{\text{Bottom Surface}} = 0.29 \times 0.33 \times 60 = 5.7 \text{ Watt}$$

Heat Leak For Freezer Compartment.

$$Q_{TL} = Q_{SW} + Q_{\text{Back Panel}} + Q_{\text{door}} + Q_{\text{Bottom}} + Q_{\text{top}} = 62.8$$

### Product Load

A product placed in a refrigerator at a temperature higher than the storage temperature will lose heat until it reaches the storage temperature. The quantity of heat to be removed may be calculated from knowledge of the product, including its state upon entering the refrigerator, its final state, its weight, specific heat above and below freezing point, its freezing temperature and latent heat.

When a definite weight of product is cooled from one state and temperature to another state and temperature, some or all of the following calculations must be made:

Heat removal from initial temperature to some lower temperature above freezing.

$$Q = mc(T_1 - T_2)$$

Heat removal from initial temperature to freezing point of product.

$$Q = mc(T_i - T_f)$$

Heat removal to freeze product.

$$Q = mh_f$$

Heat removal from freezing point to final temperature below freezing.

$$Q = mc(T_f - T_3)$$

Where

Q = heat removed, Kj

M = weight of product, kg

SMEC for Ghandil Company  
C:\My documents\GHANDIL\First Report\

تهران، خیابان شریعتی، بالاتر از میرداماد ساختمان ۱۲۸۰ آپارتمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۲۲۵۰۳۳۰، ۲۲۷۴۹۳۶، ۲۲۷۴۹۳۶

No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel.Fax: +98 21 227 49 36

e.mail, sahandmina@hotmail.com





شرکت مهندسی سهند مینا (با مسئولیت محدود)  
SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره :

Date: تاریخ :

C = specific heat of product above freezing point, Kj/Kg. K

T<sub>1</sub> = initial temp. C

T<sub>2</sub> = lower temperature above freezing, C

T<sub>f</sub> = freezing temperature of product, C

H<sub>if</sub> = latent heat of fusion, kj per kg

We suppose that 20 Kgs of normal water (25 C) must be kept frozen for 24 hours at Freezing point -18 C, therefore, we calculate as follow,

$$Q_1 = mc(T_1 - T_2)$$

Q<sub>1</sub> = heat removal of water above freezing point

M = 20 kg

C = 4.23 j/g K

T<sub>1</sub> = 25 C

T<sub>2</sub> = 0 C

$$Q_1 = 20000 \times 4.23 \times (25 - 0) = 2115000 \text{ jul} / 86400 = 24.4 \text{ Watt}$$

$$Q_2 = mc(T_1 - T_2)$$

Q<sub>2</sub> = heat removal of ice below freezing point

M = 20 kg

C = 2.10 j/g K

T<sub>1</sub> = 0 C

T<sub>2</sub> = -18 C

$$Q_2 = 20000 \times 2.10 \times [(0 - (-18))] = 756000 \text{ jul} / 86400 = 8.8 \text{ Watt}$$

Assuming only 90% of water present freezes, a good assumption for many foods is:

5- Latent heat of Freezing:

$$334 \times 0.9 = 300.6 \text{ kJ/kg}$$

6- Sensible heat to cool the ice:

$$2.10 \times 18 = 37.8 \text{ kJ/kg}$$

7- Sensible heat to cool unfrozen water:

$$4.23 \times 0.1 \times 18 = 7.6 \text{ kJ/kg}$$

8- Sensible heat to cool non-aqueous material, 25% of material is non-aqueous

$$(0.25 \times 0.84) \times 18 = 3.9 \text{ kJ/kg}$$

SMEC for Ghandil Company,  
C:\My documents\GHANDIL First Report





شرکت مهندسی سهند مینا (با مسئولیت محدود)  
**SAHAND MINA ENGINEERING CO.LTD.**

شماره: Our Ref.:

تاریخ: Date:

$$\text{Total} = 349900 \text{ J/kg}$$

$$Q_{\text{total}} = 349900 \times 20 = 3499000 \text{ J} = 6998000/86400 = 81$$

### Internal Load

Door Opening

Refrigerator Internal Volume 360 lit.

Number of air change as per ASHREA standard = 20 per day

Heat removed per cubic meter of air 75000 j

$$\text{Air Change load} = 0.36 \times 20 \times 75000 / 86400 = 6.3 \text{ Watt}$$

$$Q_{\text{Total}} = Q_{\text{heat leak}} + Q_{\text{product load}} + Q_{\text{internal load}} + Q_{\text{air change}}$$

$$Q_{\text{Total}} = 62.8 + 114.2 + 6.3 = 183.3 \text{ Watts}$$

Considering 20 % of Q total for safety factor

$$Q_{\text{Grand Total}} = 183 + 20\%(37) = \underline{220} \text{ watts}$$

With respect to the above calculation we have to select a compressor of R134a with cooling capacity of approximately 220 watt at - 23.3 degree centigrade evaporating temperature. We recommend Compressor Matsushita Model QA77C17GAX6 with 200 watts cooling capacity at - 23.3 evaporating temp. ASHREA Standards, or Aspera Model B3117Z with 203 watts cooling capacity at - 23.3 evaporating temp. ASHREA Standards, or Electrolux (Zanussi) Model GL80AA with 197.7 watts cooling capacity at - 23.3 evaporating temp. ASHREA Standards. Or Necchi Model ESC 9/9K with 205 watts cooling capacity at - 23.3 evaporating temp. ASHREA Standards. Or LG Model V 75 LAEG with 194 watts cooling capacity at - 23.3 evaporating temp. ASHREA Standards.

As an alternative for selecting compressor for tropical condition we could recommend to select a compressor of R134a with cooling capacity of approximately 240 watt at - 23.3

SMEC for Ghandil Company.  
C: My documents\GHANDIL\First Report





شرکت مهندسی سهند مینا (با مسئولیت محدود)

**SAHAND MINA ENGINEERING CO.LTD.**

Our Ref.: شماره:

Date: تاریخ:

degree centigrade evaporating temperature. We recommend compressor Danfoss model SC12G oil cooled compressor with 259 watts cooling capacity at - 23.3 evaporating temp. ASHREA Standards, or Compressor Matsushita Model D91C21RAX5 With 227 watts cooling capacity at - 23.3 evaporating temp. ASHREA Standards, or Aspera Model B3119Z with 234 watts cooling capacity at - 23.3 evaporating temp. ASHREA Standards, or Electrolux (Zanussi) Model GL90AA with 224 watts cooling capacity at - 23.3 evaporating temp. ASHREA Standards. Or Necchi Model ESC 11/11K with 246 watts cooling capacity at - 23.3 evaporating temp. ASHREA Standards.

SMEC for Ghandil Company,  
C:\My documents\GHANDIL\First Report

تهران، خیابان شریعتی، بالاتر از میرداماد ساختمان ۱۲۸۰ آپارتمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۰۲۳-۲۲۵۰۳۳۰، نمابر: ۲۲۷۴۹۳۶  
No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel.Fax : +98 21 227 49 36  
e.mail, sahandmina@hotmail.com





Our Ref.: شماره:

Date: تاریخ:

**Refrigeration Load Calculation**  
**Upright Refrigerator Showcase Model 160**

a) Transmission load calculation

Refrigerator Compartment	Dimension Cm.	Area (sq.mt.)	Insulation Thickness	Temp. Difference
Side Walls	2 x (80x200)	3.2	40mm	27 c
Back Panel	160x200	3.2	40mm	27 c
Bottom	80x200	1.6	40mm	27 C
Top	80x200	1.6	40mm	37 c
Doors	160x200	3.2	40mm	27 c

Insulation Type: Pu Foam with R141b blowing agent.  
Thermal Conductivity for Foam = 0.0180 W/ mt. ° C  
Temperature Difference Refrigerator Compartment:  
 $\Delta T = 32 - (+5) = 27 \text{ }^\circ \text{C}$   
Ambient Temperature = 32 °C  
Refrigerator Air Temperature = +5 °C

Calculation :

Heat Leak For Refrigerator Compartment.

$$Q_{TL} = Q_{SW} + Q_{\text{Back Panel}} + Q_{\text{door}} + Q_{\text{Bottom}} + Q_{\text{top}}$$

$$Q = U A (T_a - T_r)$$

$$U = \frac{1}{\sum X_i / K_i}$$

Where :

U = Heat Resistance Coefficient Factor

K<sub>1</sub> = Foam Thermal Conductivity





شرکت مهندسی سهند مینا (با مسئولیت محدود)  
SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

Due to the short thickness of cabinet out side panel ( 0.6 mm ) and plastic inner liner ( 1.5 mm ) heat resistance of these materials have been considered negligible.

Therefore:

$$1- Q_{SideWalls} = [ U A ( T_a - T_r ) ]$$

$T_a$  = Ambient Temperature 32

$T_r$  = refrigerator air Temperature 5

$$U = 1 / ( 0.040 / 0.0180 ) = 0.45 \text{ W/ sq.m } ^\circ\text{C}$$

$$A = 3.2 \text{ Sq. Mt.}, T_a = 32 \text{ } ^\circ\text{C}, T_r = + 5 \text{ } ^\circ\text{C}$$

therefore

$$Q_{SideWalls} = 0.45 \times 3.2 \times 27 = 39 \text{ Watts}$$

$$Q_{SideWalls} = 39 \text{ Watts}$$

$$2- Q_{doors} = [ U A ( T_a - T_r ) ]$$

$$U = 1 / [( 0.040 / 0.018 ) ] = 0.45 \text{ W/ sq.m } ^\circ\text{C}, T_a - T_r = 27, A = 3.2,$$

$$Q_{doors} = 0.45 \times 3.2 \times 27 = 39 \text{ Watts } Q_{doors} = 39 \text{ Watts}$$

$$3- Q_{top} = [ U A ( T_a - T_r ) ]$$

$$U = 0.45 \text{ w/sq. Mt. } ^\circ\text{C},$$

$$T_a - T_r = 37, A = 1.6$$

$$Q_{top} = 0.45 \times 1.6 \times 37 = 26.6 \text{ Watts}$$

$$Q_{top} = 26.6 \text{ Watts}$$

$$4 - Q_{back panel} = [ U A ( T_a - T_r ) ]$$

$$U = 0.45 \text{ w/sq. Mt. } ^\circ\text{C},$$

$$T_a - T_r = 27, A = 3.2$$

$$Q_{back panel} = 0.45 \times 3.2 \times 27 = 39 \text{ Watts}$$

$$Q_{back panel} = 39 \text{ Watts}$$

$$5 - Q_{Bottom} = [ U A ( T_a - T_r ) ]$$

$$U = 0.45 \text{ w/sq. Mt. } ^\circ\text{C},$$

$$T_a - T_r = 27, A = 1.6$$

$$Q_{Bottom Surface} = 0.45 \times 1.6 \times 27 = 19.4 \text{ Watt}$$

$$Q_{Bottom Surface} = 19.4 \text{ Watts}$$

SMEC for Ghandil Company,  
C:\My documents\GHANDIL\First Report

تهران، خیابان شریعتی، بالاتر از میرداماد ساختمان ۱۲۸۰ آبارتمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۲۲۵۰۳۳۰۰، ۲۲۷۴۹۳۶، ۲۲۷۴۹۳۶

No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel.Fax: +98 21 227 49 36  
e.mail, sahandmina@hotmail. com





شرکت مهندسی سهند مینا (با مسئولیت محدود)  
**SAHAND MINA ENGINEERING CO.LTD.**

Our Ref.: شماره:

Date: تاریخ:

Total Refrigerator Heat Leak = 39 + 39 + 26.6 + 19.4 + 39 = 163 W

### Product Load

A product placed in a refrigerator at a temperature higher than the storage temperature will lose heat until it reaches the storage temperature. The quantity of heat to be removed may be calculated from knowledge of the product, including its state upon entering the refrigerator, its final state, its weight, specific heat above and below freezing point, its freezing temperature and latent heat.

When a definite weight of product is cooled from one state and temperature to another state and temperature, some or all of the following calculations must be made:

Heat removal from initial temperature to some lower temperature above freezing.

$$Q = mc(T_1 - T_2)$$

Heat removal from initial temperature to freezing point of product.

$$Q = mc(T_1 - T_f)$$

Heat removal to freeze product.

$$Q = mh_f$$

Heat removal from freezing point to final temperature below freezing.

$$Q = mc(T_f - T_3)$$

Where

Q = heat removed, Kj

M = weight of product, kg

C = specific heat of product above freezing point, Kj/Kg. K

T<sub>1</sub> = initial temp. C

T<sub>2</sub> = lower temperature above freezing, C

T<sub>f</sub> = freezing temperature of product, C

H<sub>f</sub> = latent heat of fusion, kj per kg

Since this product is mainly used for storing fresh Lamb meet and beef above

SMEC for Ghandil Company,  
C. My documents-GHANDIL First Report

تهران، خیابان شریعتی، بالاتر از میرداماد ساختمان ۱۲۸۰ آبارتمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۲۲۵۰۳۳۰، ۲۲۷۴۹۳۶، نمابر: ۲۲۷۴۹۳۶  
No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel.Fax: +98 21 227 49 36  
e.mail, sahandmina@holmail. com







شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

freezing point at +5 C, we consider 600 Kg of meet to be stored in this refrigerator therefore we calculate as follow,

$$Q = mc(T_1 - T_2)$$

$$M = 600 \text{ kg}$$

$$C = 0.67 \text{ Btu/(lb)F deg} = 0.67 \times 4.184 = 2.8 \text{ j/g K}$$

$$T_1 = 25 \text{ C}$$

$$T_2 = 5 \text{ C}$$

$$Q = 600000 \times 2.8 \times (25 - 5) = 33600000 \text{ jul} / 86400 = 389 \text{ Watt}$$

Internal Load

Motor Fan 16 Watt

Door Opening

Refrigerator Internal Volume 1200 lit.

Number of air change as per ASHREA standard = 70 per day

Heat removed per cubic meter of air 75000 j

$$\text{Air Change load} = 1.2 \times 70 \times 75000 / 86400 = 72.9 \text{ Watt}$$

$$Q_{\text{Total}} = Q_{\text{heat leak}} + Q_{\text{product load}} + Q_{\text{internal load}} + Q_{\text{air change}}$$

$$Q_{\text{Total}} = 163 + 389 + 16 + 73 = 641$$

Considering 20 % of Q total for safety factor.

$$Q_{\text{Grand Total}} = 641 + 20\%(128) = \underline{769} \text{ watts}$$

With respect to the above calculation we have to select a compressor of R134a with cooling capacity of approximately 769watt at -15 degree centigrade evaporating temperature. We should select a compressor to be compatible with Electrolux compressor model S26TY.

SMEC for Ghandil Company,  
C:\My documents\GHANDIL\First Report.

تهران، خیابان شریعتی، بالاتر از میرداماد ساختمان ۱۲۸۰ آپارتمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۲۲۵۰۳۳۰۰، ۲۲۵۰۳۳۰۰، ۲۲۵۰۳۳۰۰، ۲۲۵۰۳۳۰۰  
No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel.Fax: +98 21 227 49 36  
e.mail, sahandmina@hotmail.com





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

## Chest Freezer Model CF-120

### a) Transmission Load Calculation

#### Dimension

	Dimension Cm.	Area (sq. mt.)	Insulation Thickness mm
Side Walls	2 x (65x85)	1.12	50
Front & Back Panel	2 x (125x85)	2.14	50
Chest Door	120 x 65	0.81	50
Bottom Floor	120 x 65	0.81	50

Insulation Type: Pu Foam R141b expanded blowing PU foam

R141b Foam Thermal Conductivity: 0.018 W /mt.C

Temperature Difference: ( $\Delta T$ ) = 32 - (-25) = 57 C

Ambient Temperature = 32 C

Freezer Air Temperature = - 25 C

Calculation :

$$Q_{TL} = Q_{side\ Walls} + Q_{Bottom} + Q_{Top}$$

$$Q = U A (T_a - T_f)$$

$$U = \frac{1}{X_1 / K_1 + X_2 / K_2 + \dots}$$

Where :

U = Heat Resistance Coefficient Factor

K<sub>1</sub> = Foam Thermal Conductivity

X<sub>1</sub> = Foam Thickness

Note : Due to the short thickness of cabinet out side panel ( 0.6 mm ) and plastic inner liner ( 1.5 mm ) heat resistance of these materials have been considered negligible. Therefore:





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

$$Q_{\text{SideWalls}} = [UA(T_a - T_f)]$$

$T_a$  = Ambient Temperature

$T_f$  = Freezer air Temperature

$$U = 1 / (0.05/0.018) = 0.36 \text{ W/ sq.m C}$$

$$A = 1.12 \text{ Sq. Mt.}$$

$$T_a = 32 \text{ C, } T_f = -25 \text{ C}$$

$$Q_{\text{SideWalls}} = 0.36 \times 1.12 \times 57 = 23 \text{ Watts}$$

$$Q_{\text{SideWalls}} = 23 \text{ Watts}$$

$$Q_{\text{Front Wall}} = [UA(T_a - T_f)]$$

$T_a$  = Ambient Temperature

$T_f$  = Freezer air Temperature

$$U = 1 / (0.050/0.018) = 0.36 \text{ W/ sq.m C}$$

$$A = 1.07 \text{ Sq. Mt.}$$

$$T_a = 32 \text{ C, } T_f = -25 \text{ C}$$

$$Q_{\text{Front Wall}} = 0.36 \times 1.07 \times 57 = 22 \text{ Watts}$$

$$Q_{\text{Front Wall}} = 22 \text{ Watts}$$

$$Q_{\text{Back panel}} = [UA(T_a - T_f)]$$

$T_a$  = Ambient Temperature

$T_f$  = Freezer air Temperature

$$U = 1 / (0.050/0.018) = 0.36 \text{ W/ sq.m C}$$

$$A = 1.07 \text{ Sq. Mt.}$$

$$T_a = 42 \text{ C, } T_f = -25 \text{ C}$$

$$Q_{\text{back panel}} = 0.36 \times 1.07 \times 57 = 22 \text{ Watts}$$

$$Q_{\text{Top}} = [UA(T_a - T_f)]$$

$T_a$  = Ambient Temperature

$T_f$  = Freezer air Temperature

$$U = 1 / (0.050/0.018) = 0.36 \text{ W/ sq.m C}$$

$$A = 0.81 \text{ Sq. Mt.}$$

$$T_a = 32 \text{ C, } T_f = -25 \text{ C}$$

$$Q_{\text{Top}} = 0.36 \times 0.81 \times 57 = 17 \text{ Watts}$$

SMEC for Ghandil Company,  
C:\My documents\GHANDIL\First Report\

تهران، خیابان شریعتی، پلازمه از میرداماد ساختمان ۱۲۸۰ آپارتمان شماره ۱۲ کد پستی ۱۹۵۵۸ تلفن: ۲۲۵۰۳۳۰۰، ۲۲۵۴۹۳۶، ۲۲۵۴۹۳۶ شماره: ۲۲۵۴۹۳۶

No 12, Building 1280, Shariati Ave., Tehran 19558 Iran. Tel.: +98 21 225 03 30 Tel.Fax: +98 21 227 49 36

e.mail, sahandmina@hotmail.com





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref.: شماره:

Date: تاریخ:

$$Q_{\text{Top}} = 17 \text{ Watts}$$

$$Q_{\text{Bottom}} = [UA(T_a - T_f)]$$

$T_a$  = Ambient Temperature

$T_f$  = Freezer air Temperature

$$U = 1/(0.050/0.018) = 0.36 \text{ W/sq.m C}$$

$$A = 0.81 \text{ Sq. Mt.}$$

$$T_a = 42 \text{ C}, T_f = -25 \text{ C}$$

$$Q_{\text{Bottom}} = 0.36 \times 0.81 \times 67 = 19 \text{ Watts}$$

Total Heat Leaks;

$$Q_{\text{TL}} = 23 + 26 + 22 + 19 + 17 = 107 \text{ watts}$$

$$Q_{\text{Total Heat Leaks}} = 107 \text{ Watts}$$

$$\text{Ice Making Capacity} = 5_{\text{Kg}} \times 1 \times (15 - 0) \times 1.163 = 87 \text{ Watts}$$

c) Heat gain through infiltration;

We consider 10% safety factor for door opening and infiltration

Heat gain by infiltration = 0.1 x (total heat leaks)

Heat gain by infiltration = 0.1 x (87) = 9 Watts

Total Cooling Capacity Required is calculated as follows;

$$Q_{\text{Grand Total}} = Q_{\text{Heat Leaks}} + Q_{\text{Ice Making}} + Q_{\text{Infiltration}}$$

$$Q_{\text{Grand Total}} = 107 + 87 + 9 = 203 \text{ Watts}$$

$$Q_{\text{Grand Total}} = 203 \text{ Watts}$$

The suitable R134a compressor should be compatible with cooling capacity of 203 watt. A compressor compatible with Electrolux model P12Fw should be selected. Or Danfoss Model SC12G with cooling capacity of 183 watts at CECOMAF Condition and 226 watts at ASHREA CONDITION.

SMEC for Ghandil Company,  
C:\My documents\GHANDIL\First Report\





شماره: Our Ref.:

تاریخ: Date:

## Chest Freezer Model CF-100

### a) Transmission Load Calculation

#### Dimension

	Dimension Cm.	Area (sq. mt.)	Insulation Thickness mm
Side Walls	2 x (58x75)	0.87	50
Front & Back Panel	2 x (125x85)	2X78=1.56	50
Chest Door	105x 0.58	0.61	50
Bottom Floor	105X0.58	0.810.61	50

Insulation Type: Pu Foam R141b expanded blowing PU foam

R141b Foam Thermal Conductivity: 0.018 W /mt.C

Temperature Difference: ( $\Delta T$ ) = 32 - (-18) = 50 C

Ambient Temperature = 32 C

Freezer Air Temperature = - 18 C

Calculation :

$$Q_{TL} = Q_{side\ Walls} + Q_{Bottom} + Q_{Top}$$

$$Q = U A (T_a - T_f)$$

$$U = \frac{1}{X_1 / K_1 + X_2 / K_2 + \dots}$$

Where :

U = Heat Resistance Coefficient Factor

K<sub>1</sub> = Foam Thermal Conductivity

X<sub>1</sub> = Foam Thickness

$$Q_{SideWalls} = [U A (T_a - T_f)]$$

T<sub>a</sub> = Ambient Temperature

T<sub>f</sub> = Freezer air Temperature





Our Ref: شماره:

Date: تاریخ:

$$U = 1 / (0.05/0.0175) = 0.34 \text{ W/ sq.m C}$$

$$A = 0.87 \text{ Sq. Mt.}$$

$$T_a = 32 \text{ C, } T_f = -18 \text{ C}$$

$$Q_{\text{SideWalls}} = 0.34 \times 0.87 \times 50 = 14.8 \text{ Watts}$$

$$Q_{\text{SideWalls}} = 14.8 \text{ Watts}$$

$$Q_{\text{Front Wall}} = [U A (T_a - T_f)]$$

$$T_a = \text{Ambient Temperature}$$

$$T_f = \text{Freezer air Temperature}$$

$$U = 1 / (0.050/0.0175) = 0.34 \text{ W/ sq.m C}$$

$$A = 0.78 \text{ Sq. Mt.}$$

$$T_a = 32 \text{ C, } T_f = -18 \text{ C}$$

$$Q_{\text{Front Wall}} = 0.34 \times 0.78 \times 50 = 13.3 \text{ Watts}$$

$$Q_{\text{Front Wall}} = 13.3 \text{ Watts}$$

$$Q_{\text{Back panel}} = [U A (T_a - T_f)]$$

$$T_a = \text{Ambient Temperature}$$

$$T_f = \text{Freezer air Temperature}$$

$$U = 1 / (0.050/0.0175) = 0.34 \text{ W/ sq.m C}$$

$$A = 0.78 \text{ Sq. Mt.}$$

$$T_a = 42 \text{ C, } T_f = -18 \text{ C}$$

$$Q_{\text{back panel}} = 0.34 \times 0.78 \times 60 = 15.9 \text{ Watts}$$

$$Q_{\text{Top}} = [U A (T_a - T_f)]$$

$$T_a = \text{Ambient Temperature}$$

$$T_f = \text{Freezer air Temperature}$$

$$U = 1 / (0.050/0.0175) = 0.34 \text{ W/ sq.m C}$$

$$A = 0.61 \text{ Sq. Mt.}$$

$$T_a = 32 \text{ C, } T_f = -18 \text{ C}$$

$$Q_{\text{Top}} = 0.36 \times 0.61 \times 50 = \text{Watts}$$

$$Q_{\text{Top}} = 10.4 \text{ Watts}$$

$$Q_{\text{Bottom}} = [U A (T_a - T_f)]$$

$$T_a = \text{Ambient Temperature}$$





شرکت مهندسی سهند مینا (با مسئولیت محدود)

SAHAND MINA ENGINEERING CO.LTD.

Our Ref: شماره:

Date: تاریخ:

$T_f$  = Freezer air Temperature

$$U = 1 / (0.050 / 0.0175) = 0.34 \text{ W/ sq.m C}$$

$$A = 0.61 \text{ Sq. Mt.}$$

$$T_a = 32 \text{ C, } T_f = -18 \text{ C}$$

$$Q_{\text{Bottom}} = 0.34 \times 0.61 \times 50 = 10.4 \text{ Watts}$$

Total Heat Leaks;

$$Q_{\text{TL}} = 14.8 + 15.9 + 10.4 + 10.4 + 13.3 = 64.8 \text{ watts}$$

$$Q_{\text{Total Heat Leaks}} = 64.8 \text{ Watts}$$

$$\text{Ice Making Capacity} = 5_{\text{kg}} \times 1 \times (15 - 0) \times 1.163 = 87 \text{ Watts}$$

c) Heat gain through infiltration;

We consider 10% safety factor for door opening and infiltration

$$\text{Heat gain by infiltration} = 0.1 \times (\text{total heat leaks})$$

$$\text{Heat gain by infiltration} = 0.1 \times (87) = 9 \text{ Watts}$$

Total Cooling Capacity Required is calculated as follows;

$$Q_{\text{Grand Total}} = Q_{\text{Heat Leaks}} + Q_{\text{Ice Making}} + Q_{\text{Infiltration}}$$

$$Q_{\text{Grand Total}} = 64.8 + 87 + 9 = 160.8 \text{ Watts}$$

$$Q_{\text{Grand Total}} = 160.8 \text{ Watts}$$

The suitable R134a compressor should be compatible with cooling capacity of 160.8 watt. A compressor compatible with DANFOSS model FR8.5 should be selected. This model of compressor can deliver 153 watts of cooling capacity at ASHREA standard condition.



**Setting**


Test Date	Tue Feb 08-00
Hot Room Temp.	42.0 (E-E)
Hot Room Hum.	50.0% (E)
File Name	BASETYF1119-1

**Product Specification**

Refrigerator Type	
Compressor Type	AEZ1380Y
Gas Weight	R134a-230 gr
Cappil. Length	0.36-480cm
Evap. Volume	3
Condens. Length	5mm

**Test Result**


Test Time (m)	651
Work. Time (m)	412
Duty Cycle	63.3%
Energy Con.(wH)	1190.35
No. of Therm.	15
No. of Over Load	0

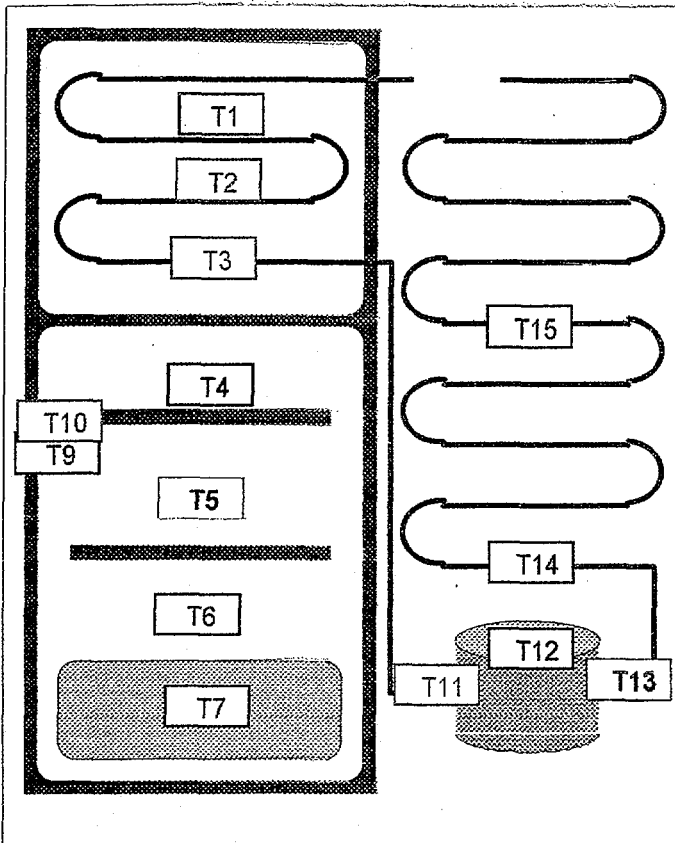

479.83

Tue Feb 08 -00

Time = 9:20

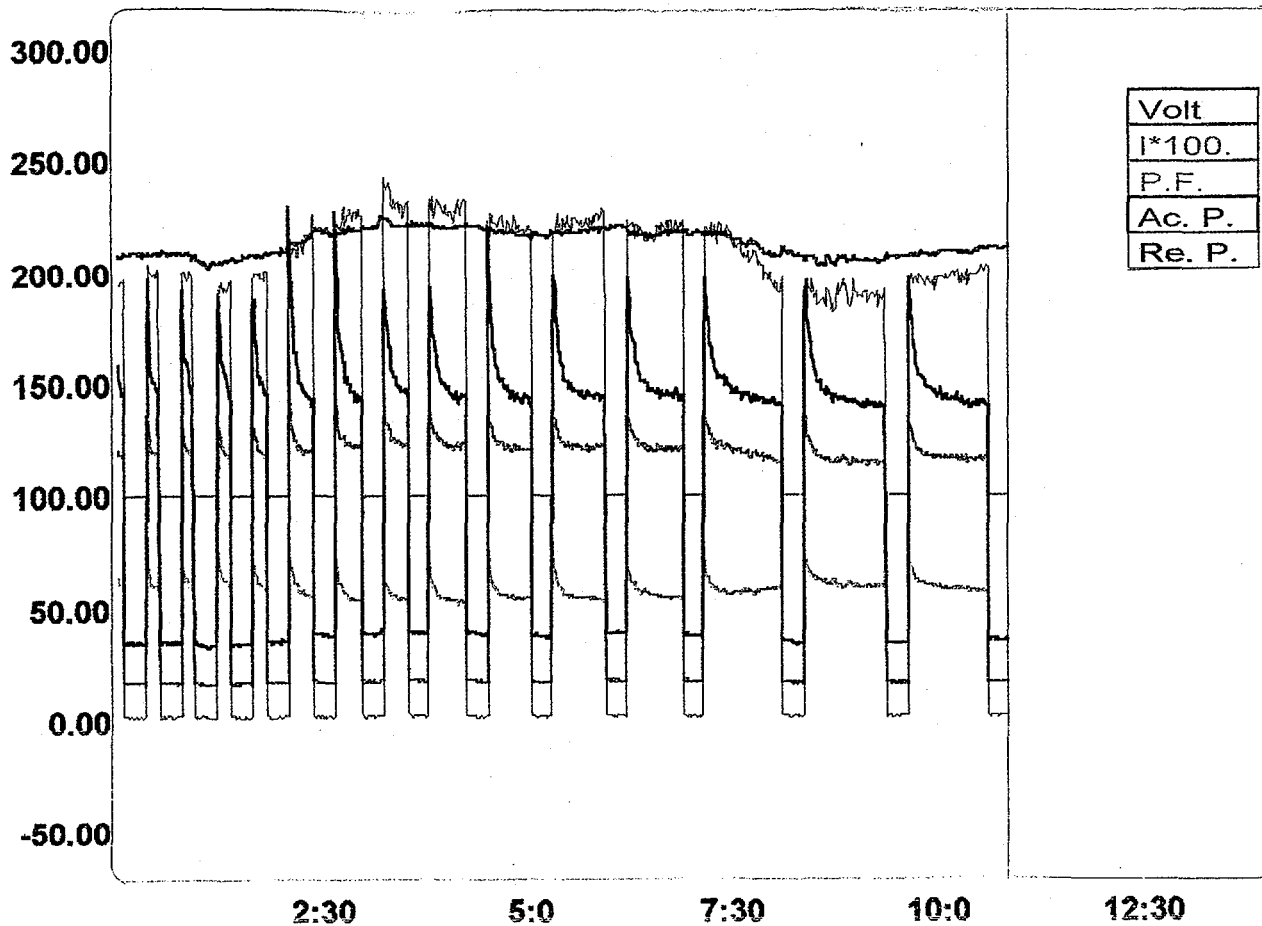



**Setting**


Test Date	Tue Feb 08-00
Hot Room Temp.	42.0 (E-E)
Hot Room Hum.	50.0% (E)
File Name	BASETYF1119-1

**Product Specification**

Refrigerator Type	
Compressor Type	AEZ1380Y
Gas Weight	R134a-230 gr
Cappil. Length	0.36-480cm
Evap. Volume	3
Condens. Length	5mm

**Test Result**


Test Time (m)	651
Work. Time (m)	412
Duty Cycle	63.3%
Energy Con.(wh)	1190.35
No. of Therm.	15
No. of Over Load	0

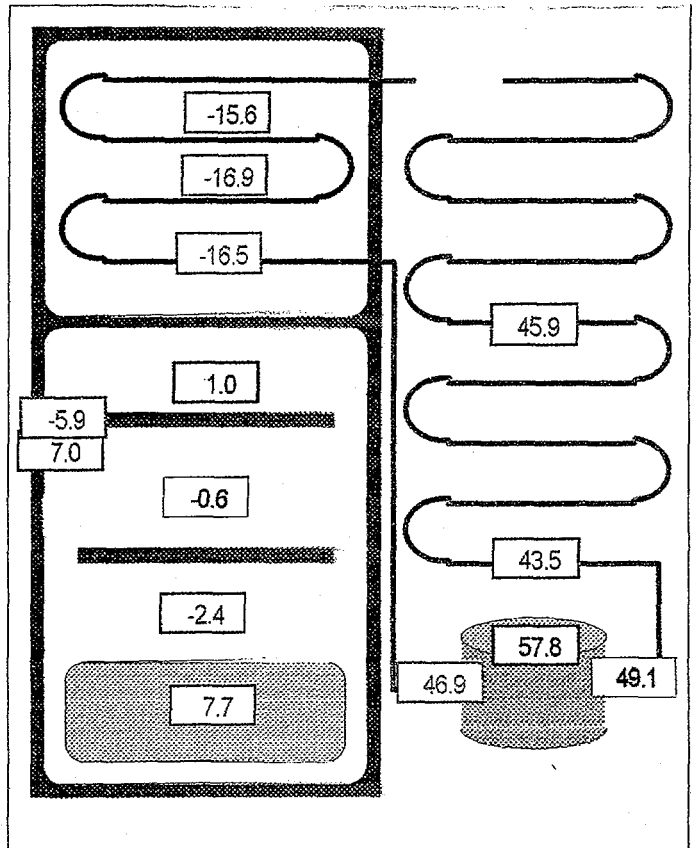

T. : 144.29

Tue Feb 08 -00

Time = 13:16

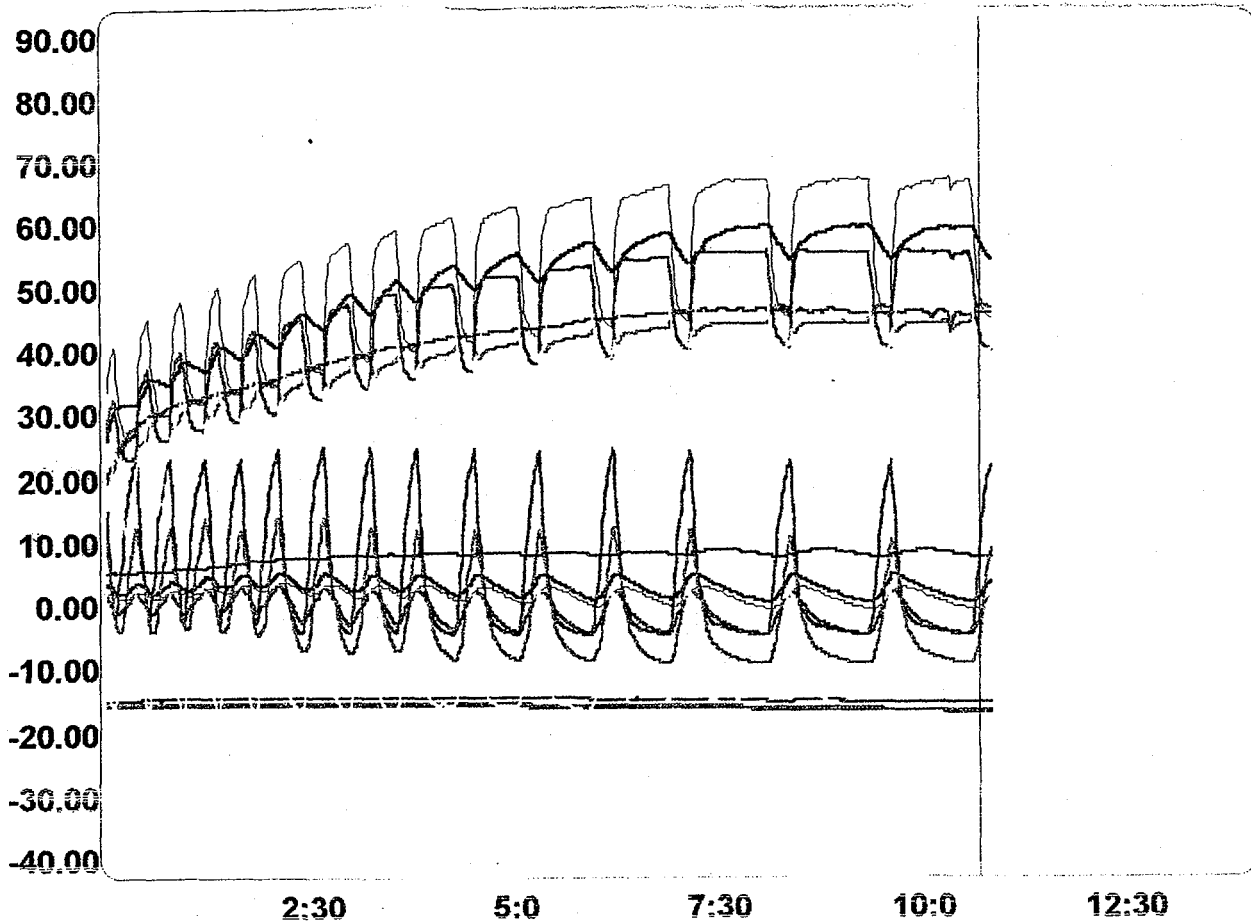

**Setting**


Test Date	Mon Oct 25-99
Hot Room Temp.	42.0 (E-E)
Hot Room Hum.	45.0% (E)
File Name	:IBASETF8-3-1

**Product Specification**

Refrigerator Type	
Compressor Type	AEZ1380Y
Gas Weight	R134a-190gr
Cappil. Length	0.31-400cm
Evap. Volume	2
Condens. Length	5mm

**Test Result**


Test Time (m)	1341
Work. Time (m)	1004
Duty Cycle	74.9%
Energy Con. (wH)	3137.63
No. of Therm.	26
No. of Over Load	0

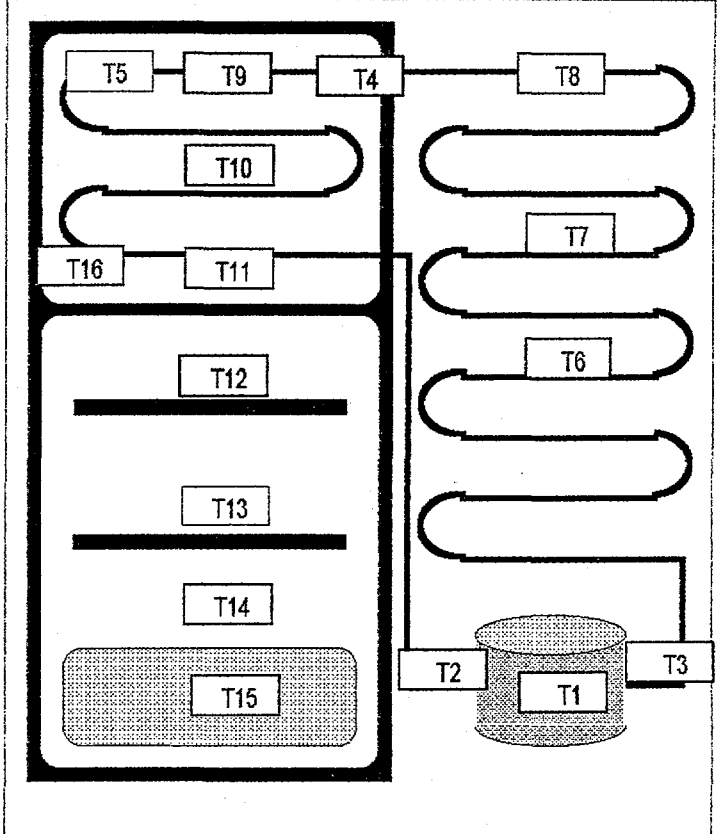

987.55

Mon Oct 25 -99

Time = 19:31

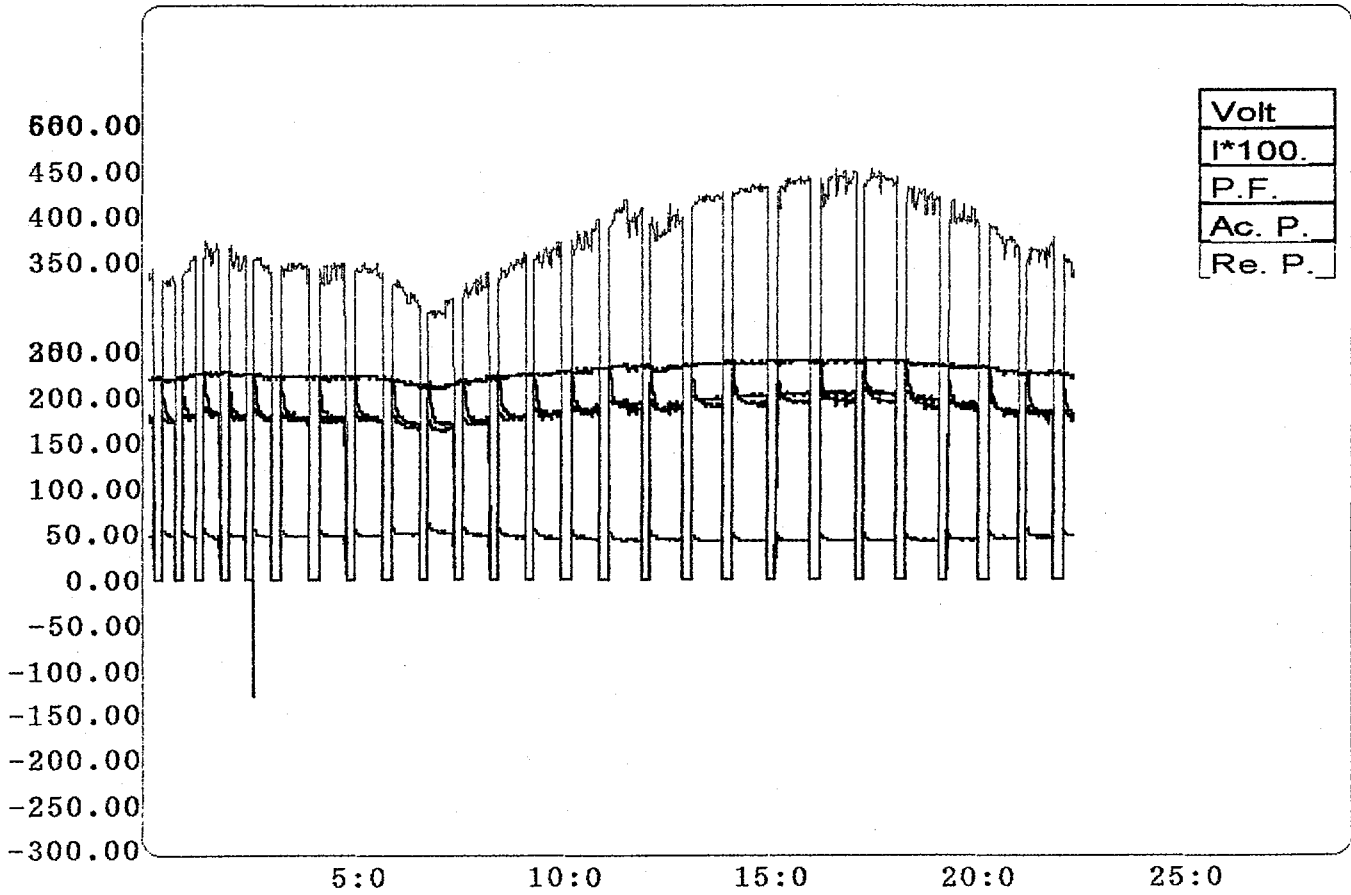

**Setting**


Test Date	Mon Oct 25-99
Hot Room Temp.	42.0 (E-E)
Hot Room Hum.	45.0% (E)
File Name	:BASET\F8-3-1

**Product Specification**

Refrigerator Type	
Compressor Type	AEZ1380Y
Gas Weight	R134a-190gr
Cappil. Length	0.31-400cm
Evap. Volume	2
Condens. Length	5mm

**Test Result**


Test Time (m)	1341
Work. Time (m)	1004
Duty Cycle	74.9%
Energy Con.(wh)	3137.63
No. of Therm.	26
No. of Over Load	0

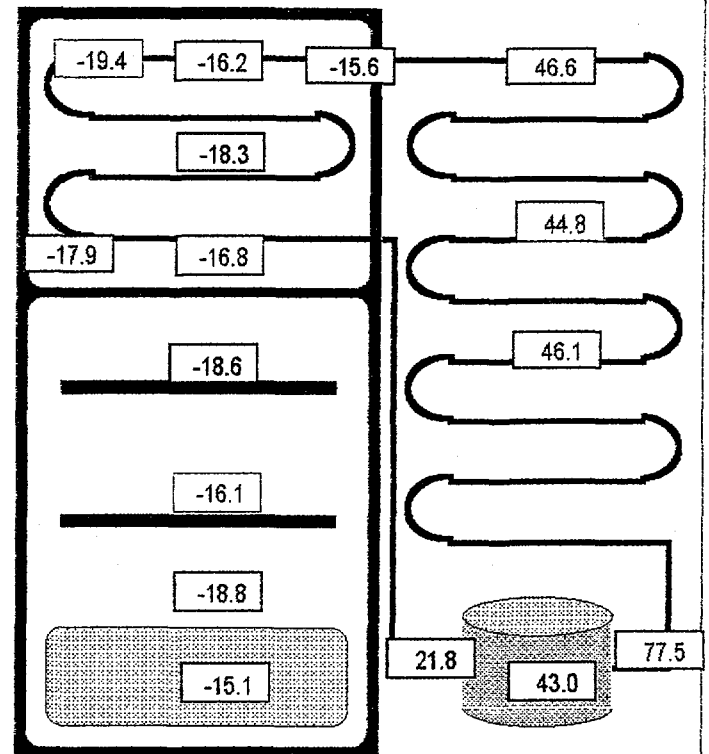

T. : 197.59

Mon Oct 25 -99

Time = 21:5

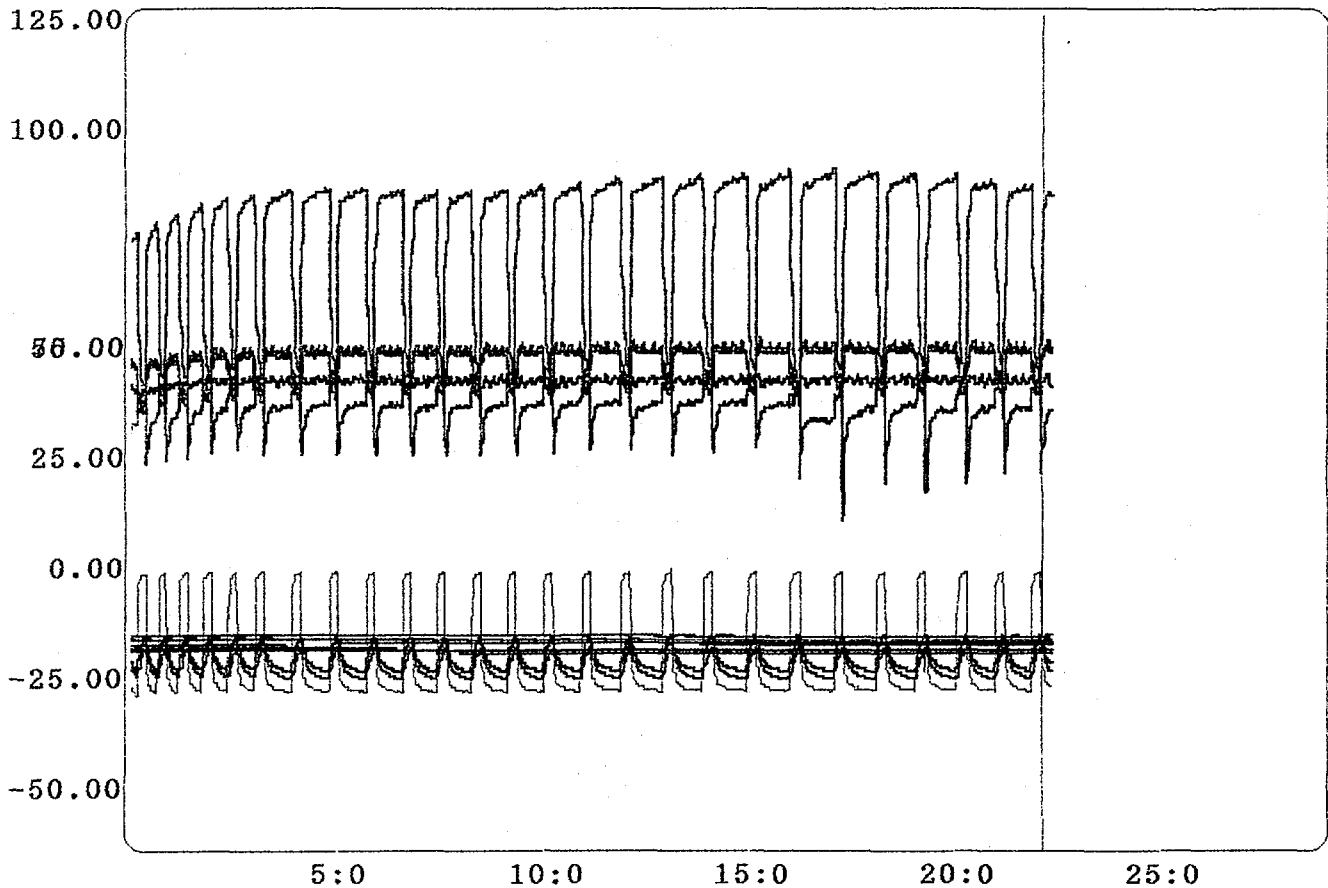

GHANDIL


# Test Sheet

F8-3-1

T1 : 48.00

Mon Oct 25 -99

Time = -3:-55

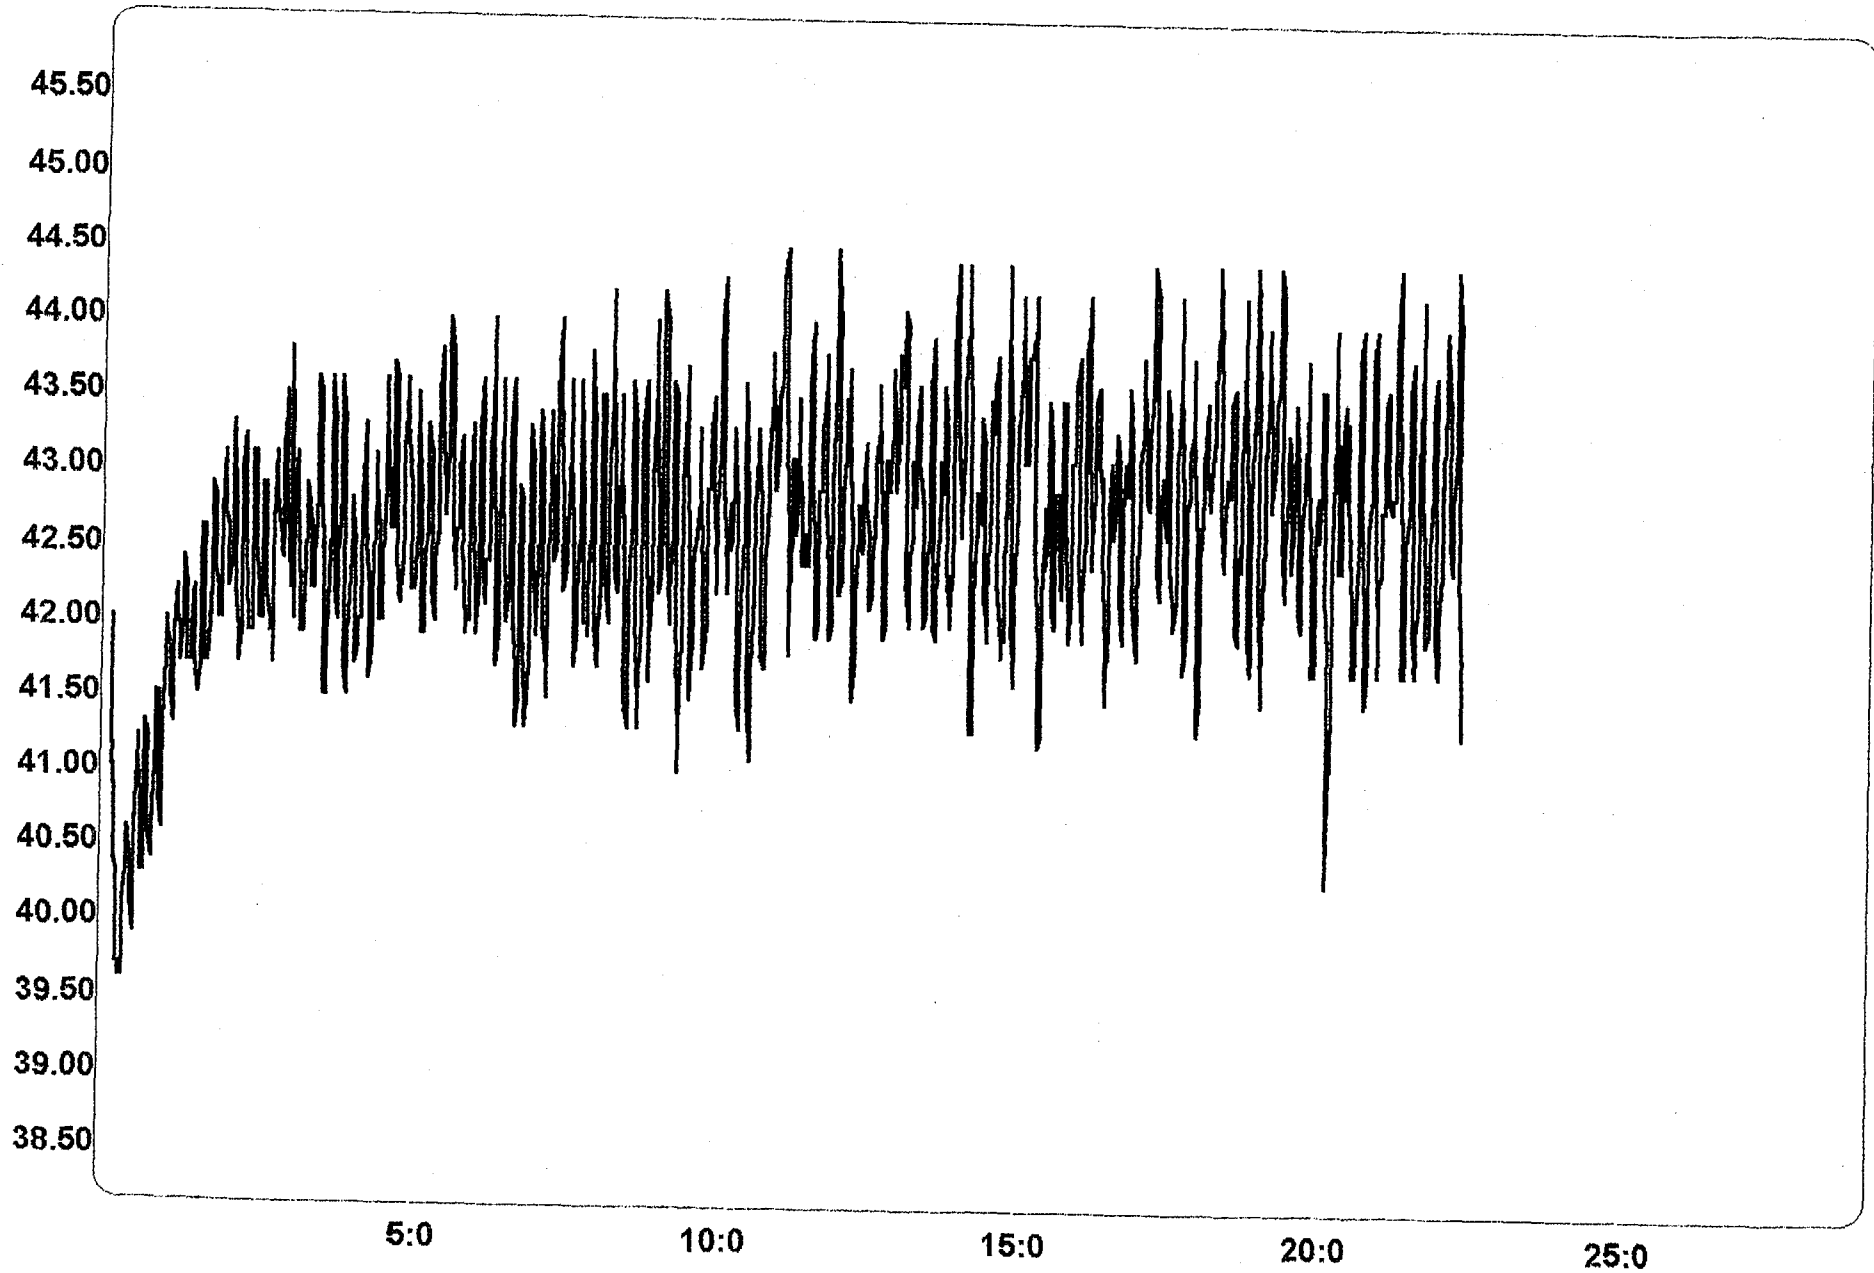

GHANDIL


# Test Sheet

F8-3-1

T2 : 30.99

Mon Oct 25 -99

Time = 9:56

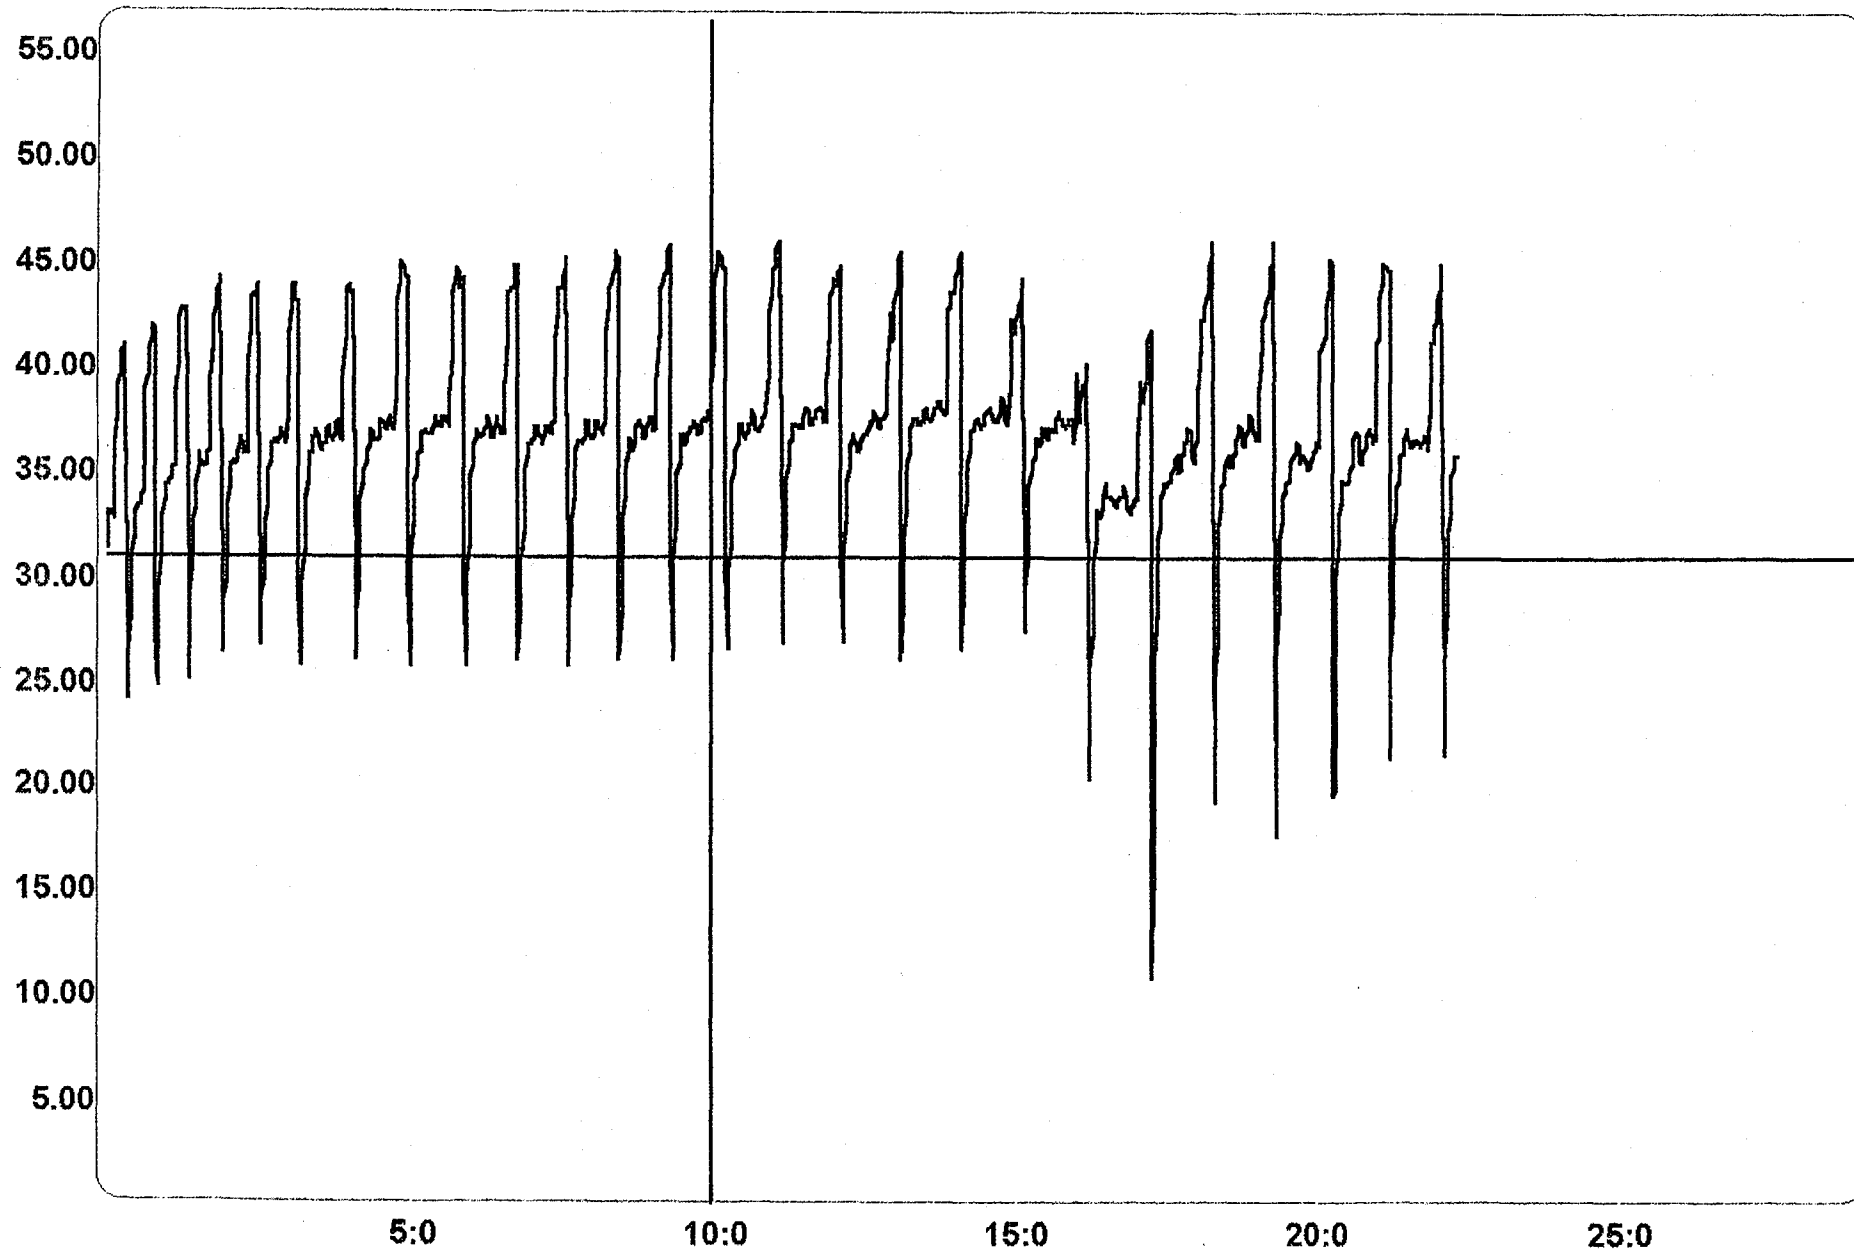

GHANDIL


# Test Sheet

F8-3-1

T3 : 130.40

Mon Oct 25 -99

Time = -3:-55

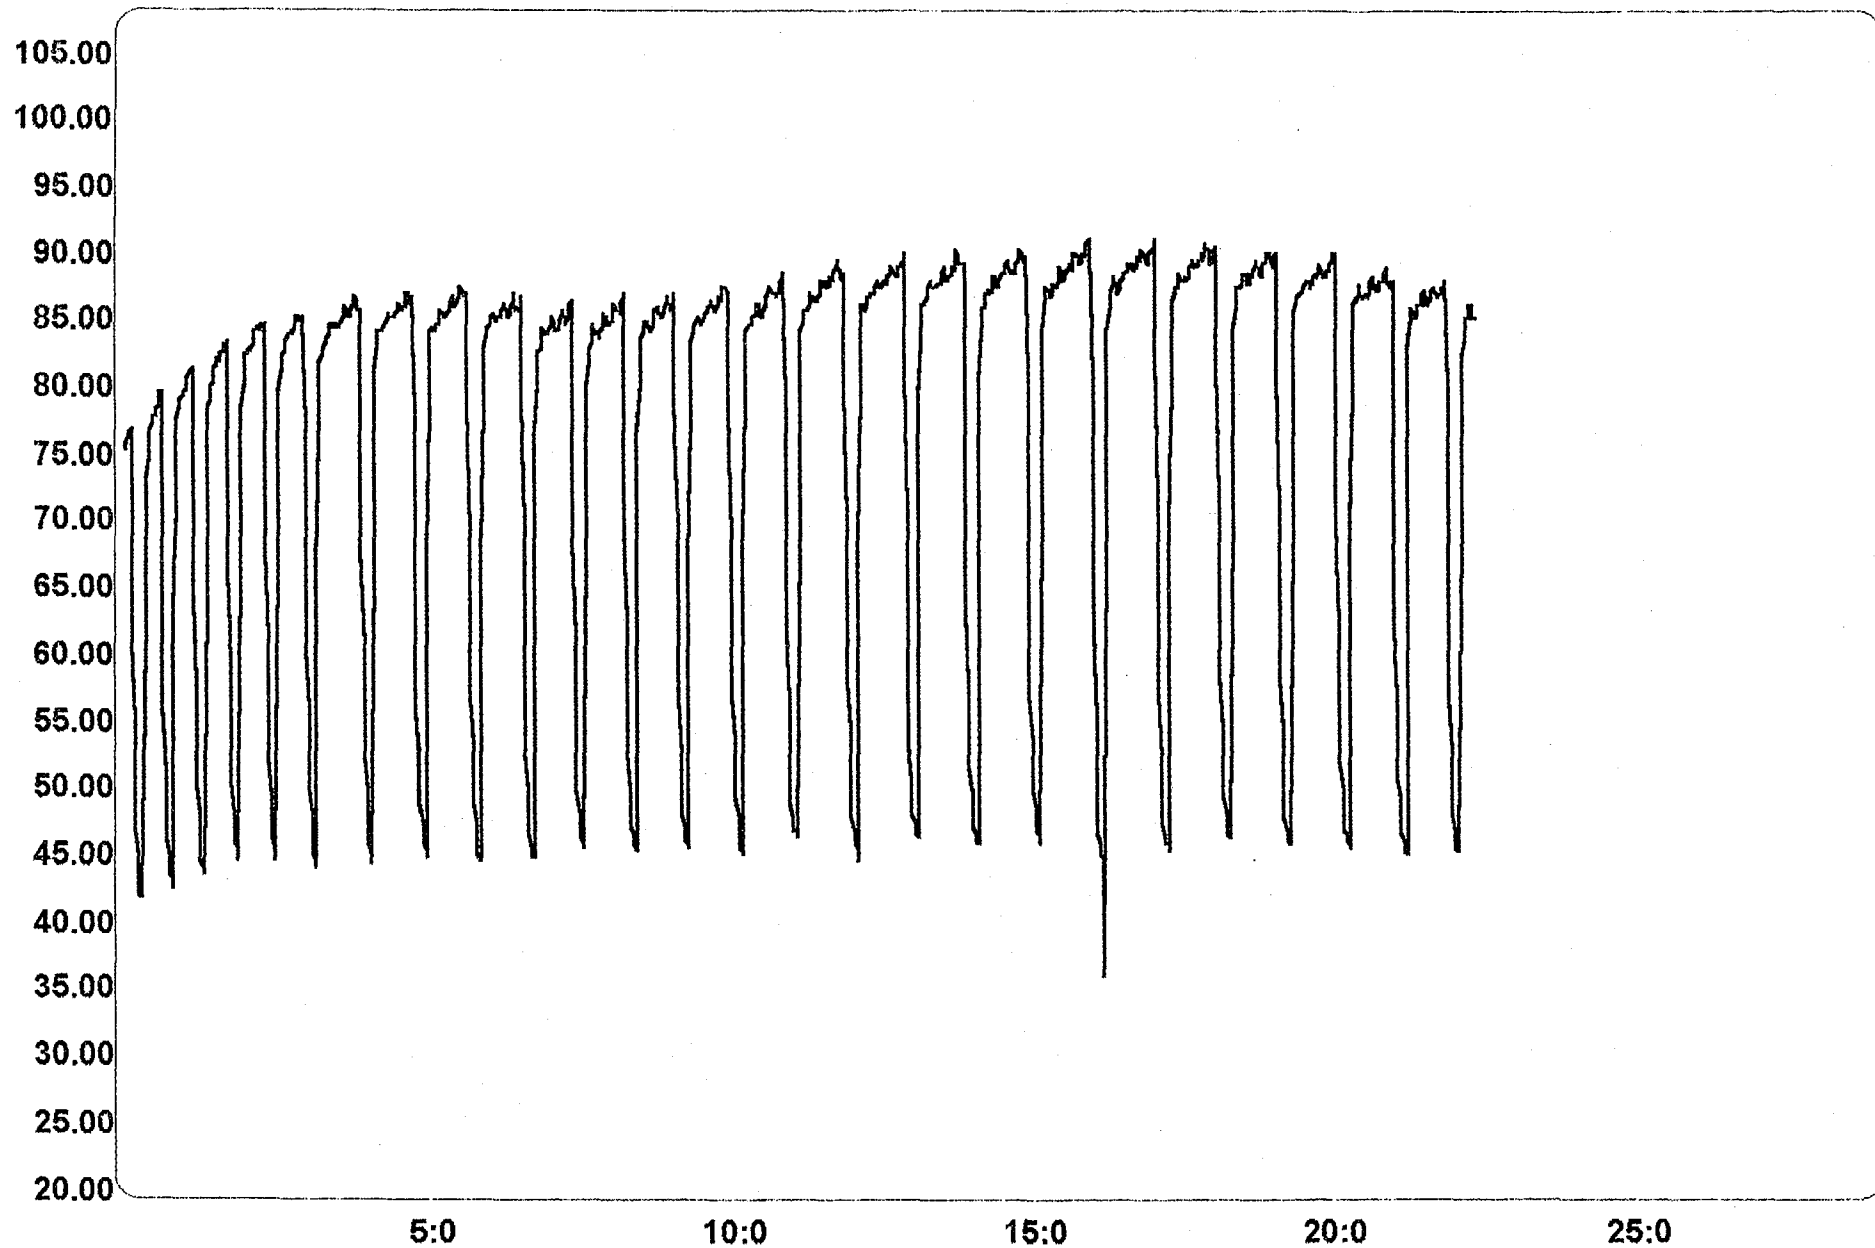

GHANDIL


# Test Sheet

F8-3-1

T4 : -17.60

Mon Oct 25 -99

Time = 20:29

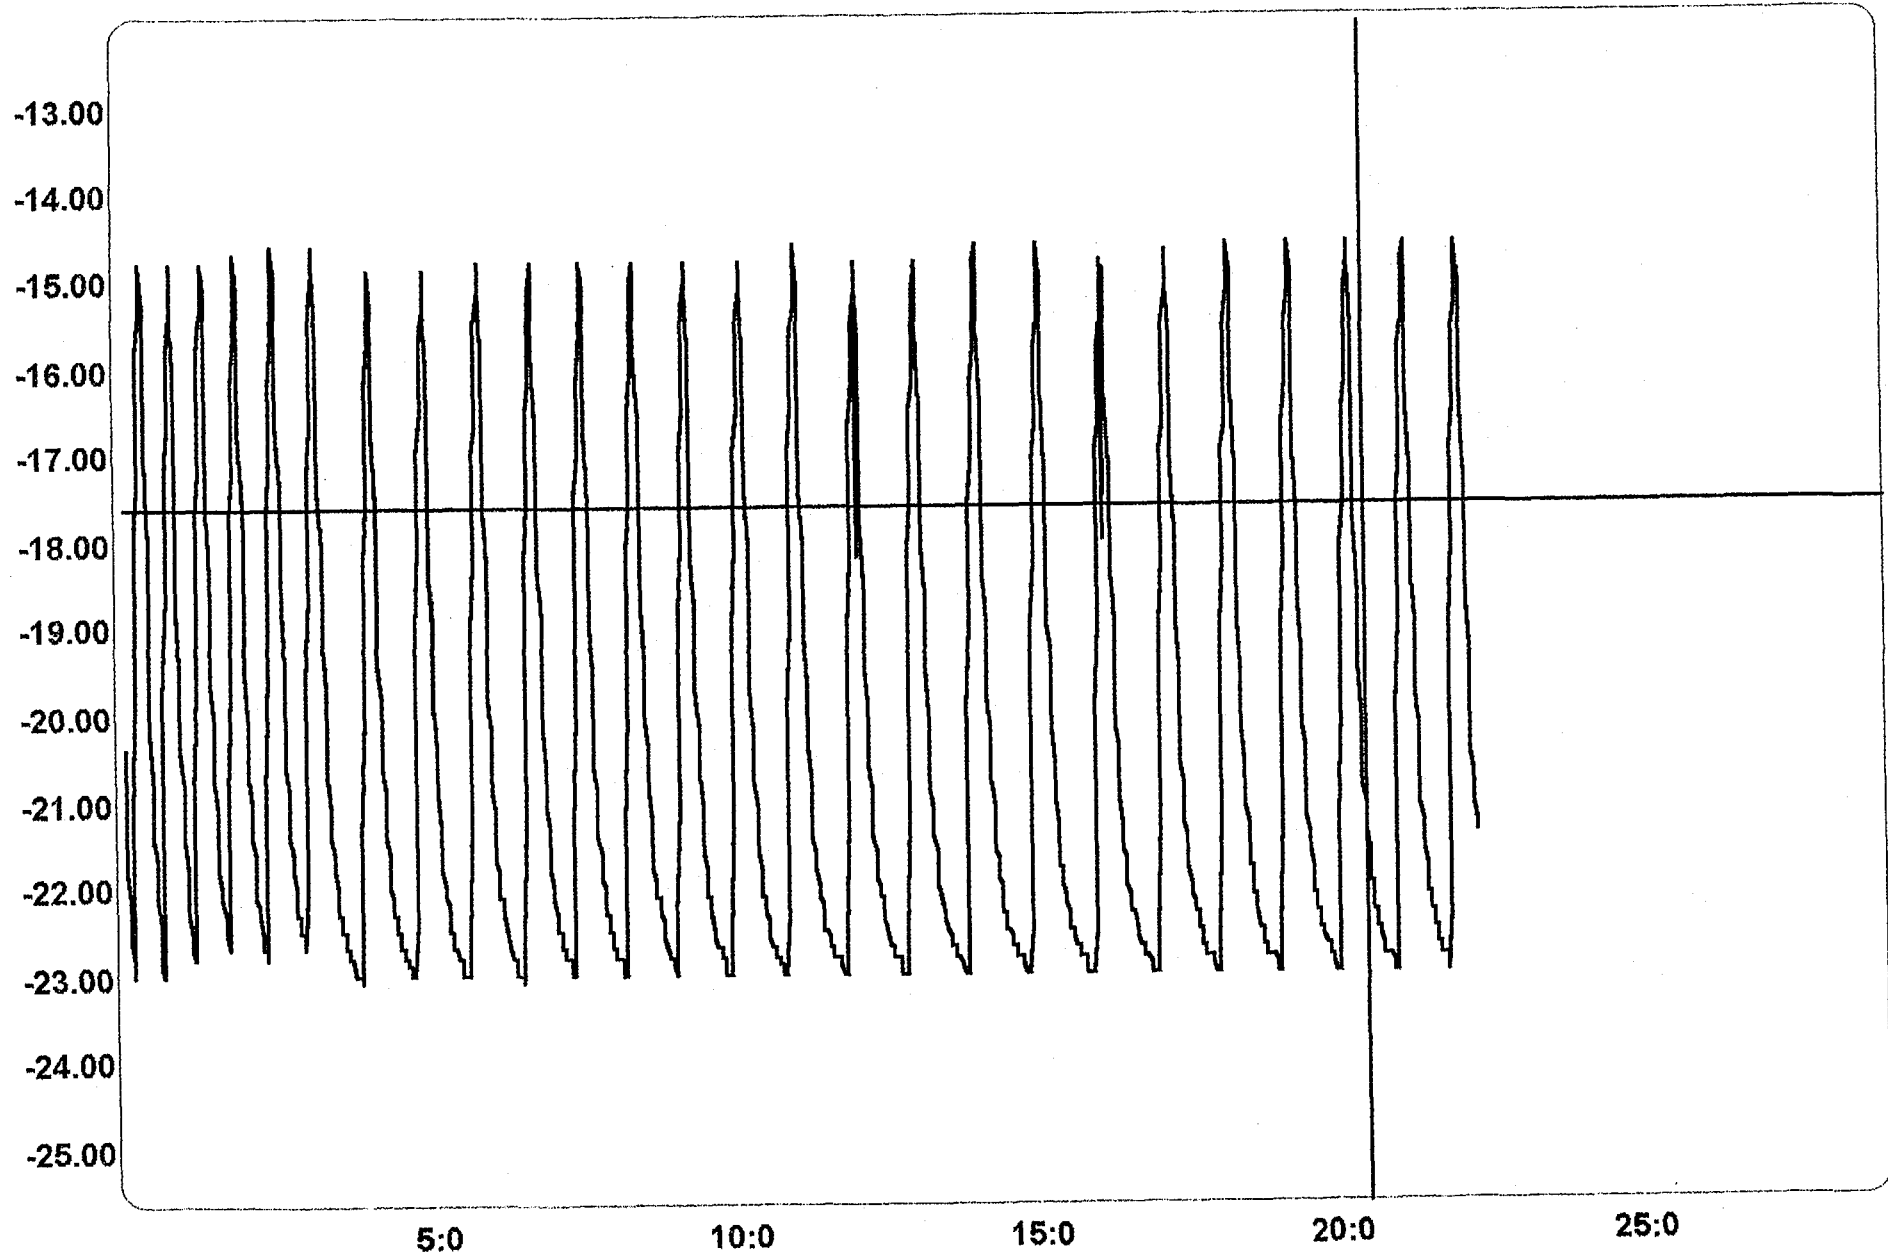

GHANDIL


# Test Sheet

F8-3-1

T5 : -12.68

Mon Oct 25 -99

Time = 10:33

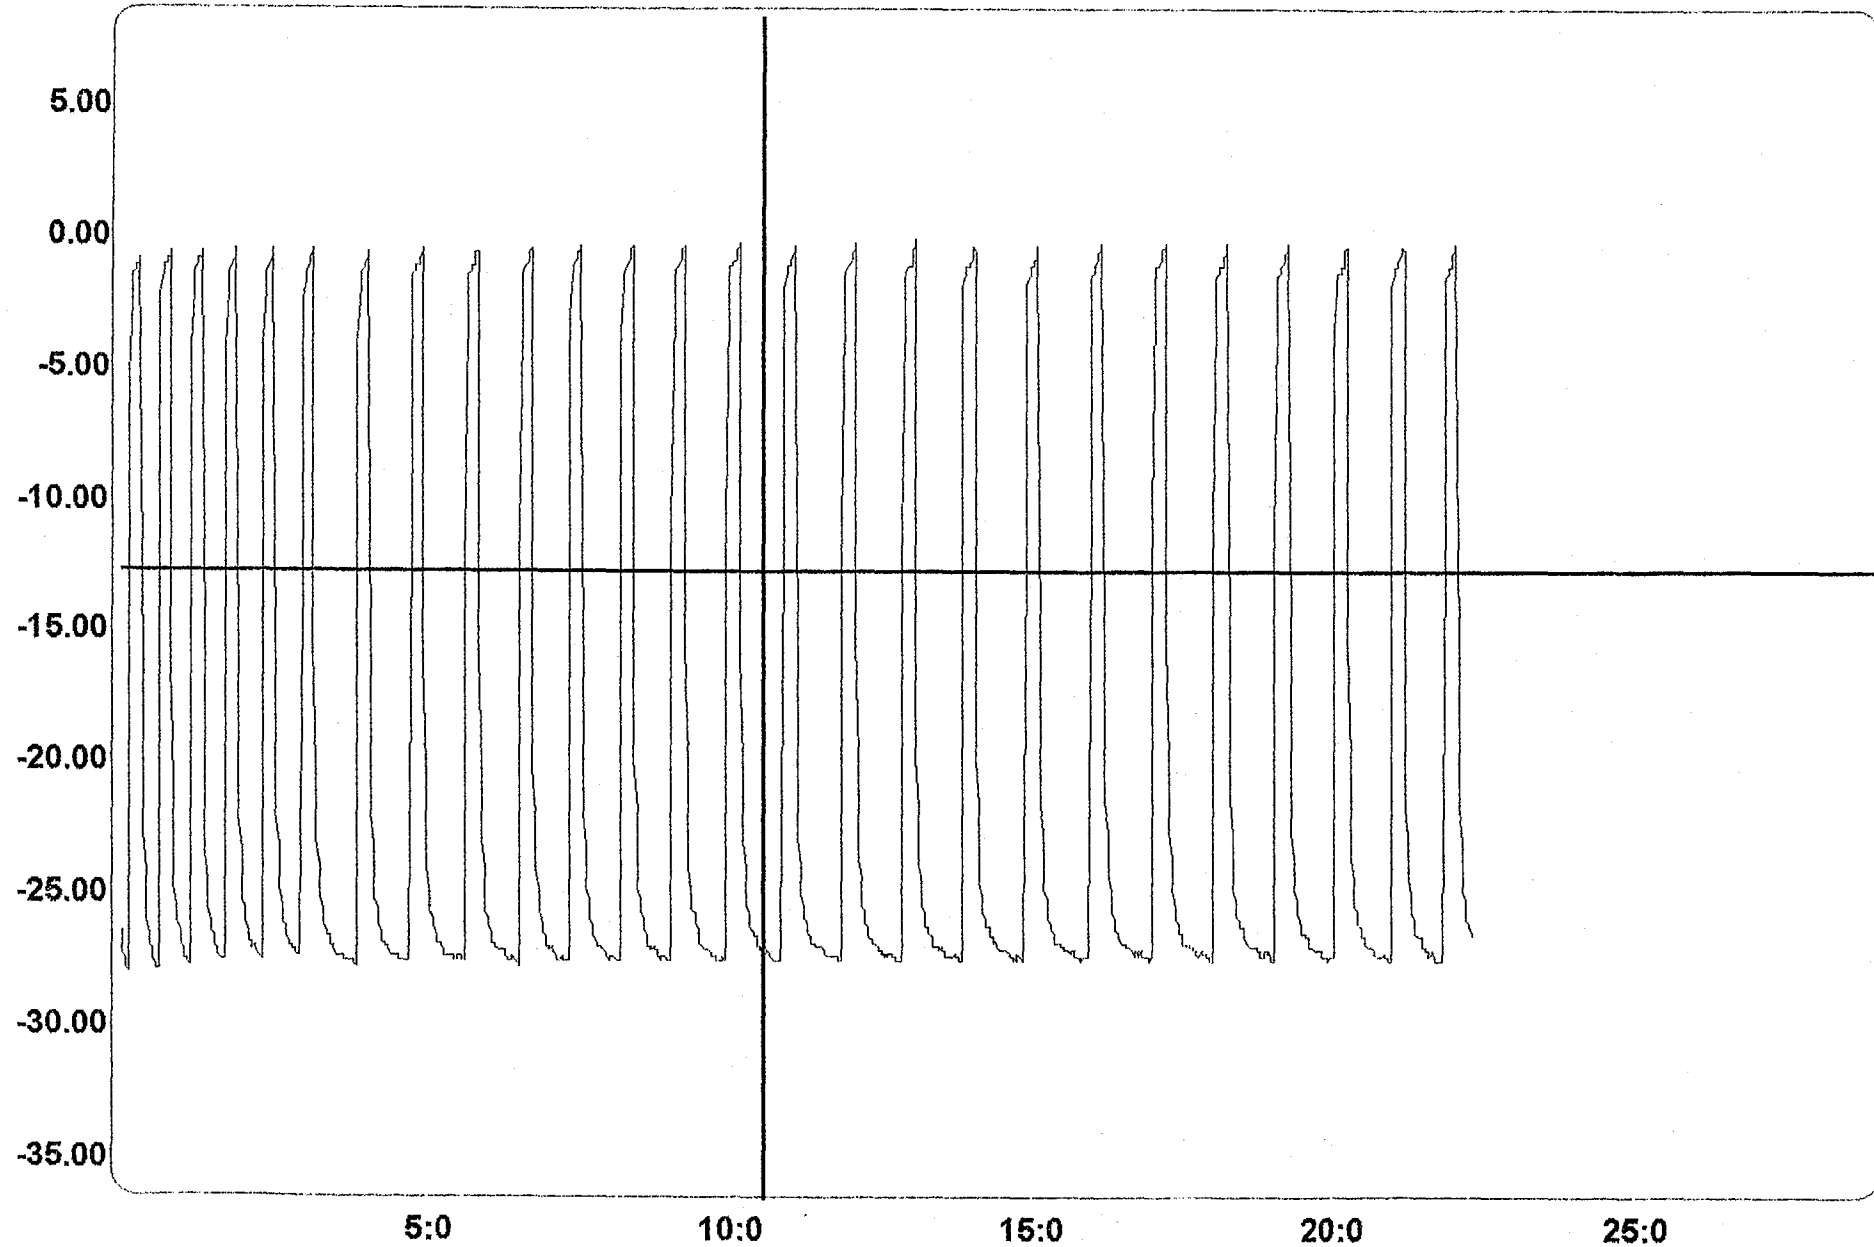



GHANDIL


# Test Sheet

F8-3-1

T6 : 46.26

Mon Oct 25 -99

Time = 5:43

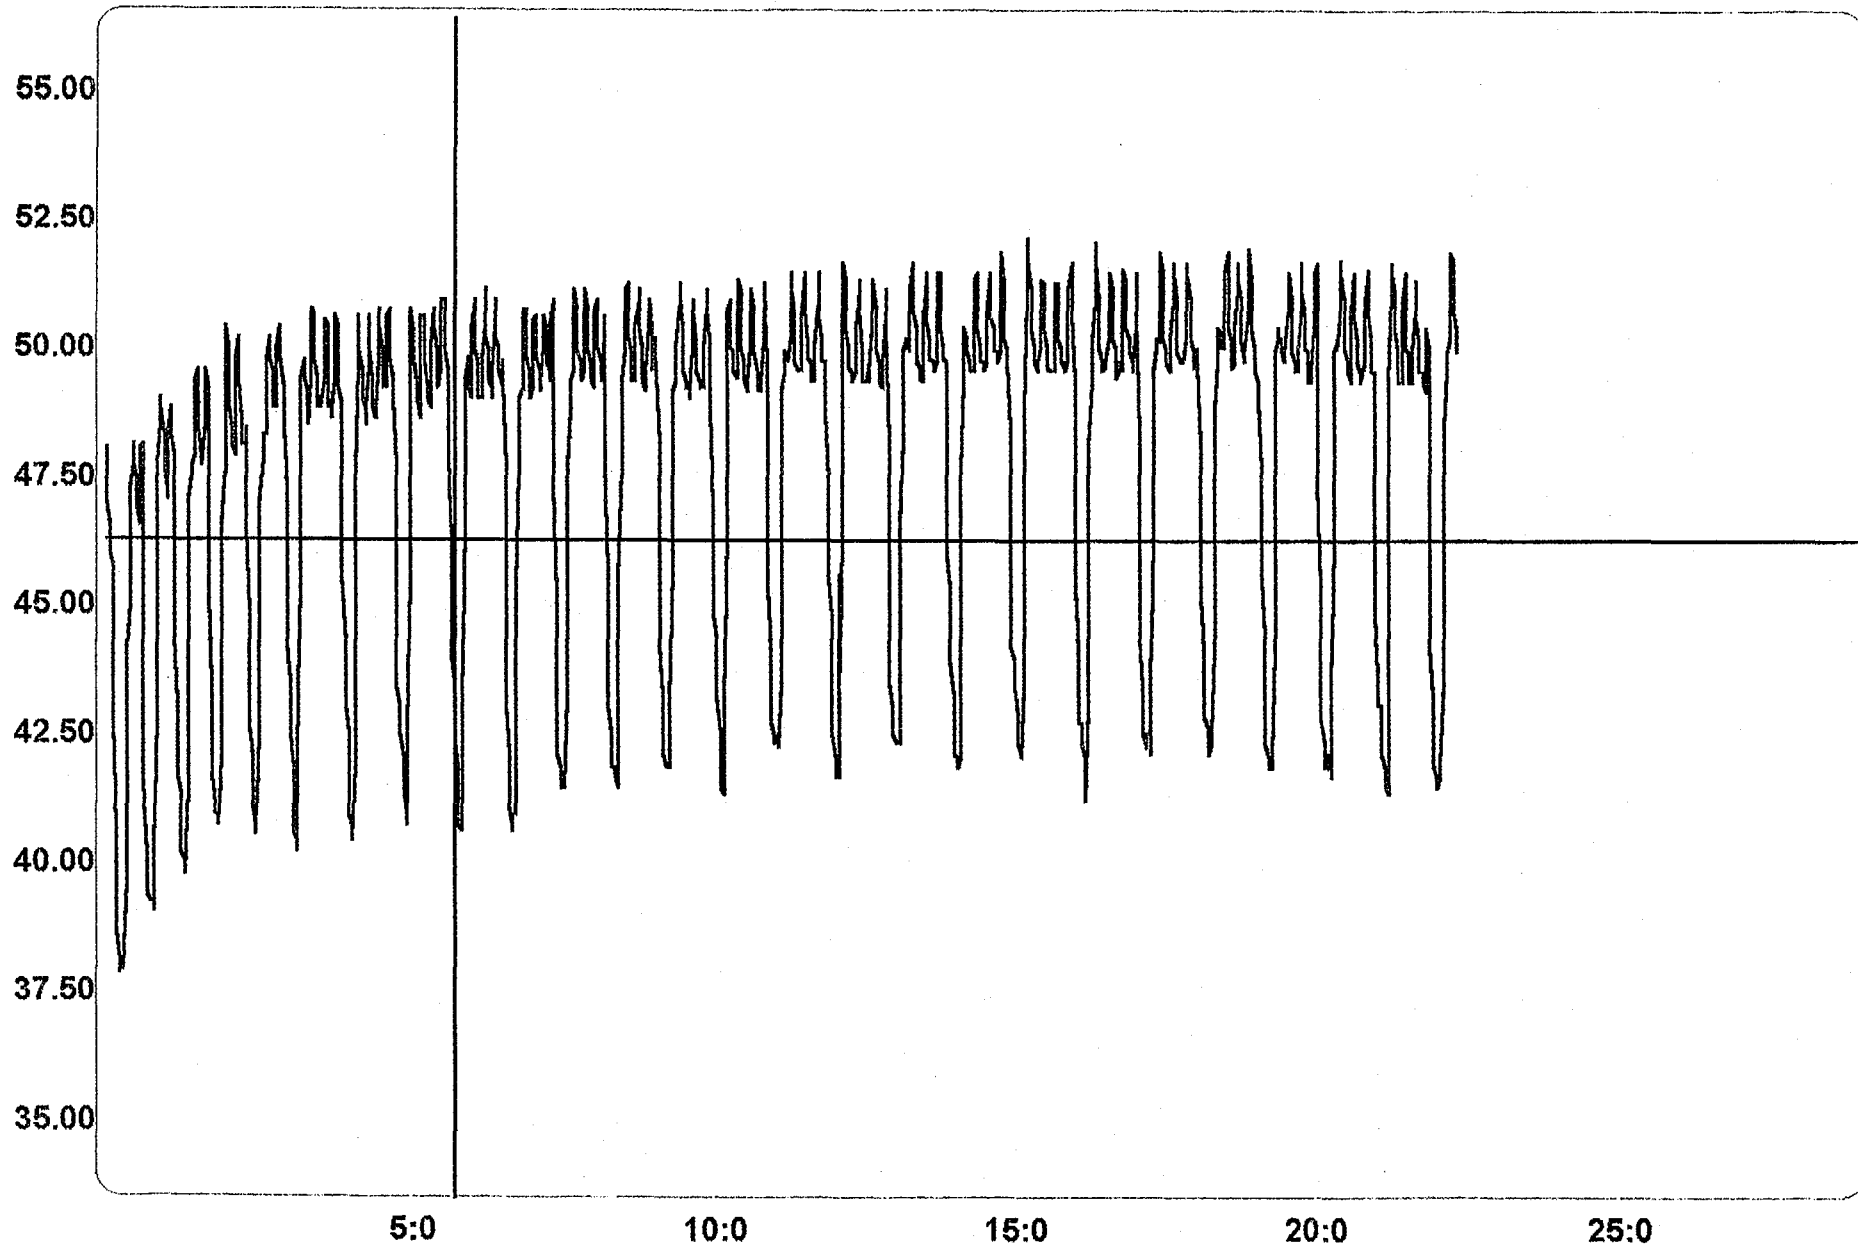

GHANDIL


# Test Sheet

F8-3-1

T7 : 44.66

Mon Oct 25 -99

Time = 9:39

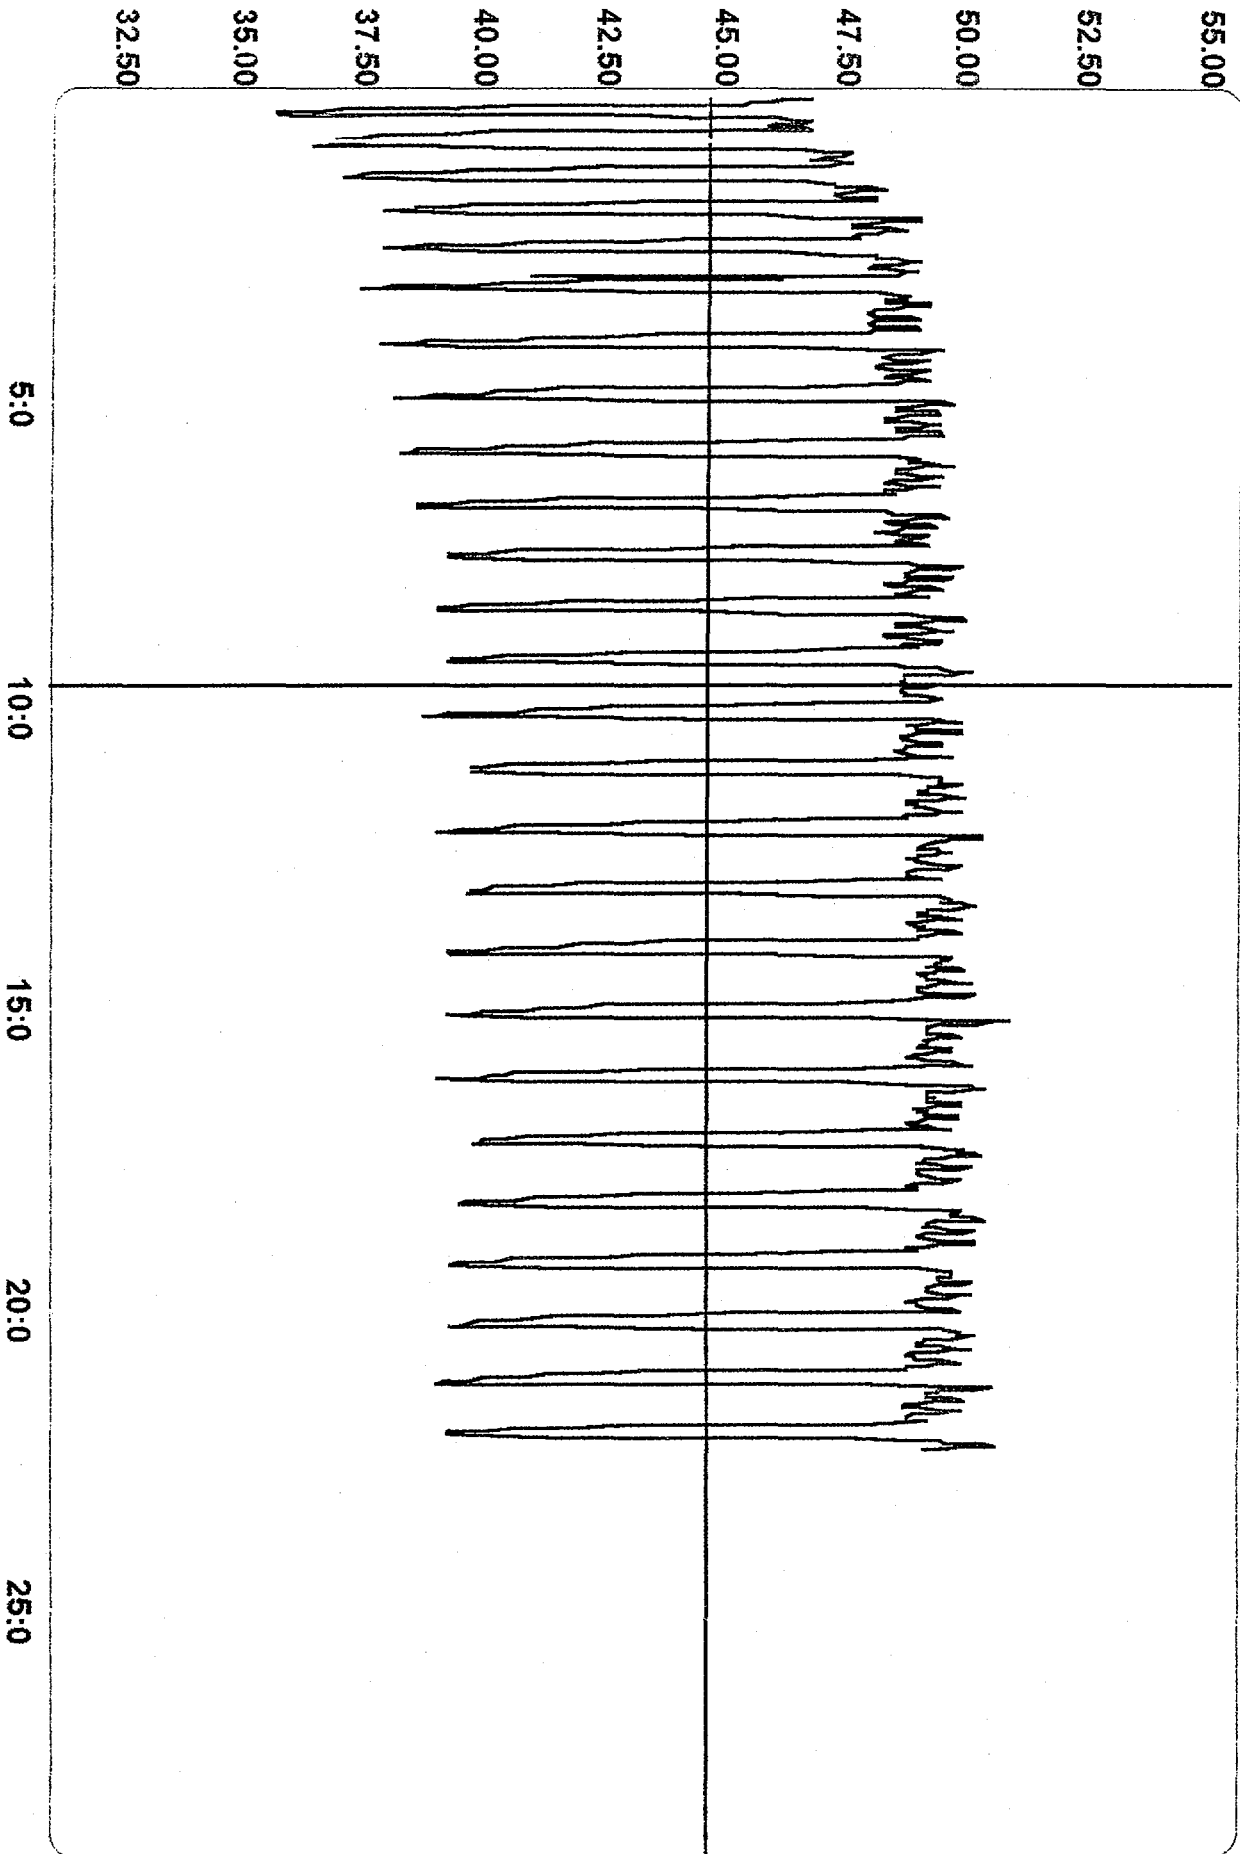

GHANDIL


# Test Sheet

F8-3-1

T8 : 46.25

Mon Oct 25 -99

Time = 11:40

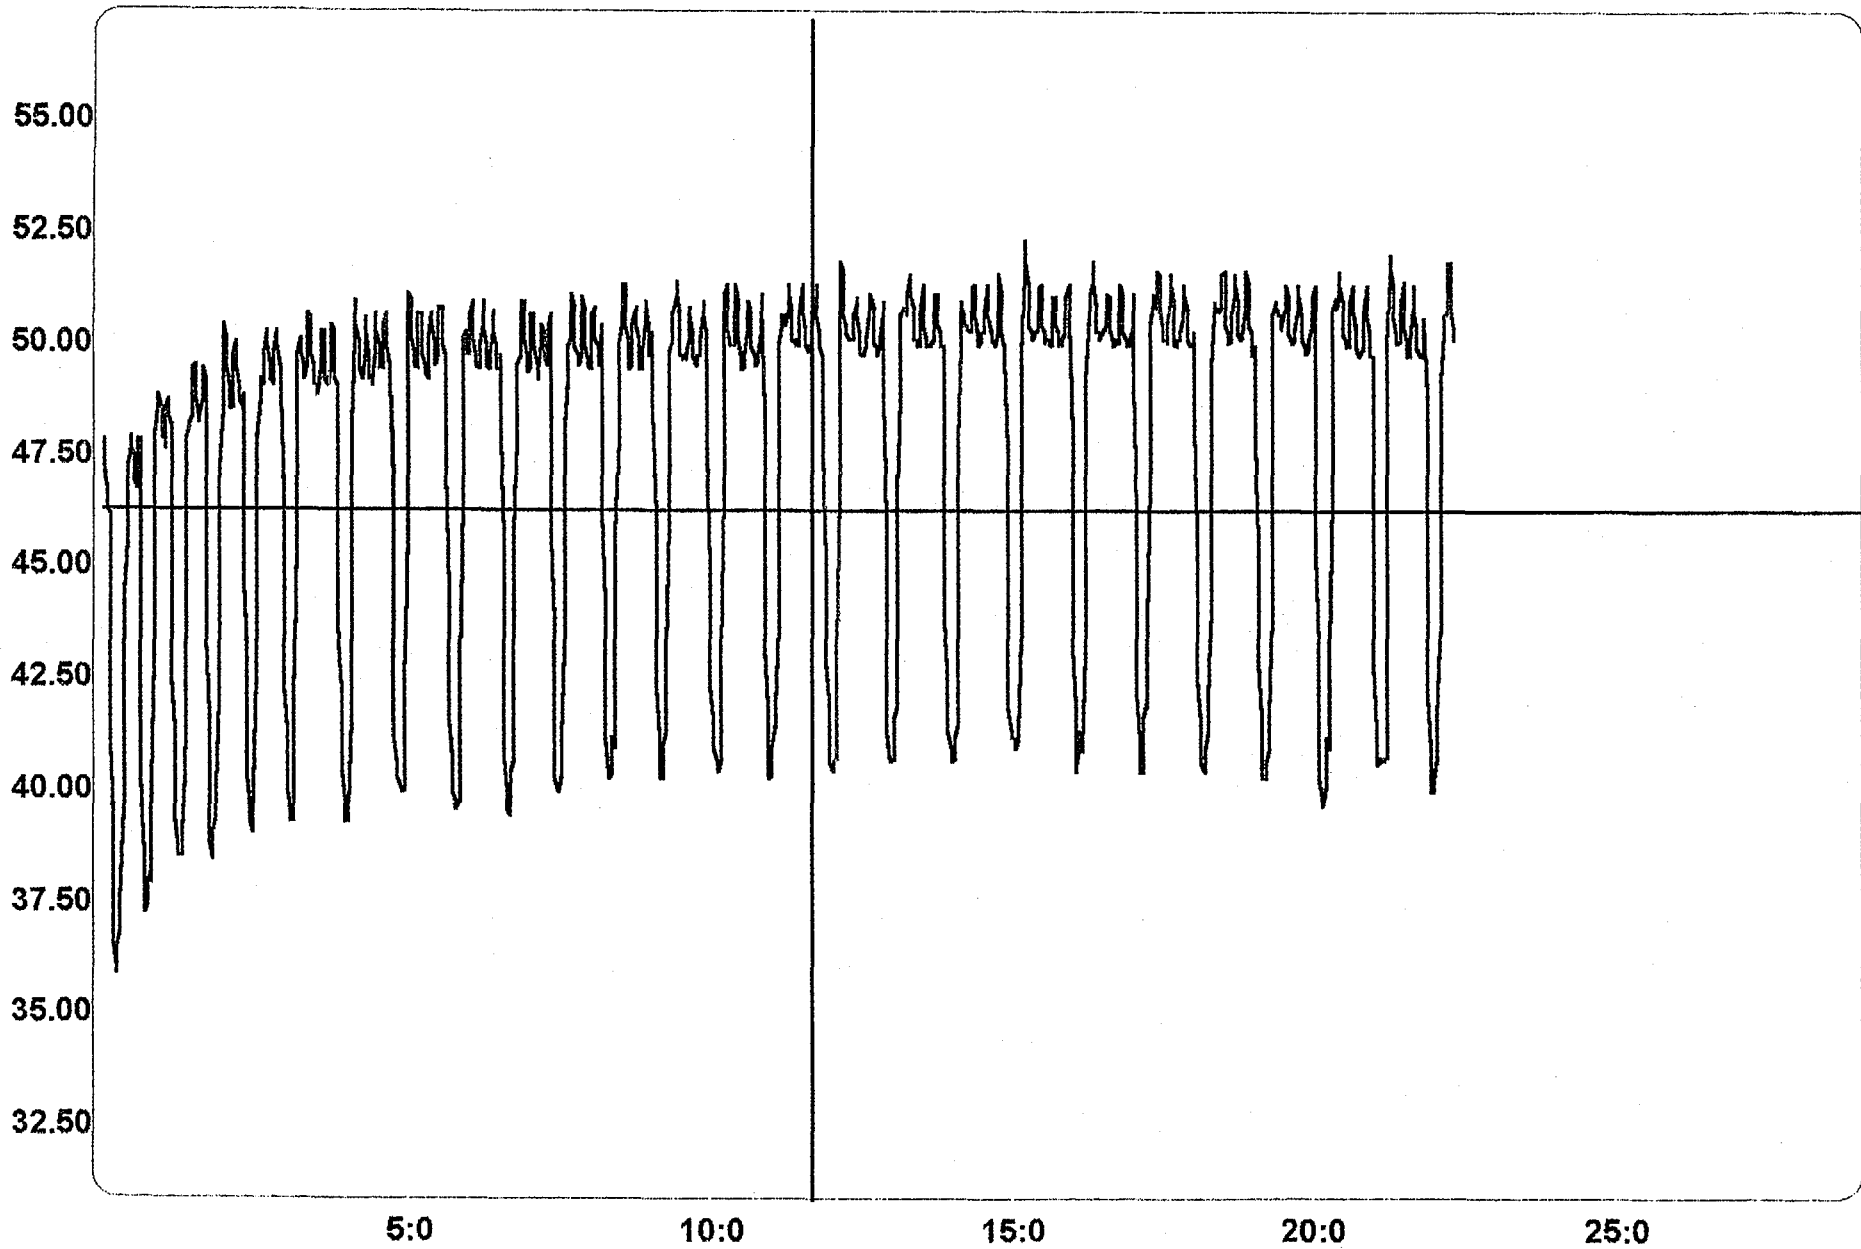

GHANDIL


# Test Sheet

F8-3-1

T9 : -15.73

Mon Oct 25 -99

Time = 14:29

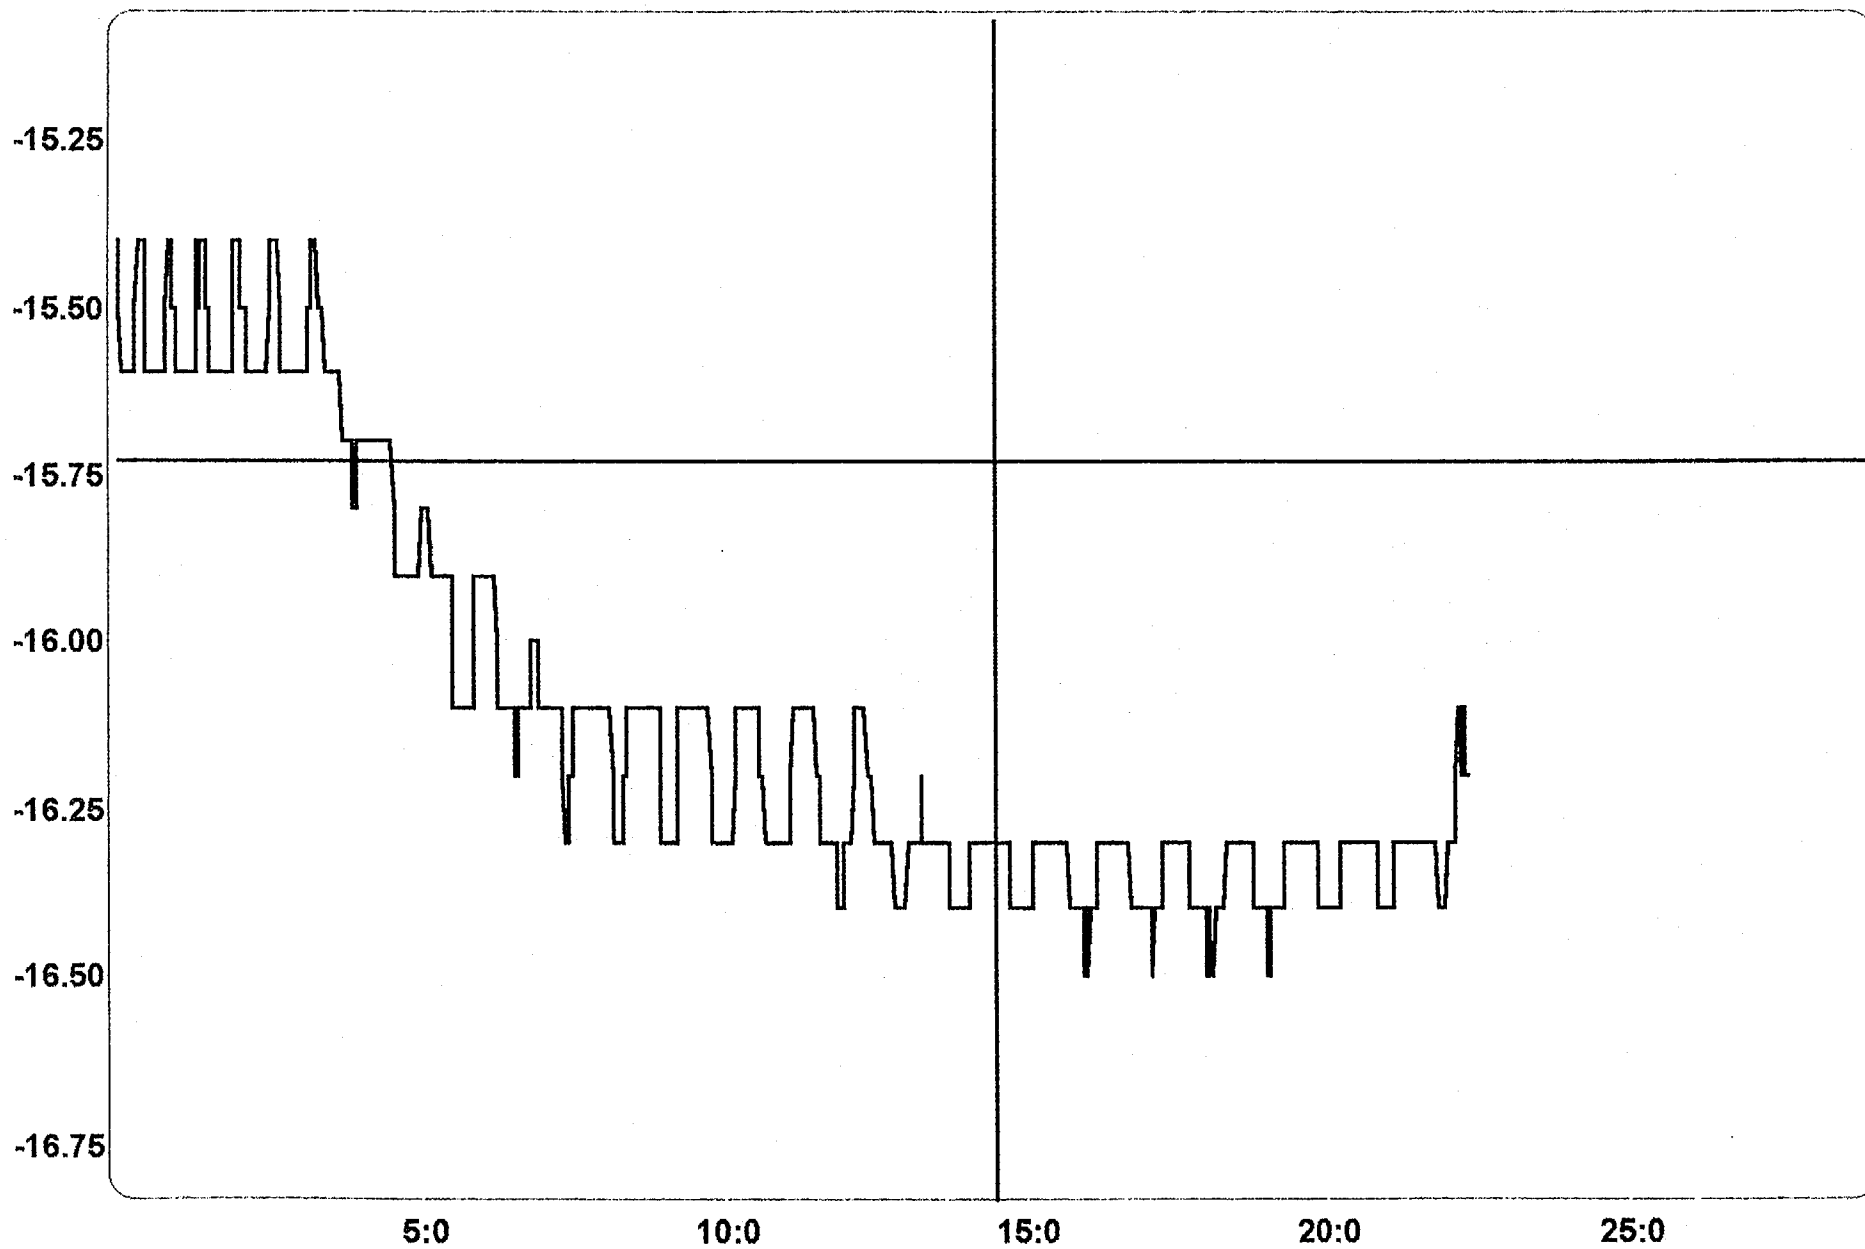

GHANDIL


# Test Sheet

F8-3-1

T10 : -17.62

Mon Oct 25 -99

Time = 5:54

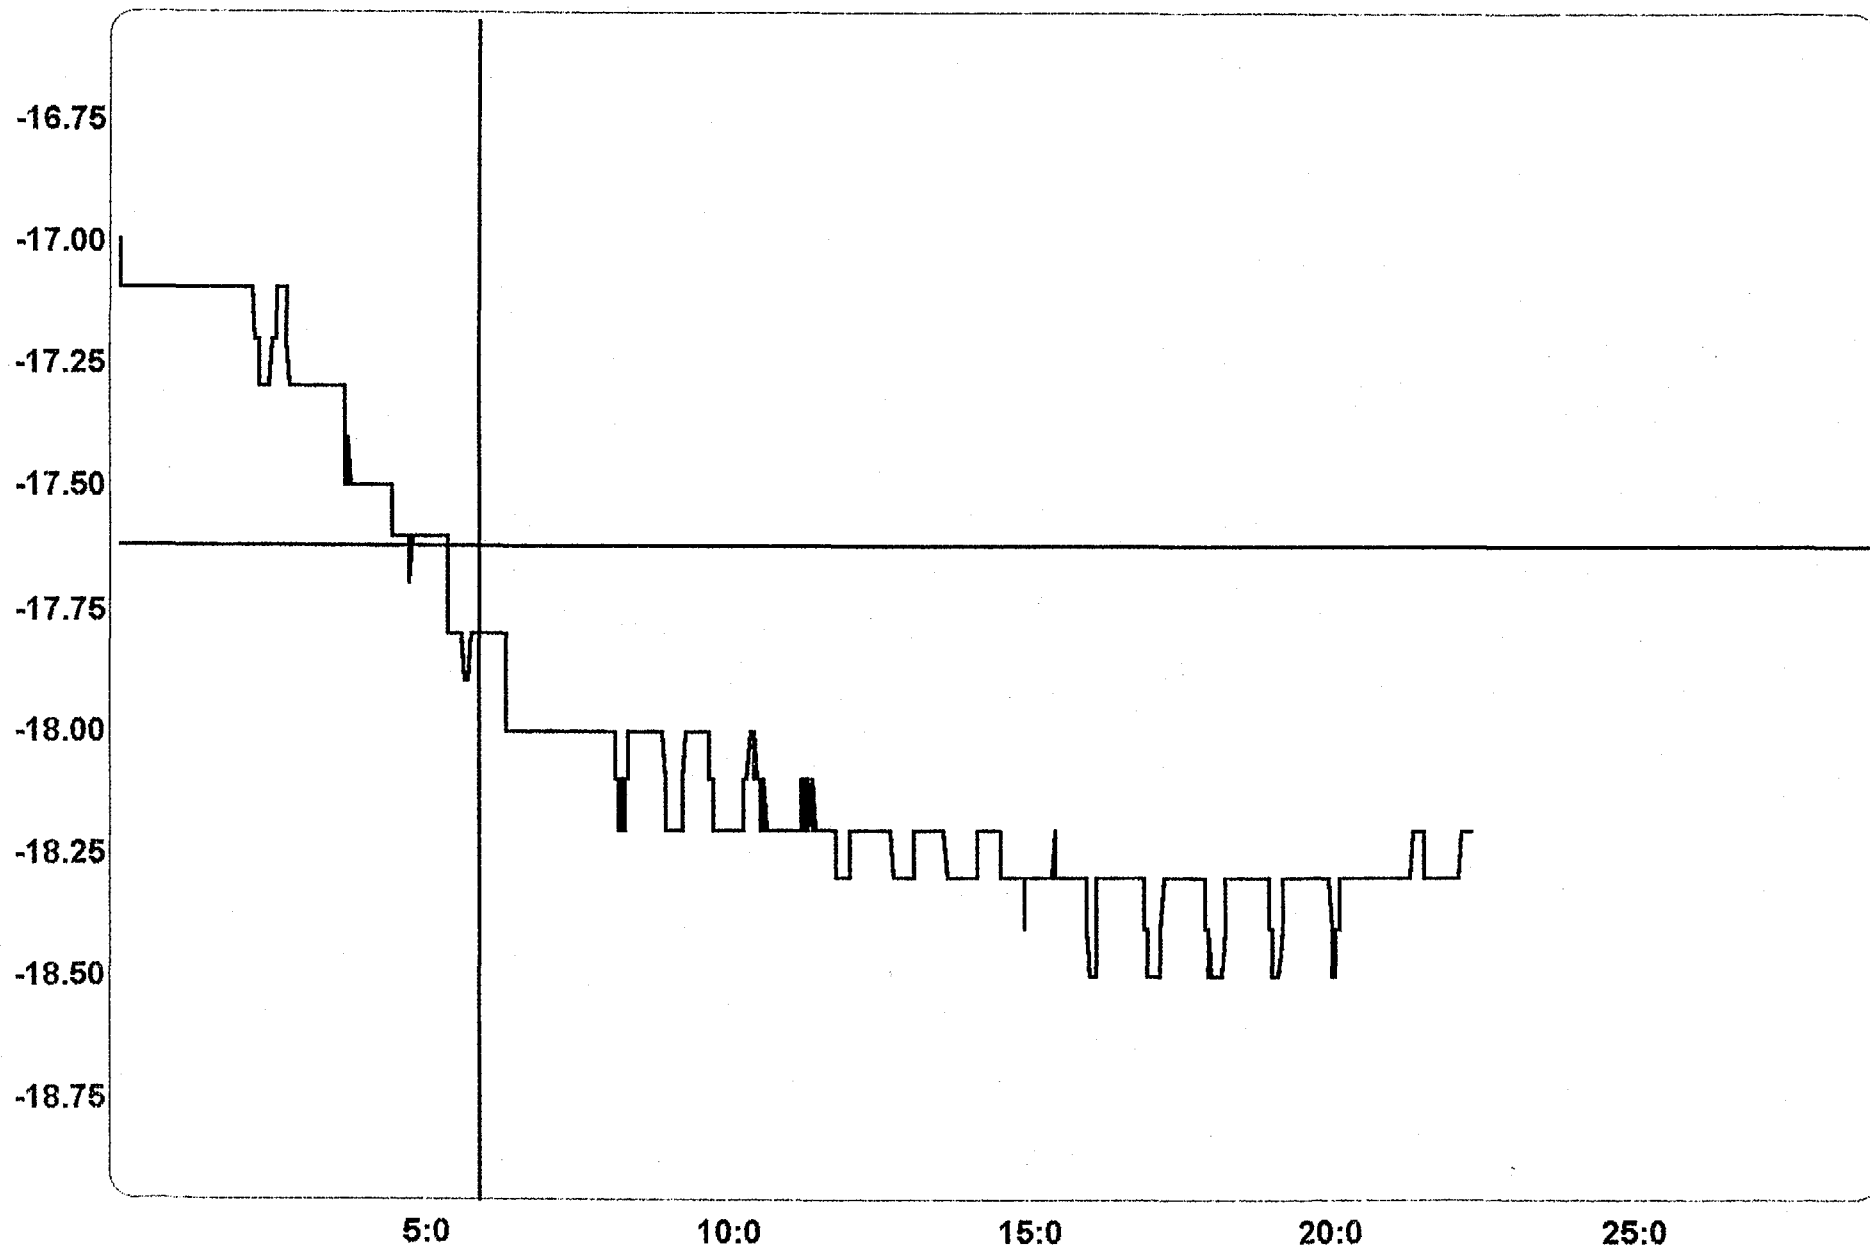

GHANDIL


# Test Sheet

F8-3-1

T11 : -15.19

Mon Oct 25 -99

Time = -3:-55

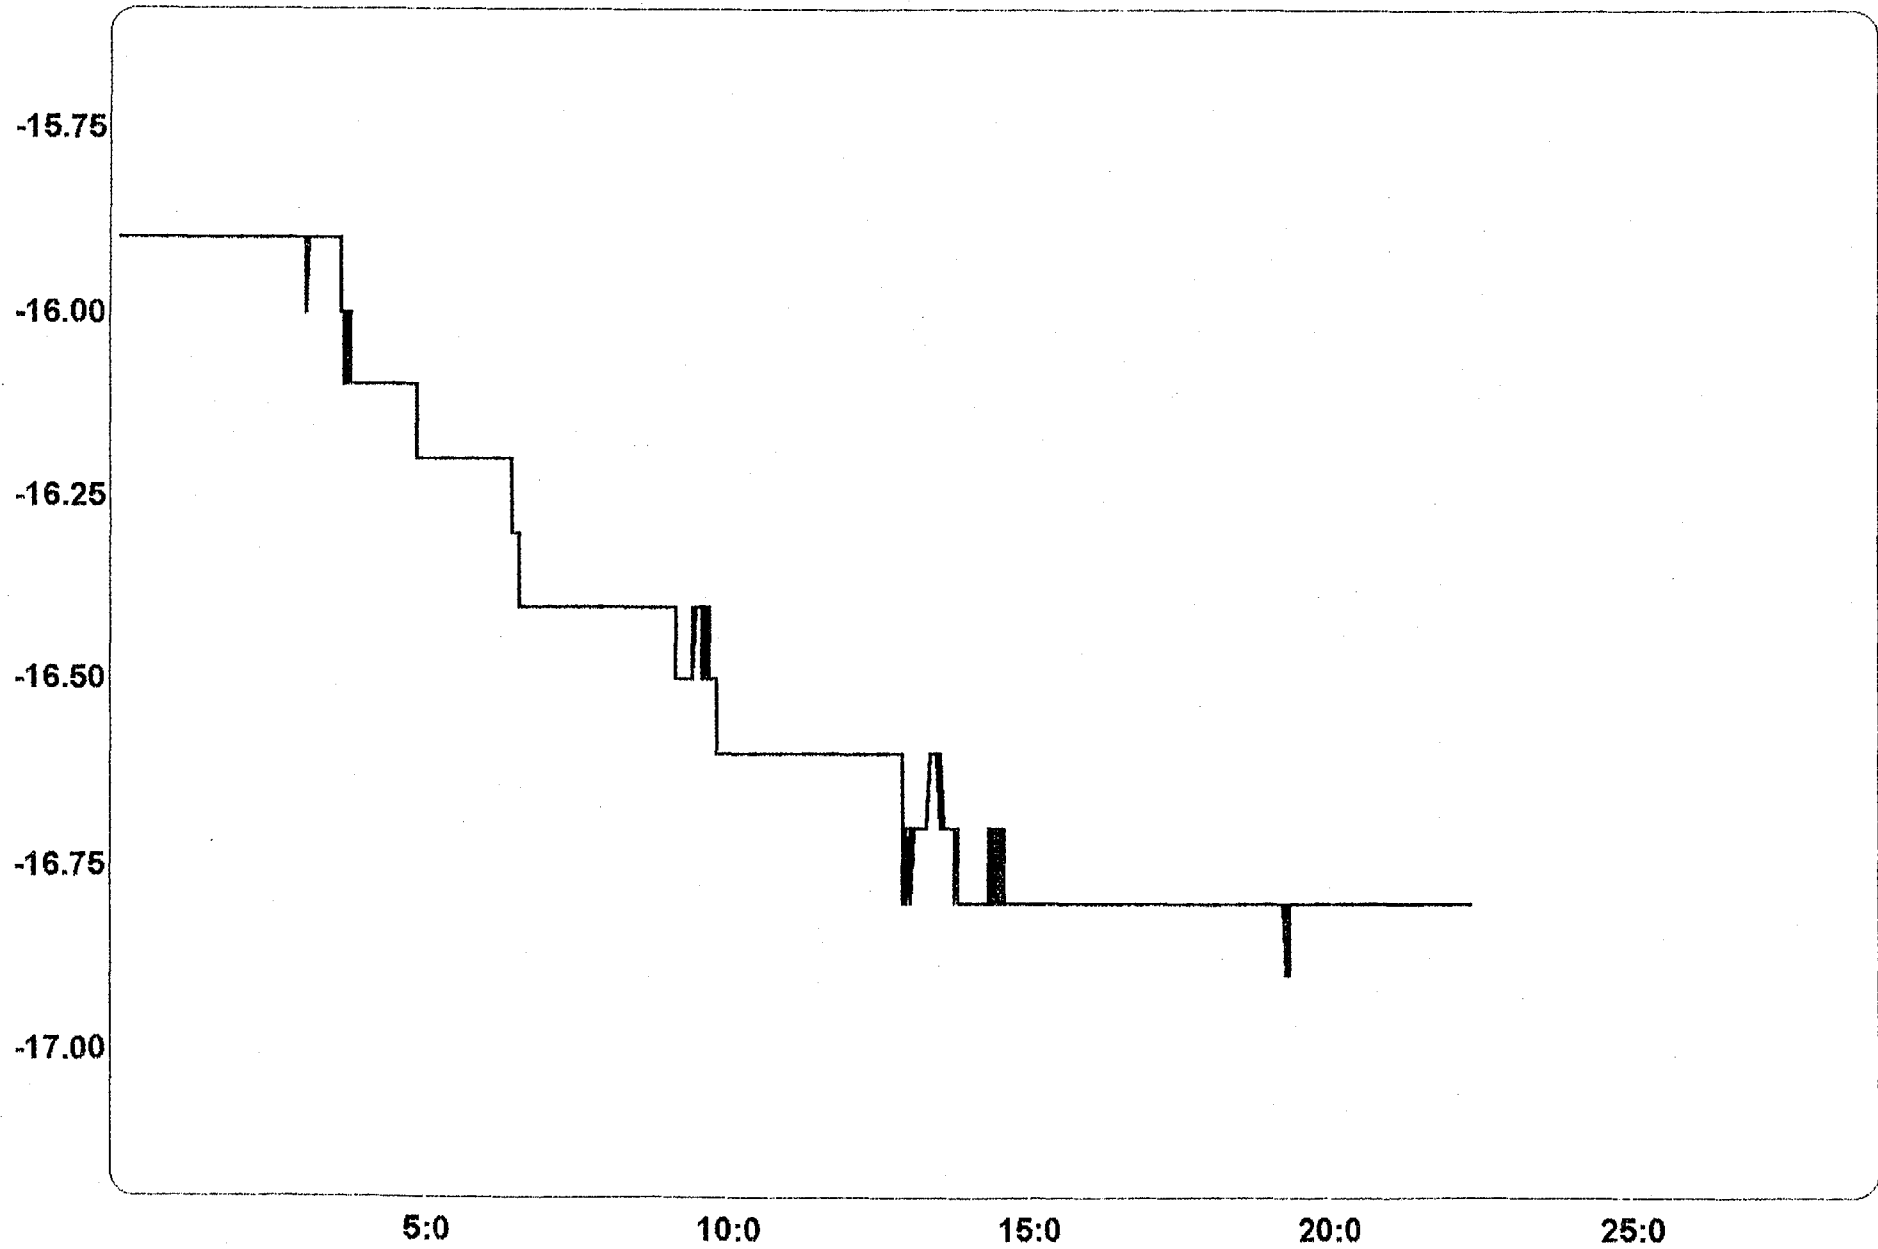

GHANDIL


# Test Sheet

F8-3-1

T12 : -18.01

Mon Oct 25 -99

Time = 0:-2

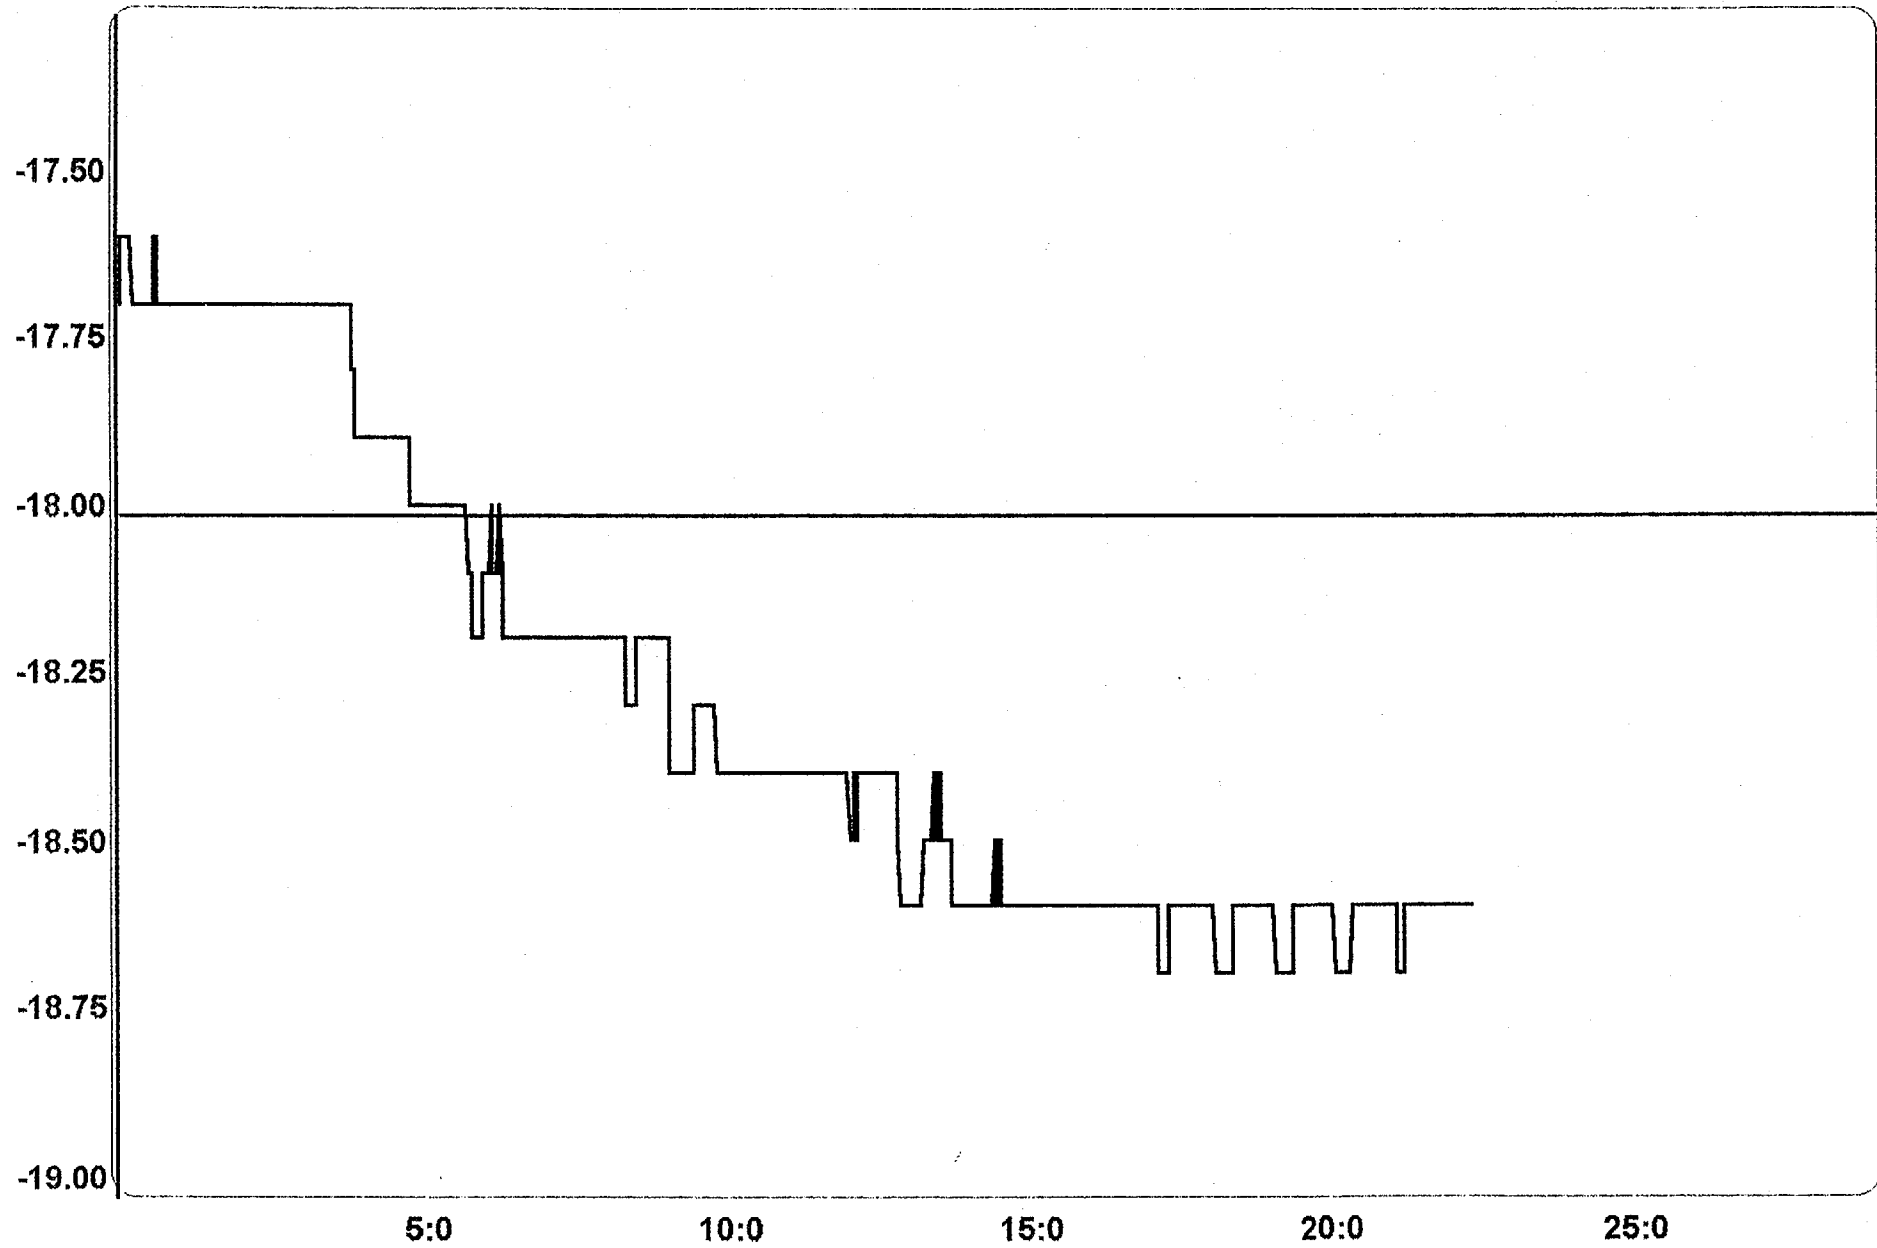

GHANDIL


# Test Sheet

F8-3-1

T13 : -15.86

Mon Oct 25 -99

Time = 6:21

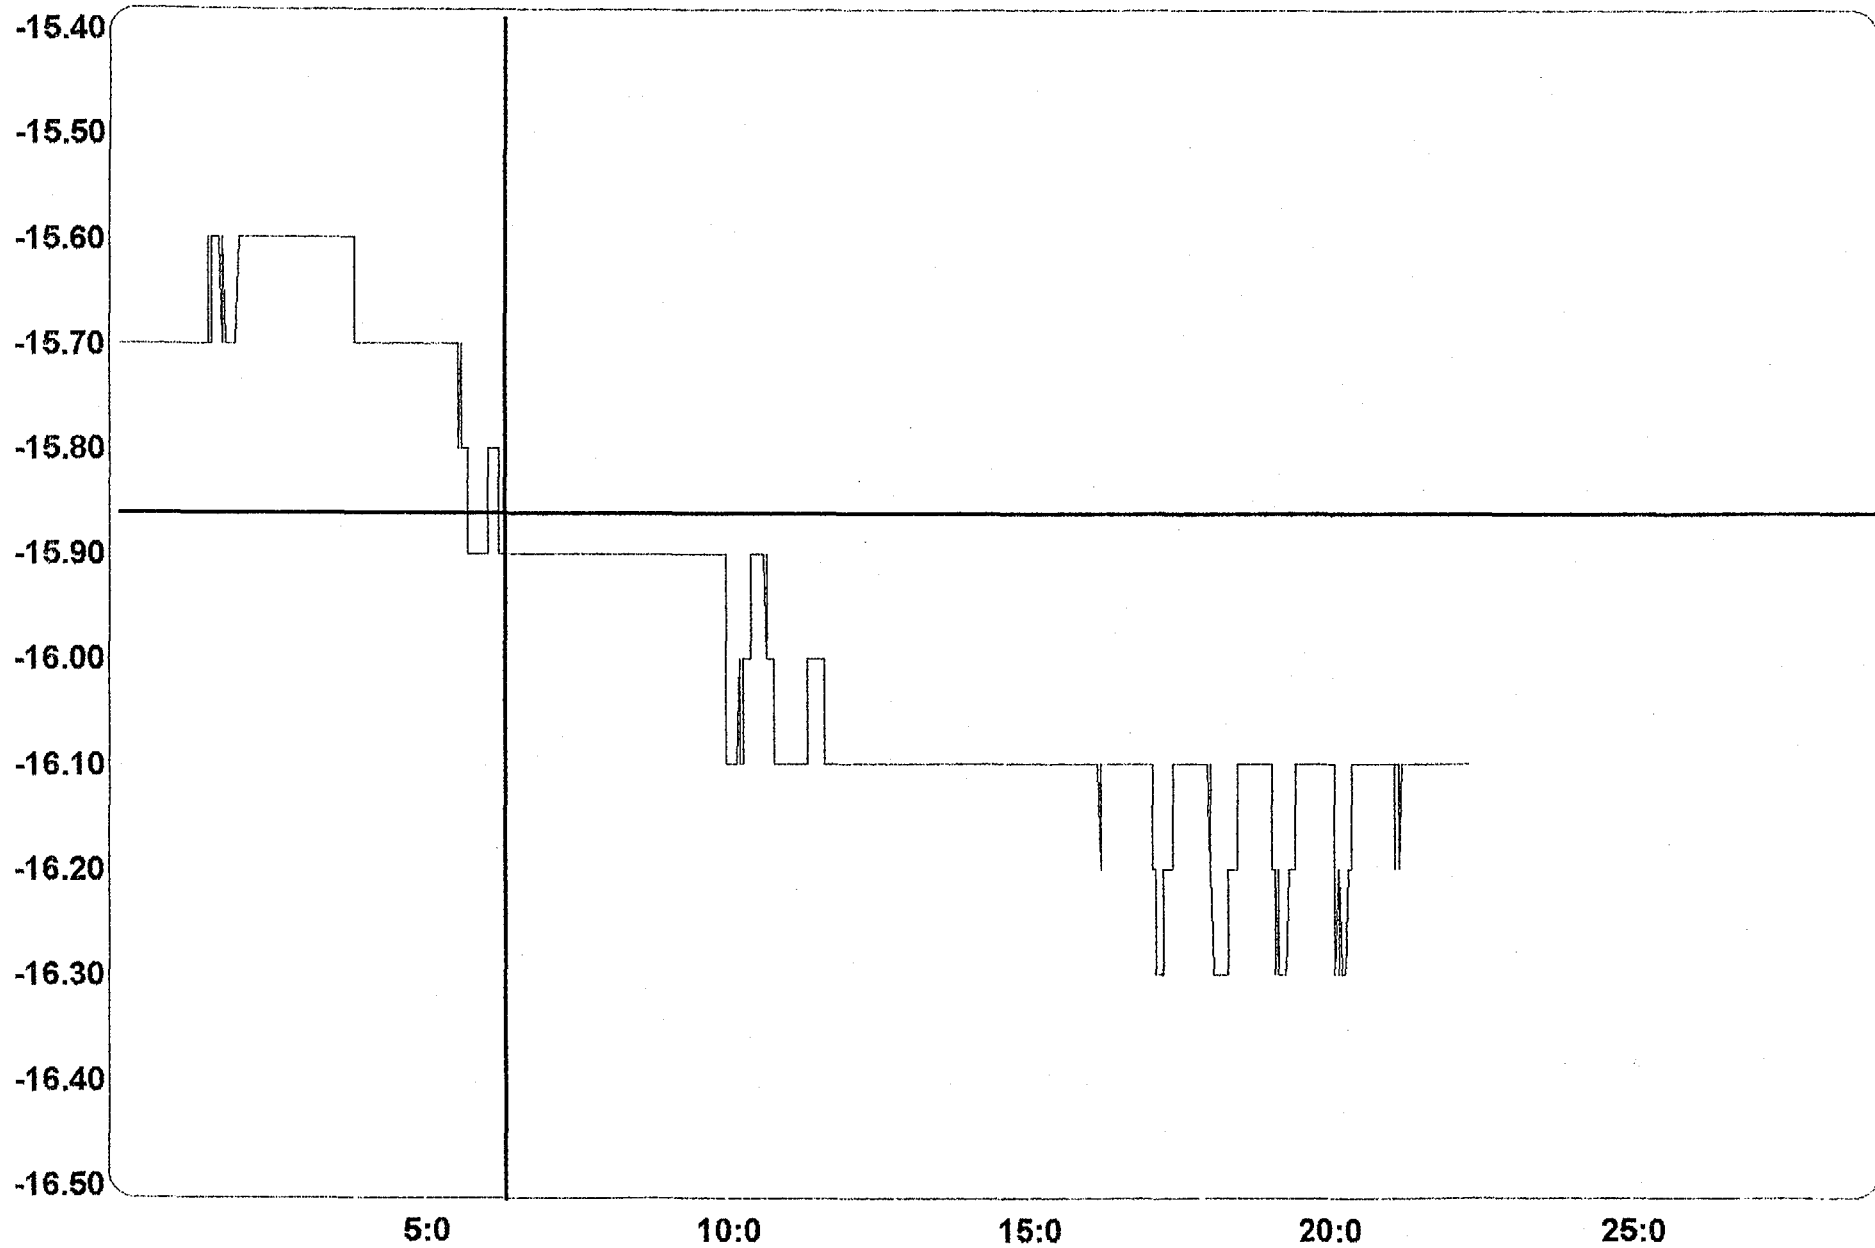



GHANDIL


# Test Sheet

F8-3-1

T14 : -6.07

Mon Oct 25 -99

Time = 4:13

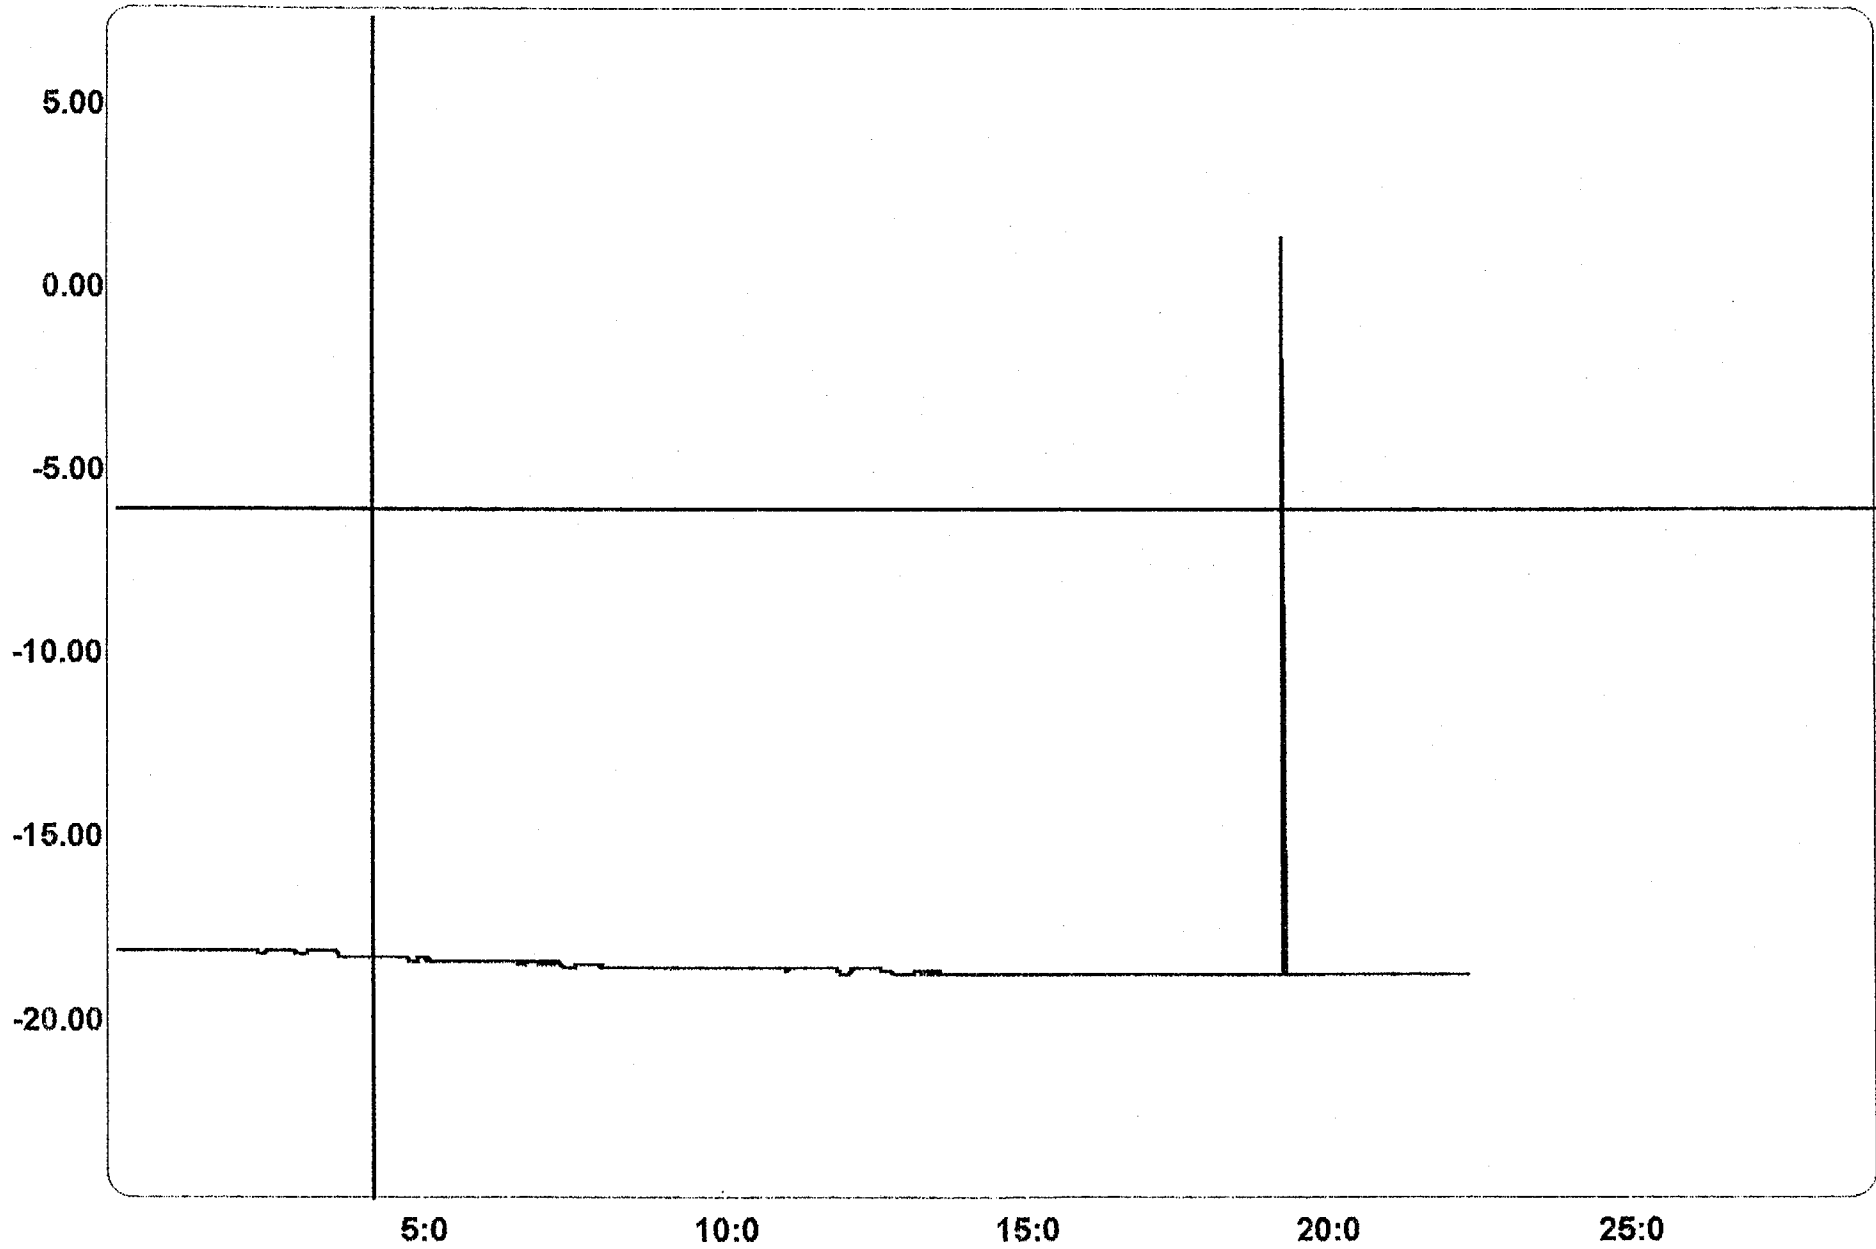

GHANDIL


# Test Sheet

F8-3-1

T15 : -14.77

Mon Oct 25 -99

Time = 14:52

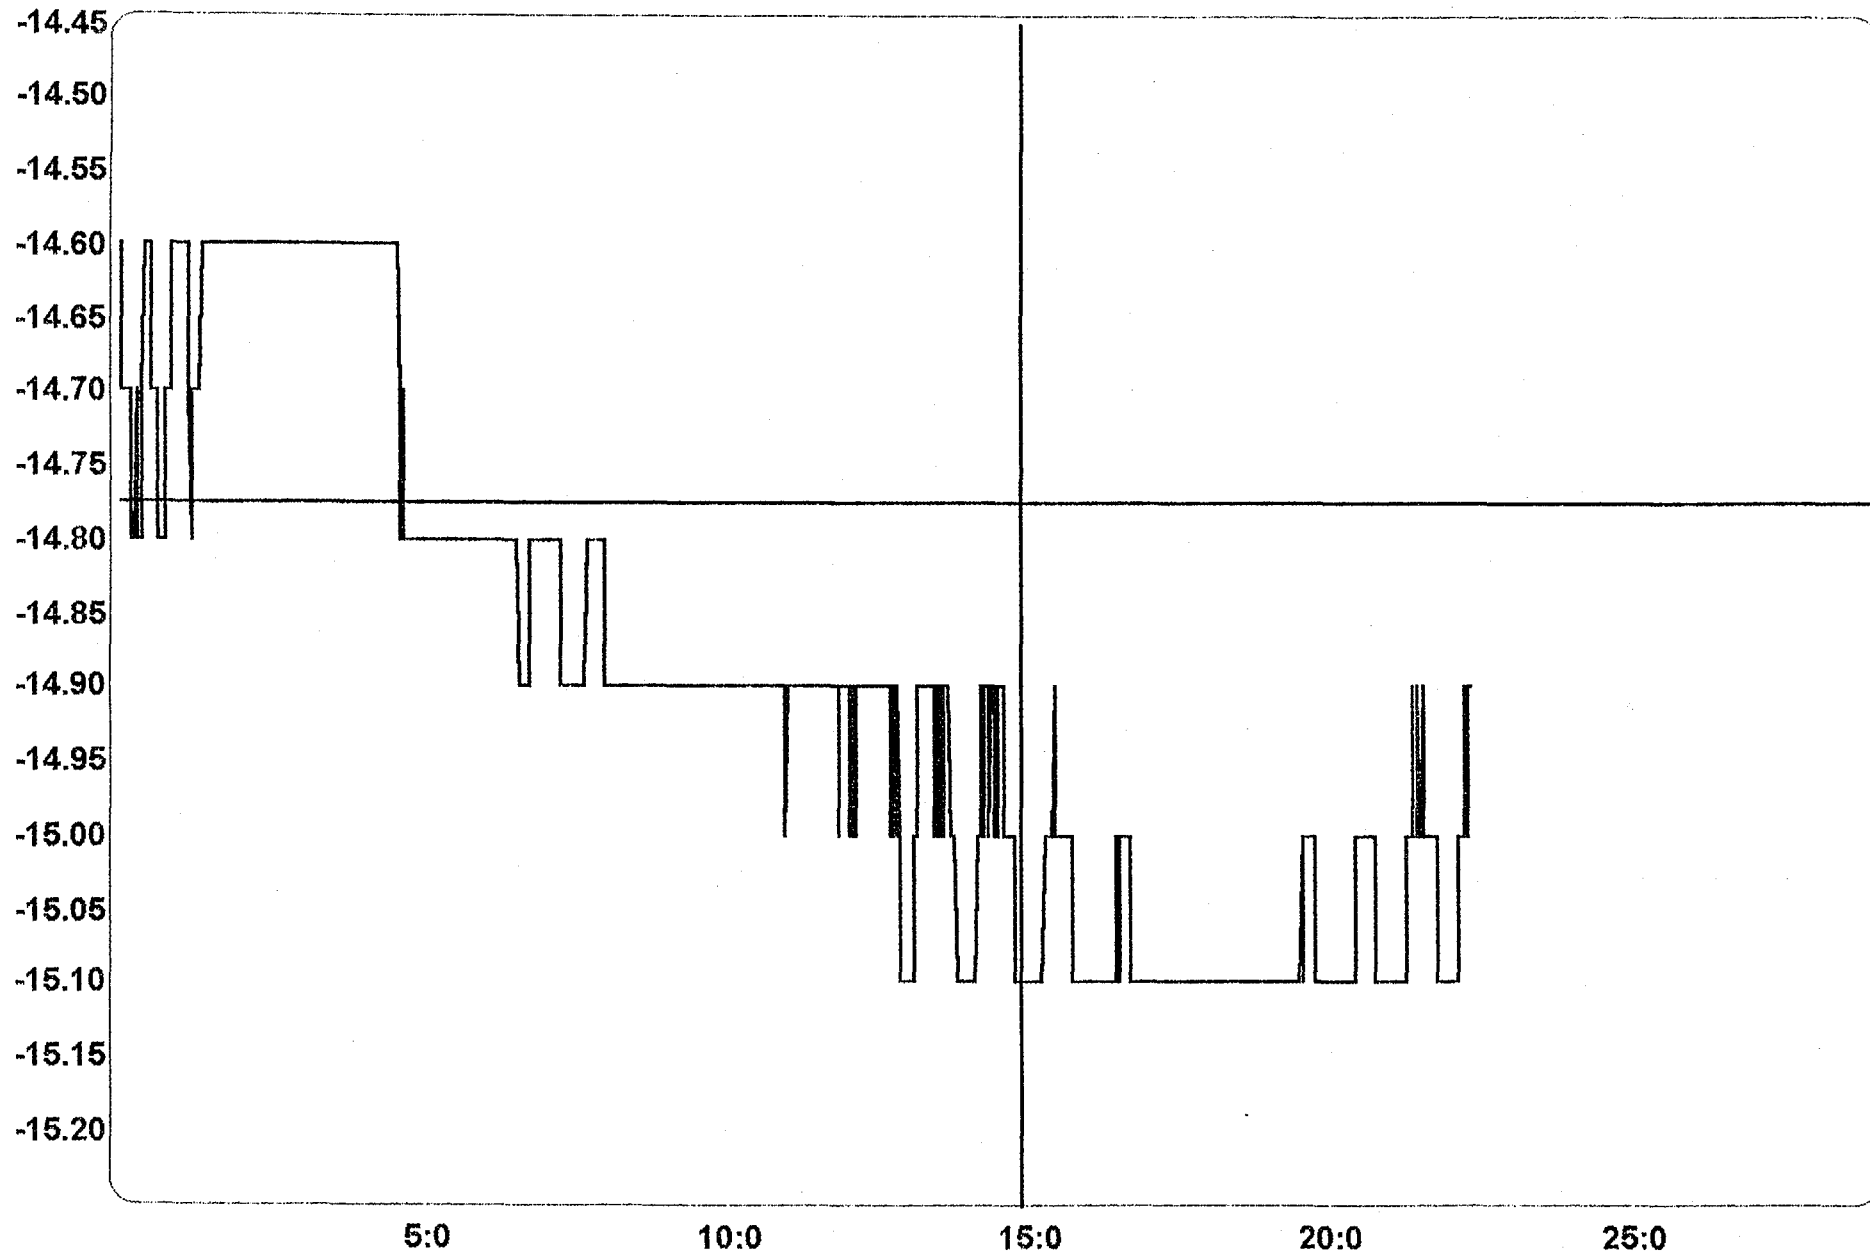

GHANDIL

# Test Sheet

F8-3-1

T16 : -20.05

Mon Oct 25 -99

Time = 11:30

